



City of Columbus
Mayor Gregory S. Lashutka

Department of Public Utilities

James P. Joyce, P.E., Director

October 26, 1992

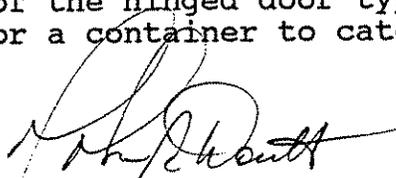
Rule and Regulation No. 92-5
Division of Water
Department of Public Utilities

SUBJ: METER ACCESSIBILITY


Pursuant to Columbus City Code 1105.038(C), the following procedures will be used whenever a customer encloses their water metering system.

If a customer wishes to enclose the metering system after its installation by constructing a false wall or enclosure, the following stipulations must be adhered to:

1. An enclosure can only be used for meter sizes 5/8" thru 1 1/2".
2. The opening of the enclosed area must be no smaller than 3' X 3' so the metering system, including the stop and waste valve, is accessible to the repairer.
3. The opening must be centered directly in front of the meter setting.
4. The opening should be of the hinged door type and must also allow room for a container to catch backflow water.


John R. Doult, P.E.
Administrator
Division of Water

APPROVED:


James P. Joyce, P.E., Director
Department of Public Utilities

Published in City Bulletin 11/7/92

Utilities Complex

10 Dublin Road, Columbus, Ohio 43215-9060

Director's Office
Electricity Division
Sewerage and Drainage Division

Water Division

614 645-6141
614 645-8371
614 645-7175
FAX 614 645-3801
614 645-7020
FAX 614 645-8177



Solid Waste Reduction Facility

2500 Jackson Pike
Columbus, Ohio 43223

614 645-3147
FAX 614 645-3654