



1. Monuments to be set at points shown on the plans or directed by engineer.
2. Letters "W.M." to be etched in concrete to depth of approximately 1/16".
Letters to be 2" high.

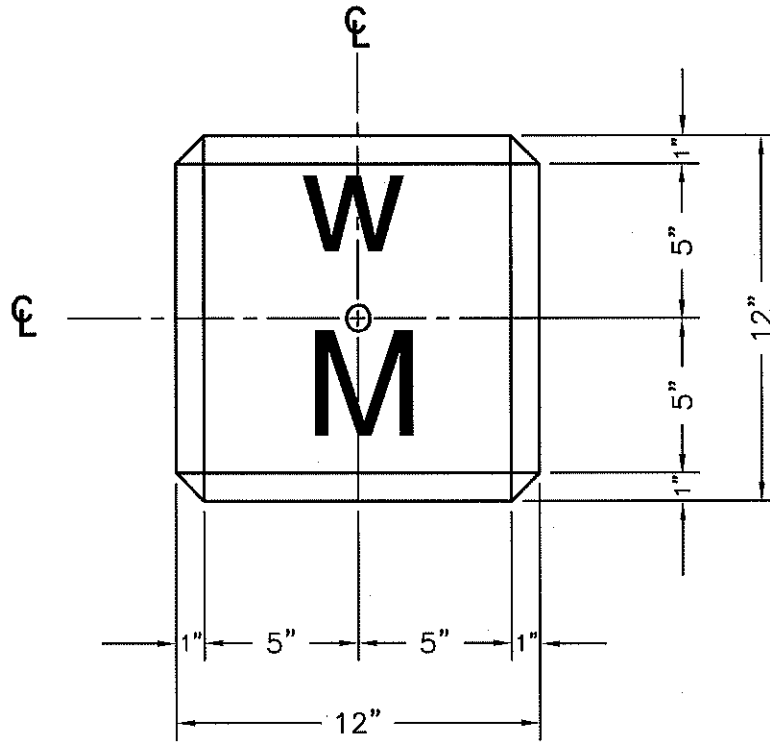

18" X 1" DIAMETER BRASS PIPE

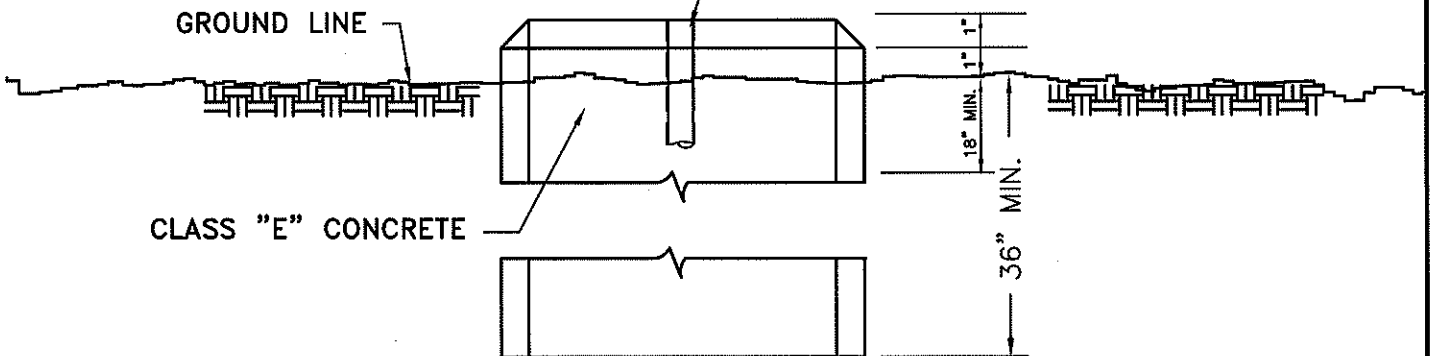

CITY OF COLUMBUS
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

APPROVED:
R. C. Westphall
ADMINISTRATOR
1-26-18
DATE

STANDARD DETAIL
WATER MAIN CENTERLINE
REFERENCE MONUMENT

