



Installation shall follow "L-9002B".

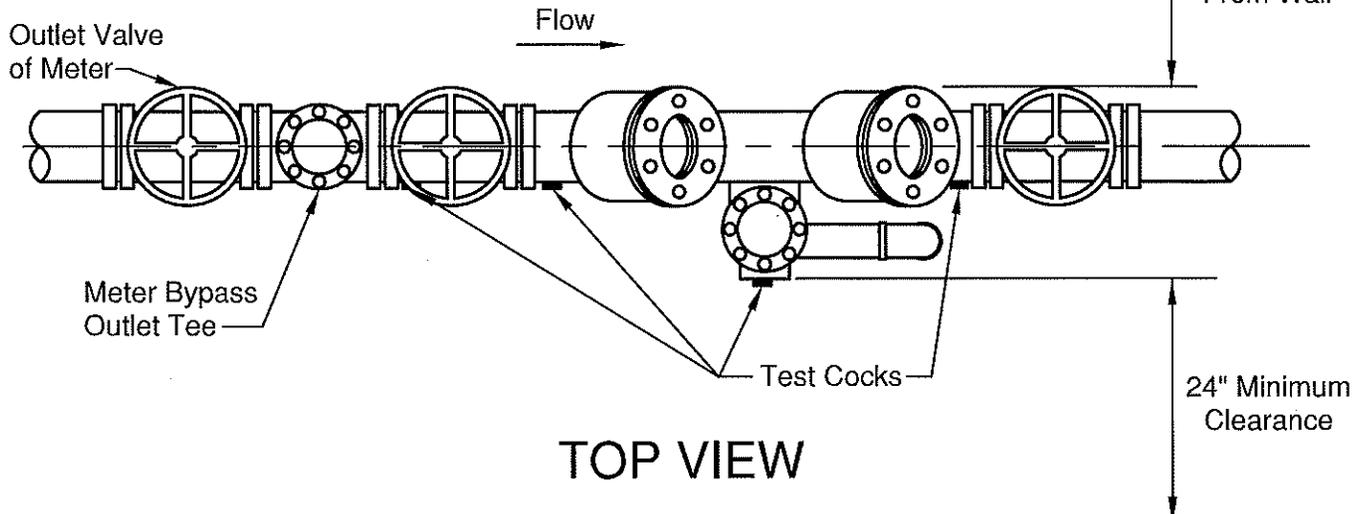

TOP VIEW

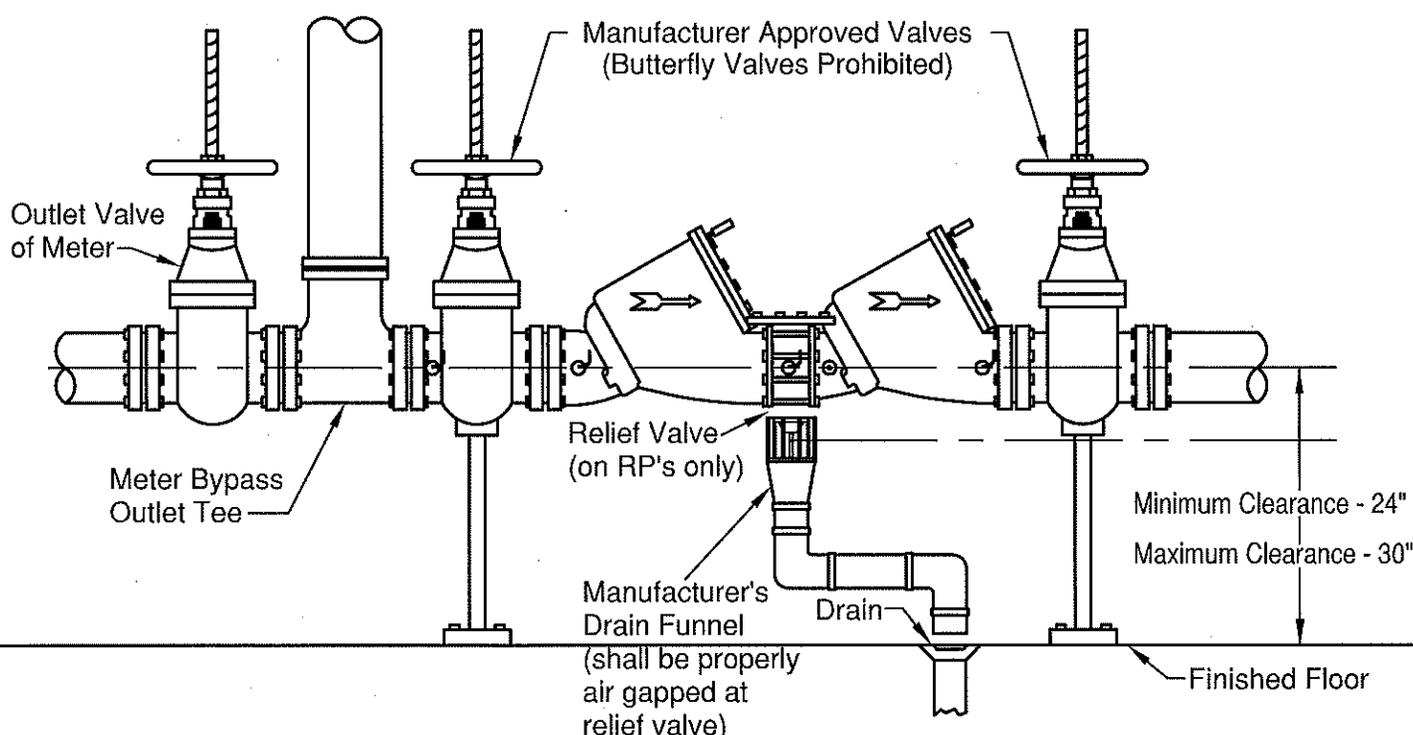

SIDE VIEW

L-9002A.Dwg Revision Date: 4/24/13

CITY OF COLUMBUS
 DEPARTMENT OF PUBLIC UTILITIES
 DIVISION OF WATER

APPROVED:
RC Westerfield 1-26-18
 ADMINISTRATOR DATE

STANDARD DETAIL
**BACKFLOW PREVENTER
 SETTING**
 (FOR DOUBLE CHECK & REDUCED PRESSURE ASSEMBLIES)

