


The only plumbing equipment on the supply line to the irrigation system shall be one shut-off valve and one hose connection with a non-removable approved vacuum breaker. Winterizing procedures shall not subject the backflow assembly or interior plumbing system to backpressure from the irrigation system. All connections to the interior plumbing system must be performed by a licensed plumber.

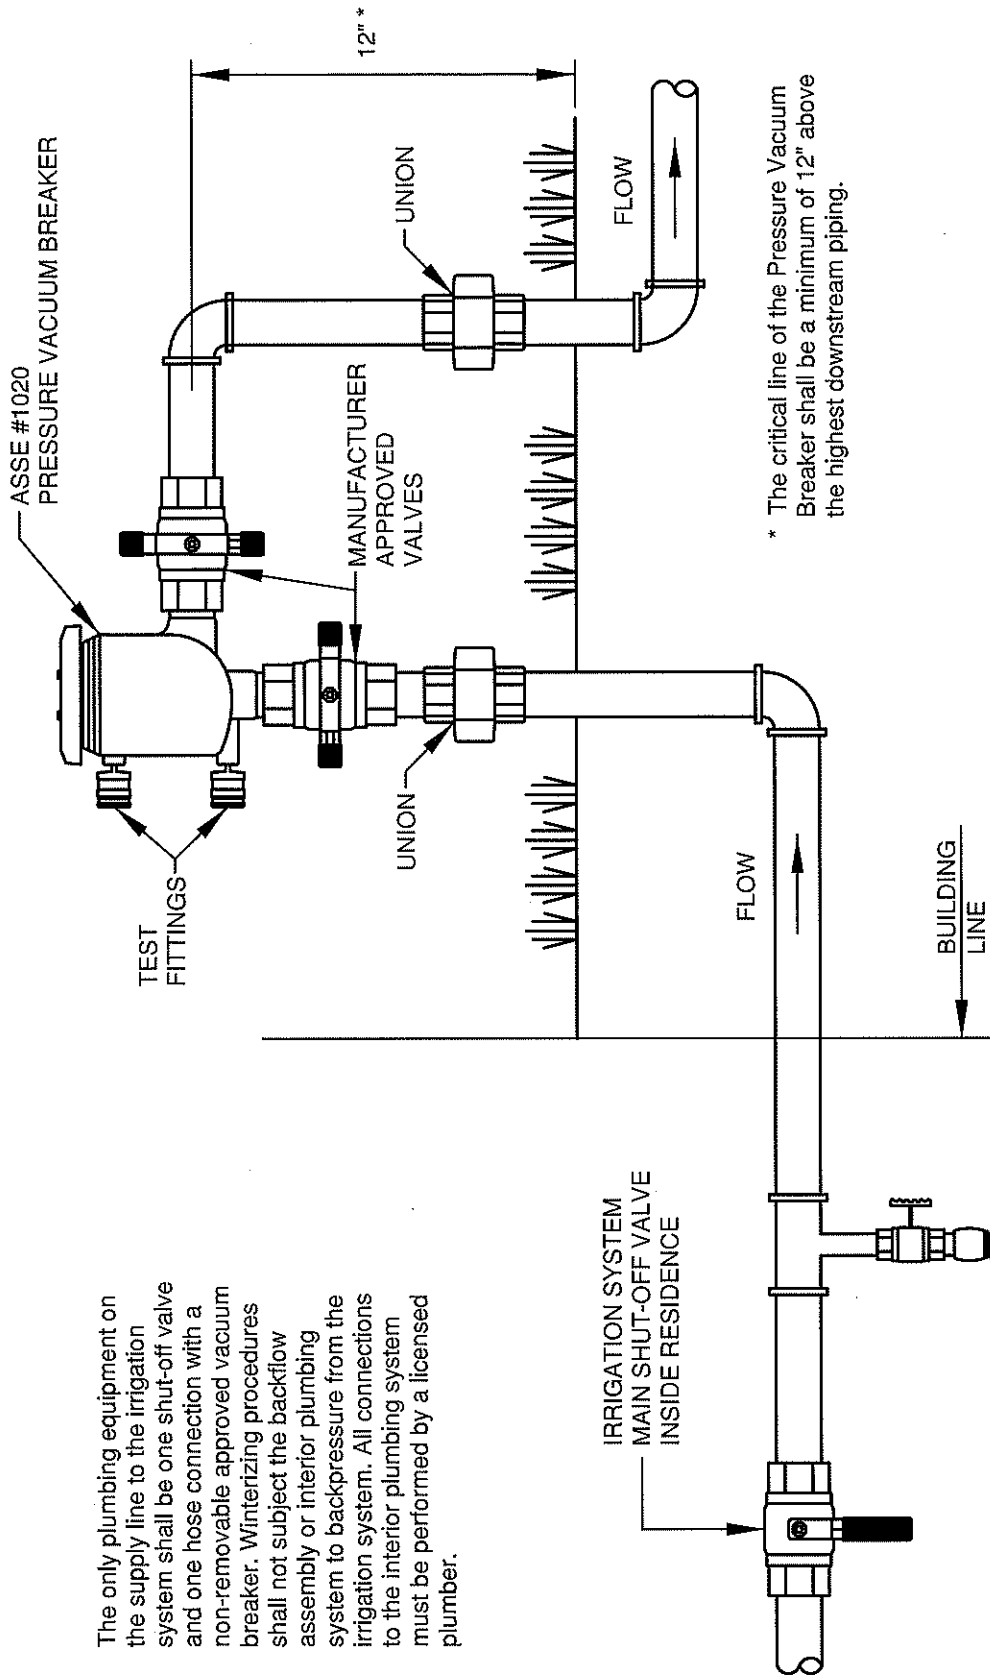

\* The critical line of the Pressure Vacuum Breaker shall be a minimum of 12" above the highest downstream piping.

CITY OF COLUMBUS  
DEPARTMENT OF PUBLIC UTILITIES  
DIVISION OF WATER

APPROVED:

*R.C. Westerfield*  
ADMINISTRATOR

1-26-18  
DATE

STANDARD DETAIL  
TYPICAL RESIDENTIAL INSTALLATION  
OF PRESSURE VACUUM BREAKER  
FOR IRRIGATION SYSTEM

