


Note:

For Manhole and Valve Box Details please refer to Division of Water Standard Drawing "L-9401B".

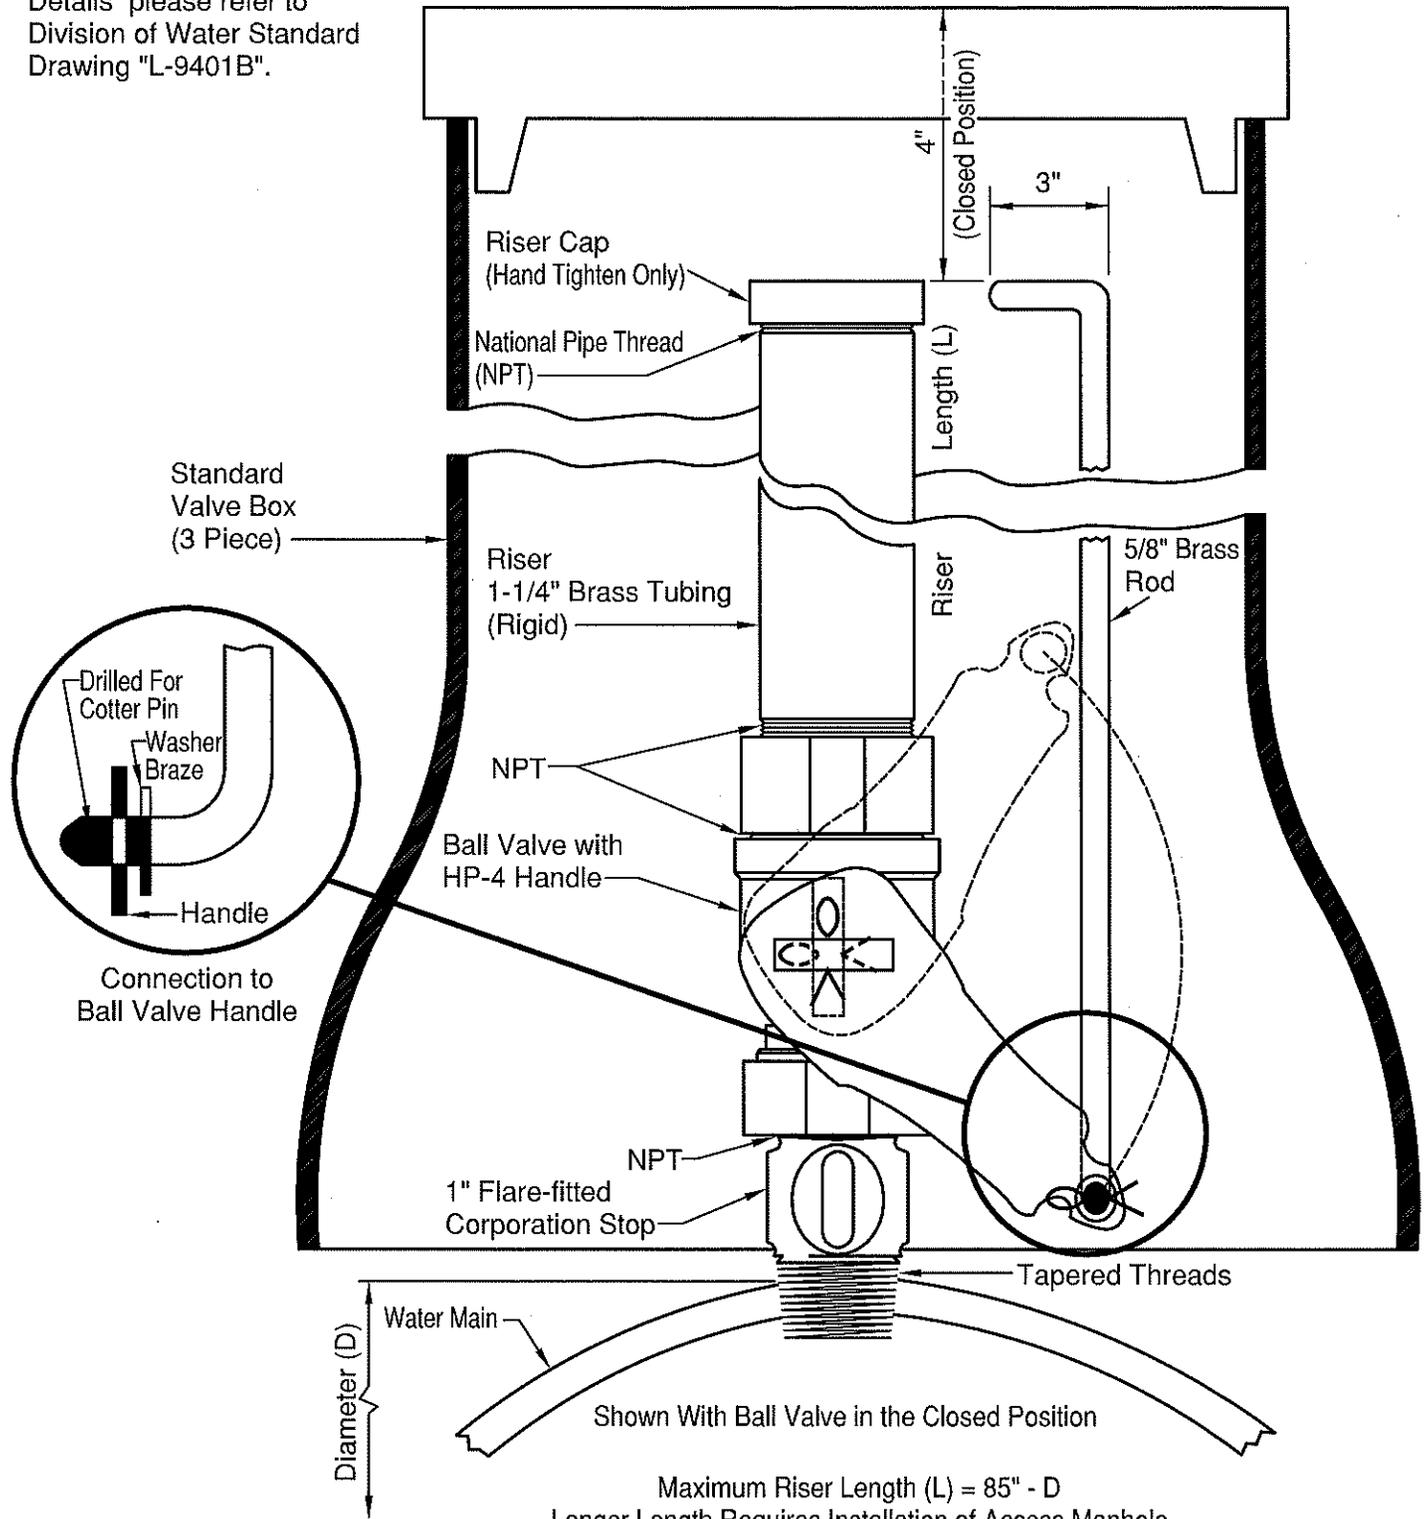

L-9401A.Dwg Revision Date: 1/2/13

CITY OF COLUMBUS
 DEPARTMENT OF PUBLIC UTILITIES
 DIVISION OF WATER

APPROVED:
R.C. Westfield
 ADMINISTRATOR

1-26-18
 DATE

STANDARD DETAIL

PITOMETER CONNECTIONS

