


FOR FIRE SERVICE
CONTINUE WITH D.I.P. OR
SWITCH TO C-900 OR C-909.
CHANGE SIZE IF APPLICABLE

FOR DOMESTIC SERVICE
CONTINUE w/ D.I.P.
TO BACKFLOW PREVENTER SETTING

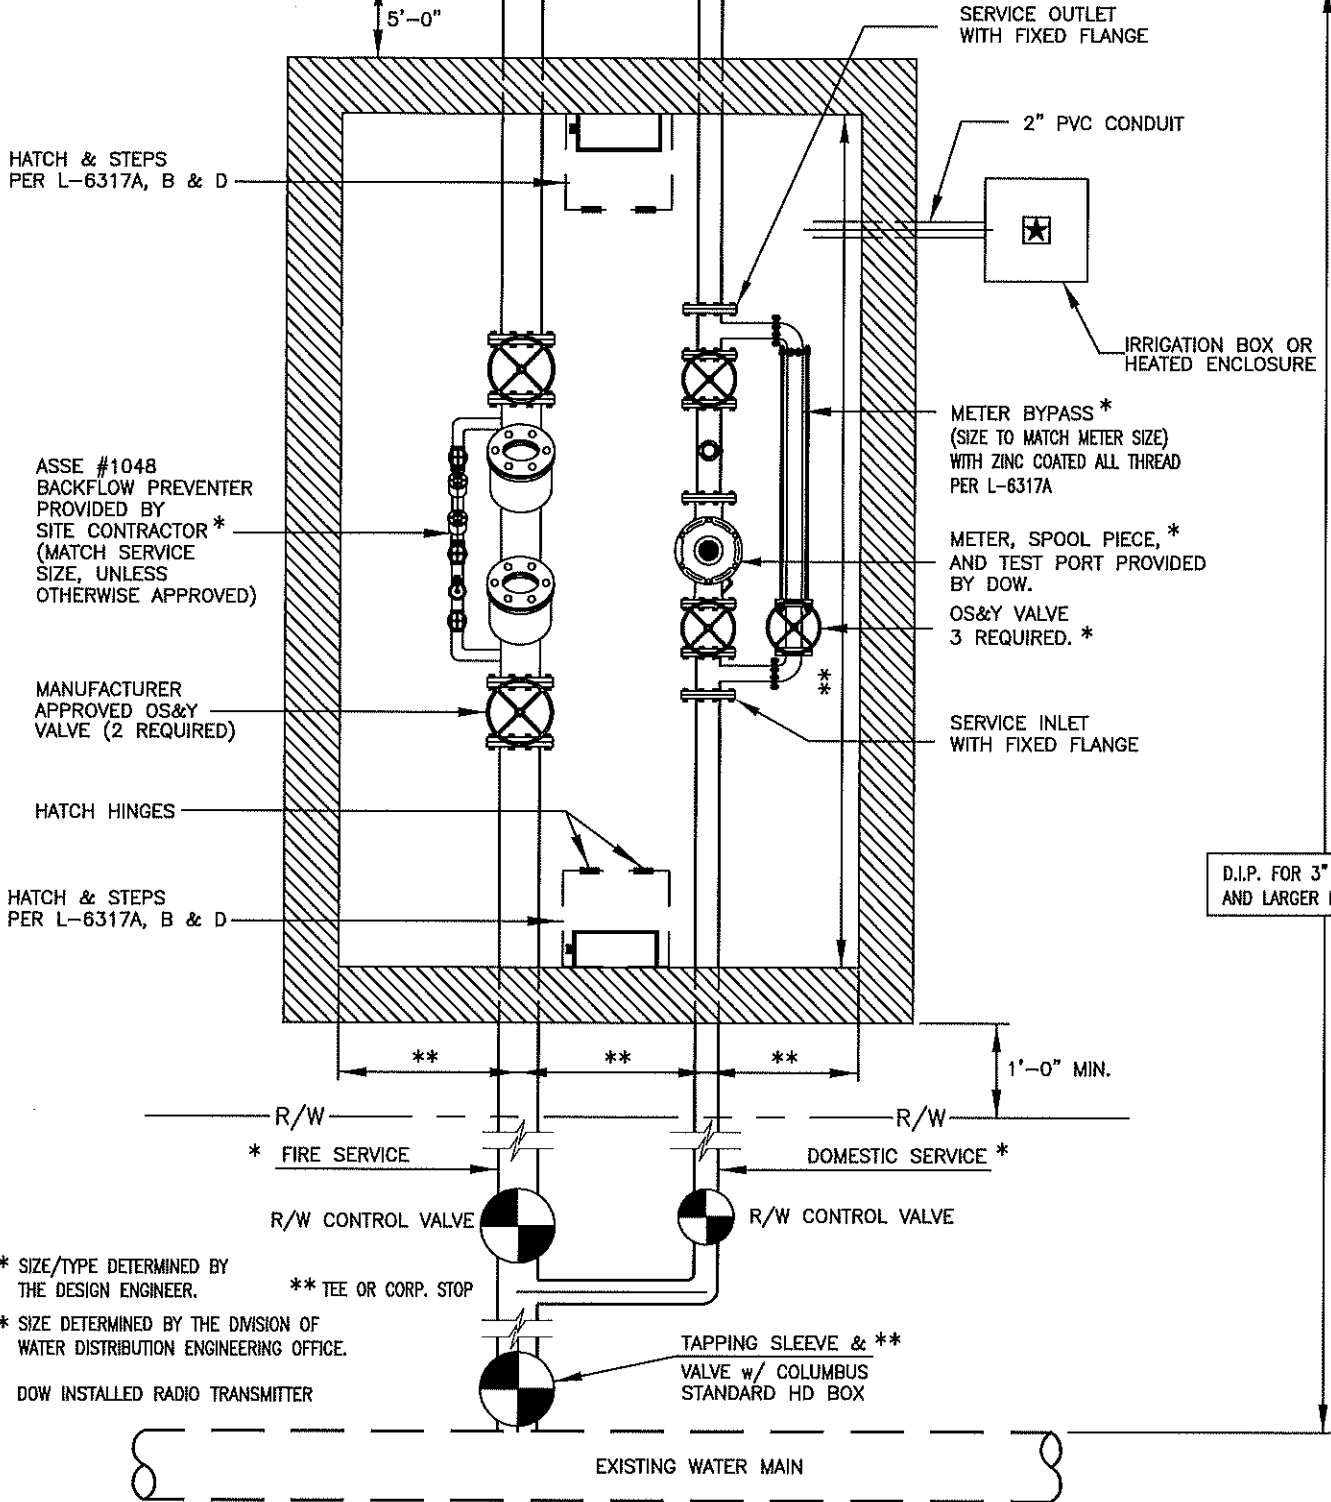

SEE DETAILS L-6317A, L-6317B AND L-6317D FOR VAULT DETAILS NOT SHOWN ON THIS DETAIL.

CITY OF COLUMBUS
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

STANDARD DETAIL

APPROVED:

Danella Pottash

5/17/21
DATE

ADMINISTRATOR

DUAL METER SETTING
3" THRU 12" METERS

L-6317E