

**\* NOTE:**

For reference in placing new corporation stops, curb stops and curb boxes see L-9901.




DOW Provided Radio Transmitter installed per manufacturer's specs

2'-0" Min.  
10'-0" Max.

9 1/2" x 20" x 11 1/2" Cast Iron Reducing Frame with 11 1/2" Dia. Composite 'worm' type locking Top Lid along w/ a Frost Proof Plastic Inner Lid. (Division of Water Approved)

Finished Grade Slope away from Lid at 1 inch per foot

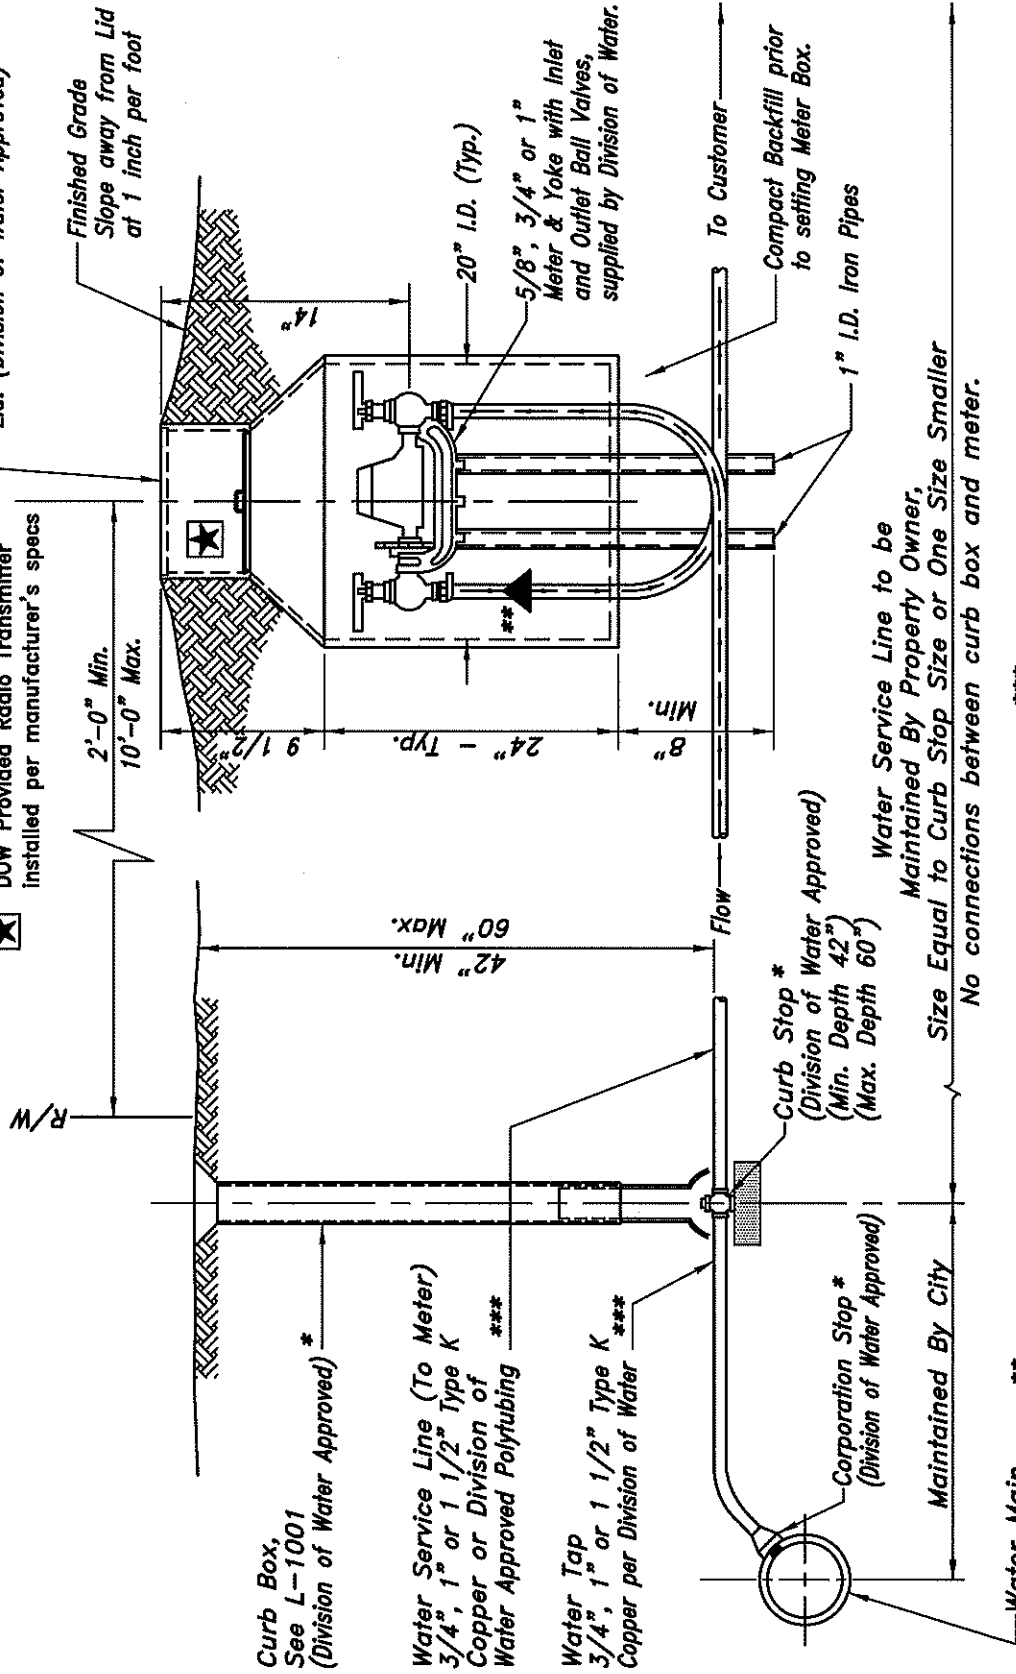

Curb Box, See L-1001 (Division of Water Approved) \*

Water Service Line (To Meter) 3/4", 1" or 1 1/2" Type K Copper or Division of Water Approved Polytubing \*\*\*

Water Tap 3/4", 1" or 1 1/2" Type K Copper per Division of Water \*\*\*

Curb Stop \* (Division of Water Approved) (Min. Depth 42" (Max. Depth 60"))

Corporation Stop \* (Division of Water Approved) |

Maintained By City

Water Main

Water Service Line to be Maintained By Property Owner, Size Equal to Curb Stop Size or One Size Smaller No connections between curb box and meter.

**\*\* NOTE:**

If the Meter size is less than the Water Service Line size, any Reducers/Incrasers shall be placed on the vertical outlet piping inside of the Meter Box.

**\*\*\* NOTE:**

Pipe Shall Be Copper Tubing Size (C.T.S.)

CITY OF COLUMBUS  
DEPARTMENT OF PUBLIC UTILITIES  
DIVISION OF WATER

STANDARD DETAIL  
METER BOX INSTALLATION  
5/8" THRU 1" METER



APPROVED:  
*R C Winterfeld* 2-20-18  
ADMINISTRATOR DATE