


### SLAB METER SET

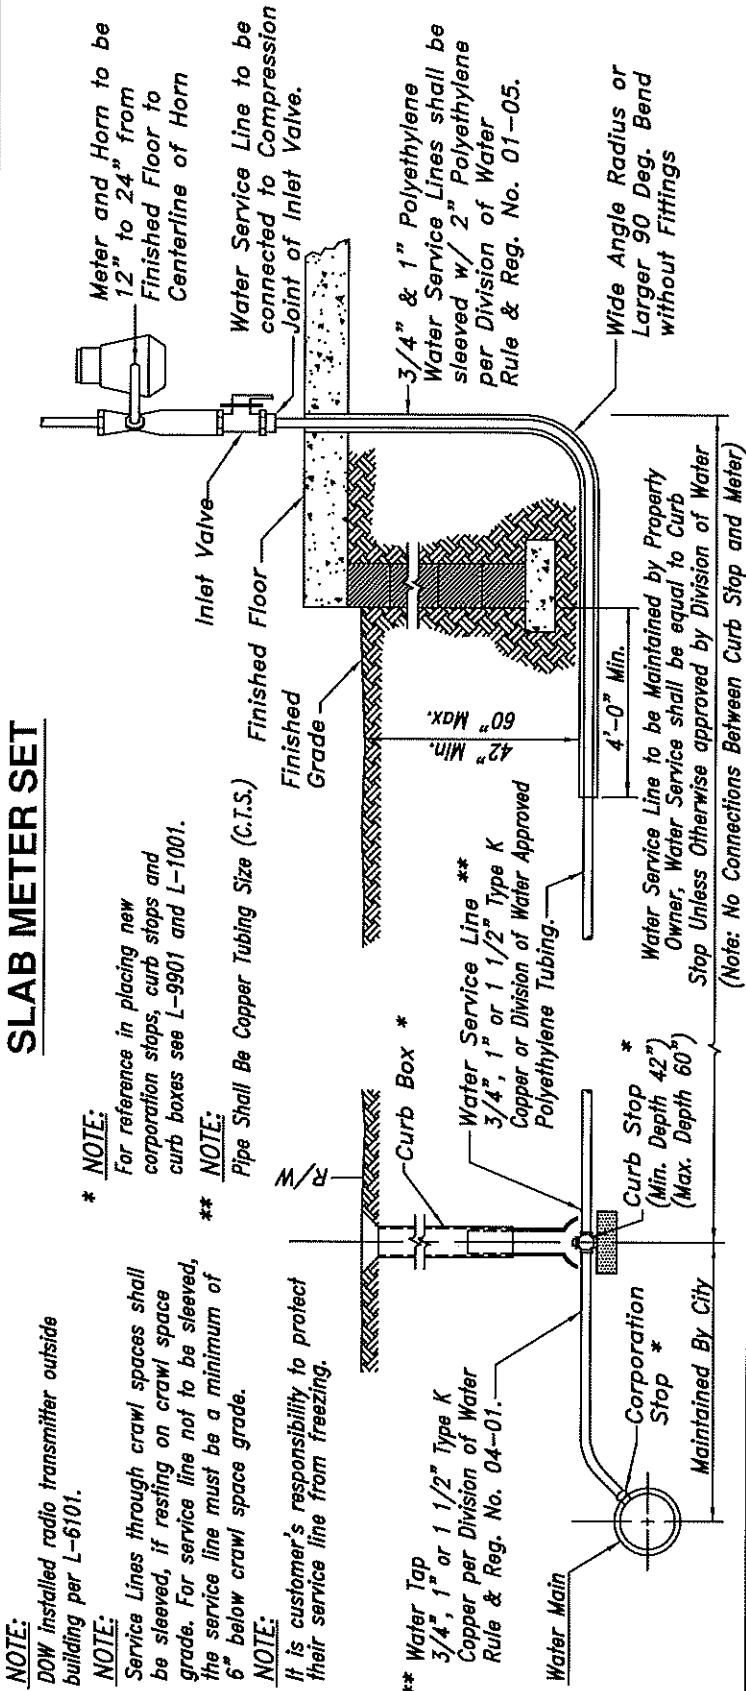

**NOTE:**  
DOW installed radio transmitter outside building per L-6101.

**NOTE:**  
Service Lines through crawl spaces shall be sleeved, if resting on crawl space grade. For service line not to be sleeved, the service line must be a minimum of 6" below crawl space grade.

**NOTE:**  
It is customer's responsibility to protect their service line from freezing.

\* **NOTE:**

For reference in placing new corporation stops, curb stops and curb boxes see L-9901 and L-1001.

\*\* **NOTE:**

Pipe Shall Be Copper Tubing Size (C.T.S.)


\* **NOTE:**

For reference in placing new corporation stops, curb stops and curb boxes see L-9901 and L-1001.

\*\* **NOTE:**

Pipe Shall Be Copper Tubing Size (C.T.S.)

### BASEMENT METER SET

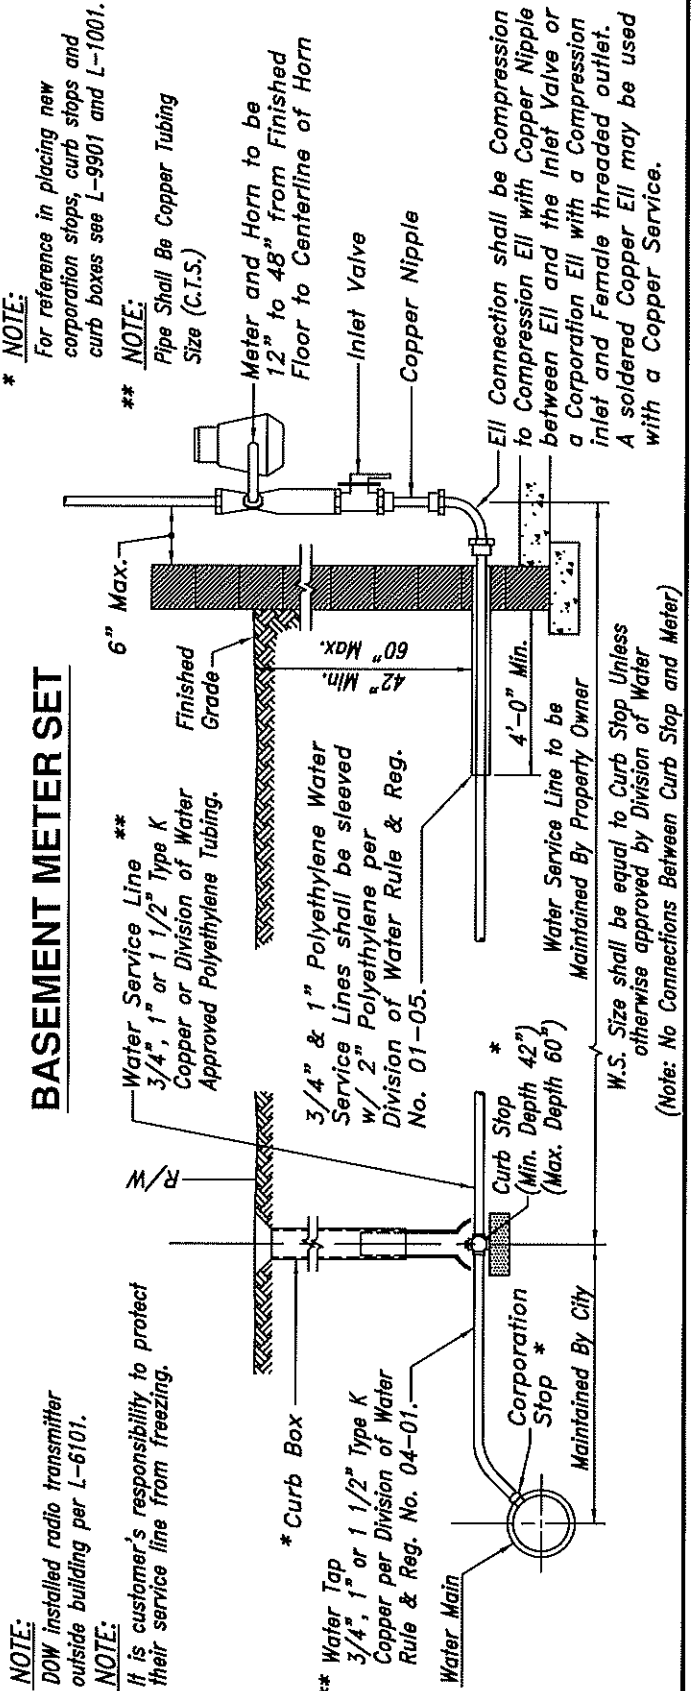

**NOTE:**

DOW installed radio transmitter outside building per L-6101.

**NOTE:**

It is customer's responsibility to protect their service line from freezing.

\*\* **NOTE:**

Pipe Shall Be Copper Tubing Size (C.T.S.)



CITY OF COLUMBUS  
DEPARTMENT OF PUBLIC UTILITIES  
DIVISION OF WATER

APPROVED:  
*Donella Pottend*  
ADMINISTRATOR

5/17/21  
DATE

STANDARD DETAIL  
METER INSTALLATION IN BUILDING  
5/8" THRU 1" METERS