



**NOTES**

- (1) WHERE STREET LIGHTS AND/OR STREET TREES ARE PROPOSED, A MINIMUM CLEAR DISTANCE OF 10'-0" SHALL BE MAINTAINED BETWEEN THE CENTER OF THE STREET TREE TRUNK AND THE CENTER OF THE STREET LIGHT LUMINAIRE. DESIGNER SHALL COMPLY WITH THE "DOWNTOWN STREETScape STANDARDS".
- (2) WHERE STREET LIGHTS AND/OR STREET TREES ARE PROPOSED A MINIMUM CLEAR DISTANCE OF 10'-0" SHALL BE MAINTAINED BETWEEN THE OUTER EDGE OF THE STREET TREE MATURE CANOPY AND THE CENTER OF THE STREET LIGHT LUMINAIRE.
- (3) ALL PROPOSED AND EXISTING STREET TREES SHALL BE MAINTAINED AS PER THE "TREE PRUNING STANDARDS" INDICATED IN THE "DOWNTOWN STREETScape STANDARDS" REFERENCED IN THE "CITY OF COLUMBUS DOWNTOWN STREET LIGHT MASTERPLAN".

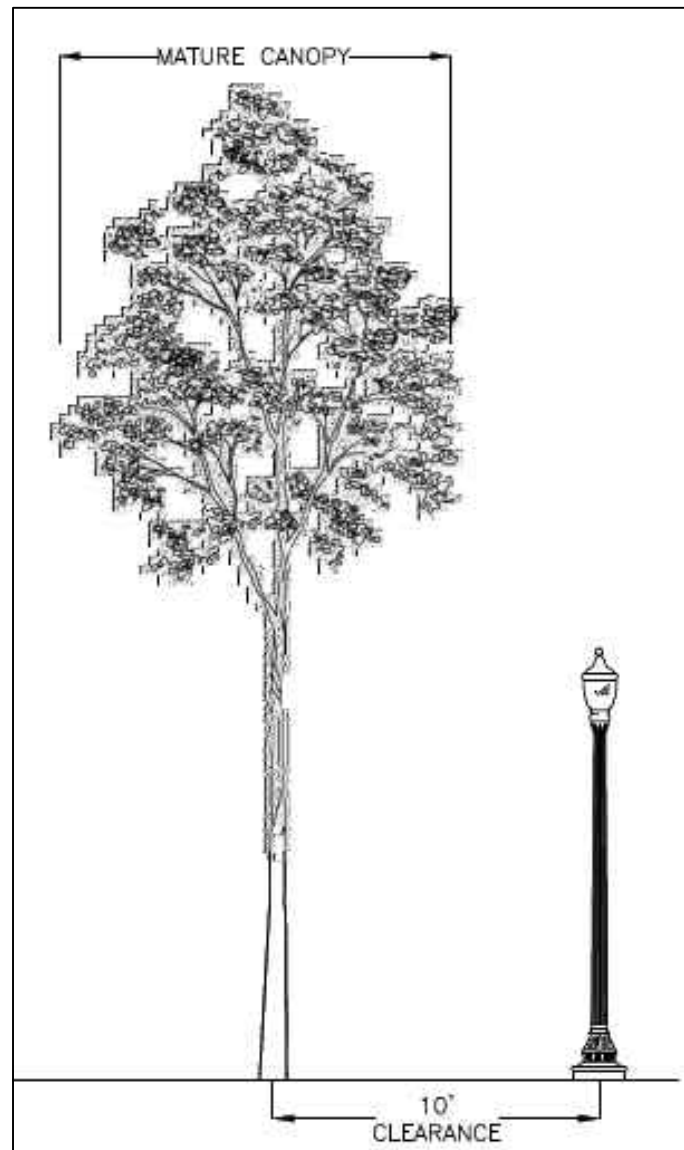

DOWNTOWN DISTRICT APPLICATION -  
SEE NOTE (1)

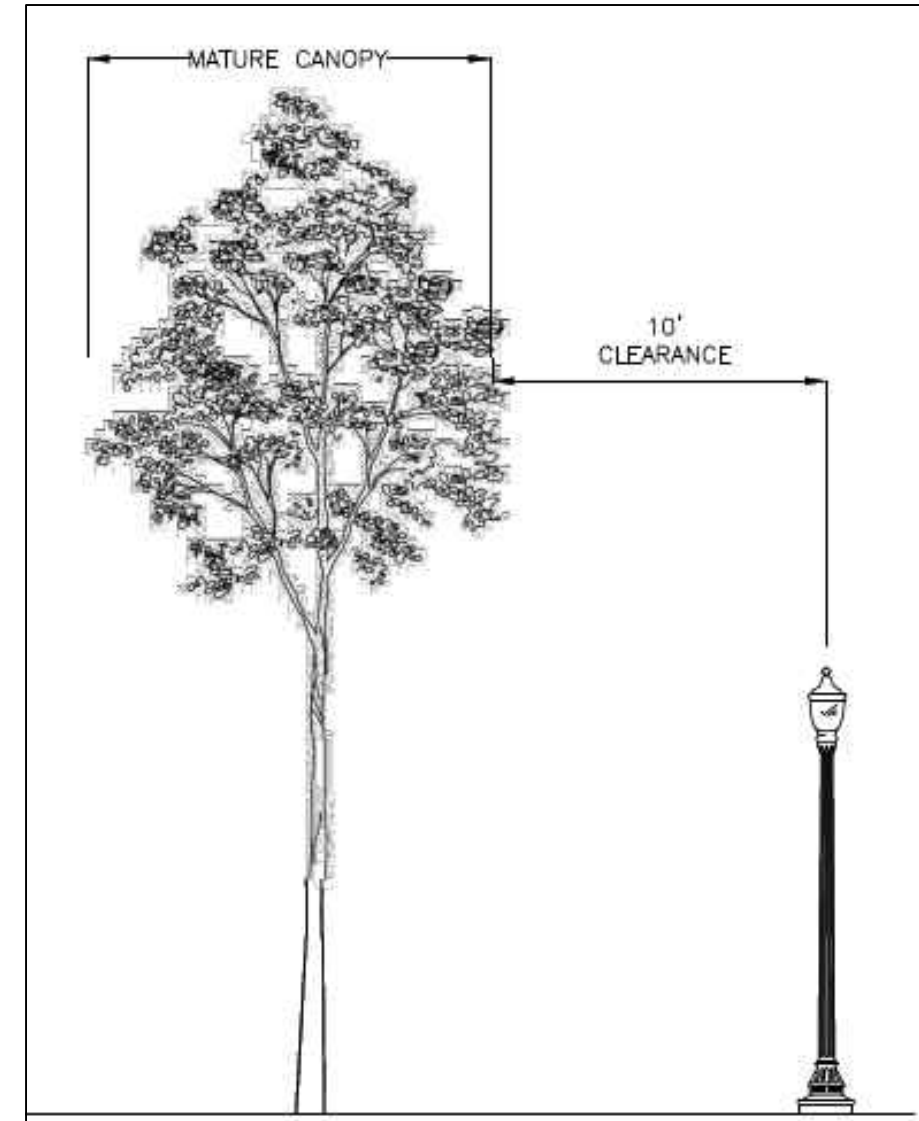

URBAN AND RURAL APPLICATION  
- SEE NOTE (2)

**MIS-58**

CITY OF COLUMBUS, OHIO DEPT. OF PUBLIC UTILITIES - DIVISION OF POWER		
<b>MINIMUM TREE CLEARANCE FOR DOWNTOWN, URBAN, &amp; RURAL AREAS</b>		
DRAWN BY: BEN	DATE: 1/1/2018	
APPROVED: <i>Amy A. Wilfong</i>		
SCALE: NONE	SHEET: 1 OF 1	58