

**APPLICATION**

THE LED COBRA HEAD LUMINAIRE MAY BE USED FOR:

- A. NEW INSTALLATION OF COBRA HEAD LUMINAIRES ON NEWLY PLACED POLES AS PER PLAN
- B. REPLACING EXISTING HID LUMINAIRES ON EXISTING POLES WHERE SPACING REMAINS UNCHANGED.

**LED COBRAHEAD GENERAL REQUIREMENTS**

- A. LUMINAIRE SHALL NOT WEIGH MORE THAN 30 POUNDS.
- B. LUMINAIRE SHALL NOT HAVE AN EFFECTIVE PROJECTED AREA (EPA) OF MORE THAN 1.0 SQ. FT.
- C. CORRELATED COLOR TEMPERATURE (CCT): 3000K. WITH A COLOR RENDERING INDEX (CRI) OF 70
- D. AMBIENT OPERATING ENVIRONMENT: -40°C TO +40°C ( -40°F TO 104°F)
- E. VOLTAGE SHALL BE AS SPECIFIED BY THE CITY OF COLUMBUS.
- F. COOLING SYSTEM: PASSIVE HEAT SINK WITH NO FANS, PUMPS, OR LIQUIDS. THE LUMINAIRE SHALL BE RESISTANT TO DEBRIS BUILD-UP THAT MAY DEGRADE HEAT DISSIPATION PERFORMANCE.

**HOUSING ASSEMBLY**

- A. THE LUMINAIRE HOUSING SHALL BE CONSTRUCTED OF DIE-CAST ALUMINUM, AND BE RUST RESISTANT. NO PARTS SHALL BE CONSTRUCTED OF POLYCARBONATES.
- B. THE HOUSING SHALL BE PROVIDED WITH AN INTERNAL BUBBLE LEVEL TO AID IN INSTALLATION.
- C. THE LUMINAIRE HOUSING SHALL INCLUDE A SECURE MAST ARM MOUNT SLIP- FITTER TO ATTACH THE LUMINAIRE TO A 2" IPS BRACKET. THE SLIP-FITTER SHALL ALLOW FOR TILT ADJUSTMENTS 5° ABOVE AND BELOW HORIZONTAL, AND SHALL BE TOTALLY ENCLOSED IN THE LUMINAIRE HOUSING.
- D. THE LUMINAIRE HOUSING SHALL ALLOW FOR TOOL-LESS ENTRY. ALL SCREWS SHALL BE STAINLESS STEEL.

**DOOR ASSEMBLY**

- A. THE LUMINAIRE DOOR ASSEMBLY SHALL BE SECURELY HINGED, AND INCAPABLE OF INVOLUNTARY SEPARATION FROM THE HOUSING.
- B. THE LUMINAIRE DOOR SHALL BE EQUIPPED WITH A LATCHING ACCESS ASSEMBLY.

**PAINT FINISH**

- A. THE PAINT FINISH SHALL BE POLYESTER POWDER COATED WITH A 5-STAGE PRE-TREATMENT PROCESS. THE FINISH COLOR SHALL BE GRAY UNLESS OTHERWISE SPECIFIED BY THE CITY OF COLUMBUS DIVISION OF POWER.
- B. THE PAINT FINISH SHALL ACHIEVE A SCRIBE CREEPAGE RATING OF (7) PER ASTM D 1654 AFTER 5000 HOURS OF SALT / FOG TESTING PER ASTM B117.
- C. PAINTED OR FINISHED COMPONENTS EXPOSED TO THE ENVIRONMENT SHALL EXHIBIT NO GREATER THAN 30% REDUCTION OF GLOSS PER ASTM D523, AFTER 500 HOURS OF UV TESTING PER ASTM G154 CYCLE 6.

**LED POWER SUPPLY / DRIVER**

- A. POWER FACTOR, MINIMUM 0.90
- B. DRIVER OUTPUT CURRENT, mA VARIABLE
- C. DIMMING SIGNAL, CONTROL RANGE, VDC 0 TO 10 .
- D. **GENERAL REQUIREMENTS**
  - 1. THE LED DRIVER SHALL BE MOUNTED INSIDE THE LUMINAIRE HOUSING, REPLACEABLE, PRE-WIRED TO 480V,120V OR AS SPECIFIED, AND READY FOR INSTALLATION.
  - 2. THE DRIVER AND LED ARRAYS SHALL BE DESIGNED FOR MULTI-CURRENT INPUT OPERATIONS WITH 0-10V DRIVER ADJUSTABLE OUTPUT.
  - 3. OUTPUT OPERATING FREQUENCY MUST BE  $\geq$  120HZ, AND INPUT OPERATING FREQUENCY MUST BE 60 HZ.
  - 4. THE LED DRIVER SHALL TOLERATE SUSTAINED OPEN CIRCUIT AND SHORT CIRCUIT OUTPUT CONDITIONS WITHOUT DAMAGE. THE LED DRIVER SHALL HAVE AN INDEPENDENTLY VERIFIED AND DOCUMENTED FAILURE RATE OF  $\leq$  0.01% PER 1000 HOURS.
  - 5. ANY WIRING INSIDE THE DRIVER HOUSING SHALL HAVE A 600V/105°C RATING OR HIGHER.
  - 6. THE LED DRIVER SHALL BE UL CERTIFIED FOR DRY AND DAMP LOCATIONS. ALL OTHER ELECTRICAL COMPONENTS SHALL BE UL LISTED FOR WET LOCATIONS.
  - 7. THE LED DRIVER SHALL COMPLY WITH FCC RULES AND REGULATIONS, TITLE 47 CFR PART 15 NON-CONSUMER, AND HAVE A CLASS "A" SOUND RATING.
  - 8. THE DRIVER SHALL BE RoHS COMPLIANT.


**LED SURGE PROTECTION DEVICE**

- A. THE SURGE PROTECTION DEVICE SHALL COMPLY WITH ANSI C136.37, AND ANSI/IEEE C62.41.2.
- B. EACH SURGE PROTECTION DEVICE SHALL BE INTERNALLY MOUNTED INSIDE THE LUMINAIRE HOUSING, AND BE SPECIFIED FOR 480V OR 120V OPERATION, OR AS SPECIFIED.
- C. THE SURGE PROTECTION DEVICE SHALL HAVE A MINIMUM 10 KV / 5KA SURGE PROTECTION.
- D. THE SURGE PROTECTION DEVICE SHALL BE A UL 1449 TYPE 4 RECOGNIZED COMPONENT FOR TYPE 2 LOCATIONS.

<b>MIS-800</b>	DEPARTMENT OF PUBLIC UTILITIES - DIVISION OF POWER CITY OF COLUMBUS, OHIO		
	<b>LUMINAIRE, LED, COBRA HEAD</b>		
	DRAWN BY: SAW	DATE: 12/21/23	
	SCALE: NONE	SHEET: 1 OF 4	800

**LED MODULE / ARRAY REQUIREMENTS**

- A. THE LED MODULE(S) / ARRAY(S) SHALL DELIVER A MINIMUM OF 70% OF INITIAL LUMENS WHEN INSTALLED FOR 100,000 HOURS AND OPERATING AT TEMPERATURES OF 40°C (104°F) OR LESS. LESS THAN THIS VALUE WILL BE CONSIDERED A LUMINAIRE FAILURE, AND SUBJECT TO REPLACEMENT UNDER THE 10 YEAR MANUFACTURER'S WARRANTY.
- B. THE LED MODULE(S) / ARRAY(S) SHALL PRODUCE LIGHTING DISTRIBUTION TYPES IN ACCORDANCE WITH IESNA LIGHTING DISTRIBUTION TYPES AS RECOMMENDED BY RP-08 (latest version)
- C. LLD, LDD AND LLF CALCULATIONS
  - 1. THE LAMP LUMEN DEPRECIATION FACTOR (LLD) SHALL BE SUPPORTED BY TM-21 DATA @ 25 °C FOR 50,000 HOURS. IT IS THE RESPONSIBILITY OF EACH MANUFACTURER TO PROVIDE A CALCULATION OF LAMP LUMEN DEPRECIATION (LLD).
  - 2. THE LUMINAIRE DIRT DEPRECIATION FACTOR (LDD) SHALL BE 0.85 FOR UV STABILIZED ACRYLIC OPTICS, AND 0.90 FOR GLASS OPTICS.
  - 3. THE LIGHT LOSS FACTOR (LLF) USED IN PHOTOMETRIC LAYOUT CALCULATIONS SHALL BE THE PRODUCT OF LDD AND THE MANUFACTURER'S PROJECTED LAMP LUMEN DEPRECIATION AT 100,000 HOURS AT 25°C AMBIENT TEMPERATURE.
- D. OPTICAL SYSTEM COMPONENTS SHALL BE IP66 RATED TO PROTECT AGAINST WATER, DIRT, AND INSECT INFILTRATION, AND BE RoHS COMPLIANT.
- E. LUMINAIRE CIRCUITRY SHALL INCLUDE QUICK CONNECT / DISCONNECT FOR EASY SEPARATION. SEE FIGURE 1.

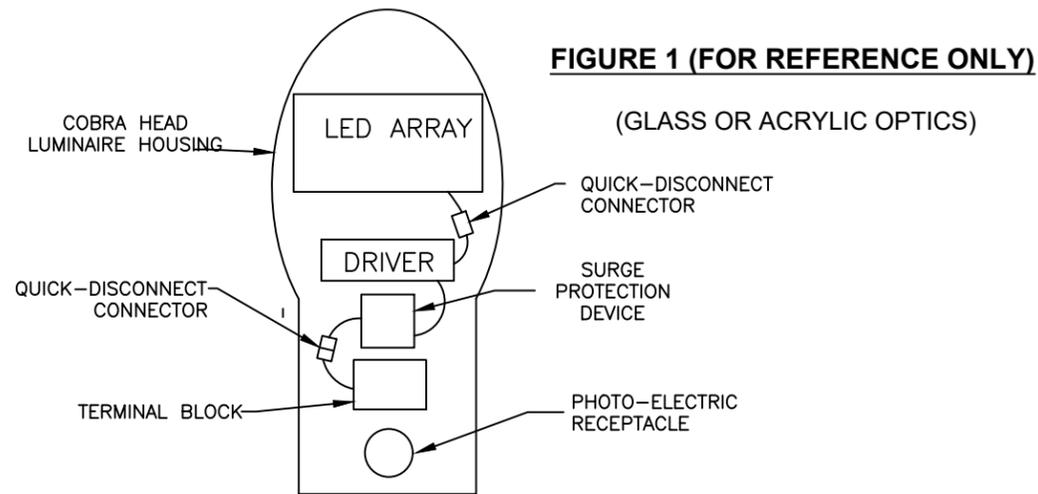

- D. THE MINIMUM OPTICAL PERFORMANCE FROM A LUMINAIRE AND IT'S COMPONENTS FOR A GIVEN APPLICATION OR PROJECT IS DEFINED BY THE "CITY OF COLUMBUS, DIVISION OF POWER STREET LIGHTING DESIGN GUIDE", IN CONJUNCTION WITH THE RECOMMENDED PRACTICES OF IESNA RP-08.

**7-PIN PHOTO-ELECTRIC RECEPTACLE**

- A. THE LUMINAIRE SHALL BE FURNISHED WITH A 7-PIN PHOTO-ELECTRIC RECEPTACLE INSTALLED IN THE TOP OF THE LUMINAIRE HOUSING. THE RECEPTACLE SHALL BE TWIST LOCK TYPE, AND HAVE THE CAPABILITY TO BE DIRECTIONALLY ADJUSTED.
- B. THE 7-PIN PHOTO -ELECTRIC RECEPTACLE SHALL BE SUITABLE FOR OPERATION WITH LED LUMINAIRES, AND CONFORM TO ANSI DESIGN STANDARD C136.10.
- C. THE PHOTO-ELECTRIC RECEPTACLE SHALL ACCOMMODATE DIMMING AND / OR AUTOMATION INTEGRATION PER ANSI C 136.41 WITH THE INSTALLATION OF NODES OR EXTERNAL EQUIPMENT AS REQUIRED.

**7-PIN LONG LIFE PHOTO CONTROL (AS REQUIRED BY THE ENGINEER)**

- A. THE LUMINAIRE SHALL BE SUPPLIED WITH A "LONG LIFE" PHOTO CONTROL THAT SHALL BE SOLID STATE, & SUITABLE FOR USE WITH 7-PIN PHOTO CONTROL RECEPTACLES AND LED LUMINAIRES.
- B. THE PHOTO CONTROL SHALL HAVE A MINIMUM DESIGN LIFE OF 20 YEARS.

**SHORTING CAP FOR 7-PIN LED PHOTO-ELECTRIC RECEPTACLE**

- A. THE LUMINAIRE SHALL BE SUPPLIED WITH A SHORTING CAP SUITABLE FOR OPERATION WITH A 7-PIN LED PHOTO ELECTRIC RECEPTACLE. THE SHORTING CAP SHALL CONTAIN A GASKET AROUND THE OUTER PERIMETER OF THE CAP FOR PROPER SEALING AGAINST DEBRIS.
- B. THE SHORTING CAP SHALL MEET OR EXCEED ANSI DESIGN STANDARD ANSI C136.10.

**INTERNAL LABELING**

- A. A VISIBLE LABEL SHALL BE ATTACHED TO THE INSIDE SURFACE OF THE LUMINAIRE HOUSING THAT MEETS THE REQUIREMENTS OF ANSI C 136.22. THE LABEL SHALL INCLUDE THE FOLLOWING:
  - 1. MANUFACTURER'S NAME - LUMINAIRE TYPE, AND CATALOG NUMBER
  - 2. MONTH AND YEAR OF MANUFACTURE
  - 3. LINE INPUT VOLTAGE AND WATTAGE
  - 4. FREQUENCY IF OVER 60 HERTZ
  - 5. DESCRIPTIVE WIRING DIAGRAM SHOWING INPUT TERMINALS, DRIVER, PHOTO-CONTROL RECEPTACLE, AND LED ARRAY.

**EXTERNAL NEMA LABELING**

- A. AN EXTERNAL NEMA LABEL SHALL BE INSTALLED ON THE OUTSIDE OF THE LUMINAIRE, AND BE ORIENTED SO THAT IT CAN BE CLEARLY IDENTIFIED FROM GROUND LEVEL.
- B. THE LABEL SHALL BE PER ANSI C136.15 (MOST CURRENT VERSION), AND INDICATE THE WATTAGE OF THE LUMINAIRE.

<b>MIS-800</b>	DEPARTMENT OF PUBLIC UTILITIES - DIVISION OF POWER CITY OF COLUMBUS, OHIO		
	<b>LUMINAIRE, LED, COBRA HEAD</b>		
	DRAWN BY: SAW	DATE: 12/21/23	
	SCALE: NONE	SHEET: 2 OF 4	800

**INSTALLATION**

- A. THE LUMINAIRE SHALL BE INSTALLED ON A 2-3/8" O.D. BRACKET AS SHOWN ON THE CONTRACT DRAWINGS AND MIS SPECIFICATIONS.
- B. ORIENTATION AND LEVELING OF THE UNITS SHALL BE SO AS TO PROVIDE FOR UNIFORM APPEARANCE, MAXIMUM LIGHTING EFFICIENCY AND EASE OF MAINTENANCE..

**WARRANTY**

- A. THE WARRANTY SHALL PROVIDE FOR THE FULL REPLACEMENT OF THE ENTIRE LUMINAIRE ASSEMBLY. THIS INCLUDES THE POWER SUPPLIES / DRIVER, DEFECTIVE ELECTRICAL AND NON-ELECTRICAL PARTS, 7-PIN PHOTOCONTROL RECEPTACLE, AND LIGHT SOURCE FOR A PERIOD OF TEN (10) YEARS FROM DATE OF ACCEPTANCE BY THE DIVISION OF POWER.
- B. NEGLIGIBLE LIGHT OUTPUT FROM MORE THAN 10 PERCENT OF THE LED PACKAGE CONSTITUTES LUMINAIRE FAILURE. THE LUMINAIRE WILL BE REPLACED UNDER THE MANUFACTURER'S 10 YEAR WARRANTY.

**TESTING / CERTIFICATION / STANDARDS / RECOMMENDED PRACTICES**

THE LUMINAIRE SHALL COMPLY WITH THE LATEST VERSIONS OF THE FOLLOWING STANDARDS:

- A. ANSI C136:31 FOR 100,000 CYCLES AT 3G ACCELERATION FOR NORMAL ROAD AND BRIDGE APPLICATIONS.
- B. UL/CUL LISTED, SUITABLE FOR WET LOCATIONS PER UL 1598 OR CSA C22.2 NUMBER 250.
- C. THE LED OPTICAL ASSEMBLY AND DRIVER SHALL BE IP66 RATED PER IEC60529.
- D. LUMINAIRE COMPONENTS AND APPLIED FINISHES SHALL COMPLY WITH THE 1000 HOUR SALT / FOG TEST PER ASTM B117 STANDARD.
- E. LM-79 OPTICAL PERFORMANCE TESTS SHALL BE CONDUCTED IN ACCORDANCE WITH IESNA STANDARD PRACTICES FOR SOLID STATE LIGHTING
- F. THE LUMINAIRE SHALL BE CERTIFIED WITH A BUG RATING (BACKLIGHT, UPLIGHT, GLARE)
- G. IESNA LM-79 H. IESNA LM-80 I. TM-15 J. TM-21 K. ANSI C78.377 L. ANSI C136.10
- M. ANSI C136.22. N. ANSI C136.37 O. ANSI C136.41 P. ASTM D1654 Q. IEEE C62.41.2
- R. IEC 60529 S. UL 1449 (Surge Protection Devices) T. RoHS

**DELIVERY, STORAGE, AND HANDLING**

- A. DELIVERY
  - 1. THE LED LUMINAIRES SHALL BE DELIVERED TO THE JOB SITE IN A MANNER AS TO NOT CAUSE DAMAGE OR REQUIRE REPAIRS.
  - 2. LUMINAIRE SHALL BE 100% FACTORY TESTED PRIOR TO SHIPMENT BY THE MANUFACTURER DELIVERY OF MATERIAL SHALL BE COORDINATED WITH OTHER TRADES TO AVOID DELAYS.
- B. STORAGE OF MATERIALS
  - 1. MATERIAL SHALL BE STORED IN STRICT COMPLIANCE WITH MANUFACTURER'S RECOMMENDATIONS.
- C. HANDLING
  - 1. HANDLE ALL PRODUCTS WITH CARE. ONLY SOUND, UNDAMAGED PRODUCTS WILL BE ACCEPTED.

**SUBMITTALS**

- A. THE FOLLOWING ITEMS SHALL BE INCLUDED IN THE SUBMITTAL PACKAGE:
  - 1. LUMINAIRE SUBMITTAL FORM (SEE SHEET 4)
  - 2. LUMINAIRE CUT SHEET
  - 3. LED DRIVER CUT SHEET
  - 4. LM-79 TEST REPORT
  - 5. TM-21 TEST REPORT
  - 6. LUMINAIRE THERMAL TEST REPORT
  - 7. MANUFACTURER'S TEN (10) YEAR WARRANTY DOCUMENTATION
- B. LM -79 DATA AND TM-21 TEST REPORTS MUST REFLECT THE EXACT CCT, WATTAGE AND VOLTAGE OF THE LUMINAIRE TO BE SUPPLIED. NO PRO-RATED TEST REPORTS WILL BE ACCEPTED.
- C. THE LUMINAIRE THERMAL TEST REPORT MUST REFLECT THE EXACT WATTAGE AND VOLTAGE TO BE SUPPLIED. NO PRO-RATED TEST REPORTS WILL BE ACCEPTED.

<b>MIS-800</b>	DEPARTMENT OF PUBLIC UTILITIES - DIVISION OF POWER CITY OF COLUMBUS, OHIO		
	<b>LUMINAIRE, LED COBRA HEAD</b>		
	DRAWN BY: SAW	DATE: 12/21/23	
	SCALE: NONE	SHEET: 3 OF 4	800

**CITY OF COLUMBUS: DIVISION OF POWER  
LED LUMINAIRE SUBMITTAL FORM  
MATERIAL SPECIFICATION**

Luminaire Catalog Number: \_\_\_\_\_ Manufacturer: \_\_\_\_\_

Project: \_\_\_\_\_ Drawing Number: \_\_\_\_\_

GENERAL CRITERIA: LED LUMINAIRE			
<b>LUMINAIRE</b>	Wattage of Luminaire		
	Voltage of Luminaire		
	Weight of Luminaire		
	Luminaire Effective Projected Area (EPA)		
	Luminaire Housing Finish Color		
<b>MOUNTING METHOD</b>	<input type="checkbox"/> Post-Top <input type="checkbox"/> Side-Arm		
	Tenon Nominal Pipe Size (NPS)		
<b>LENS:</b>	<input type="checkbox"/> Flat <input type="checkbox"/> Sag / Drop <input type="checkbox"/> Teardrop <input type="checkbox"/> Prismatic Acorn/Traditional		
<b>IES FORWARD DISTRIBUTION TYPE</b>	<input type="checkbox"/> I <input type="checkbox"/> II <input type="checkbox"/> III <input type="checkbox"/> IV <input type="checkbox"/> V <input type="checkbox"/> VS		
<b>IES LATERAL DISTRIBUTION TYPE</b>	<input type="checkbox"/> Very Short <input type="checkbox"/> Short <input type="checkbox"/> Medium <input type="checkbox"/> Long <input type="checkbox"/> Very Long		
<b>DRIVER</b>	Variable Output: (Specify Current Output Setting in mA)		
	Minimum Available Output		
	Maximum Available Output		
	Dimmable (0-10 Volts Required)	YES / NO	
<b>ELECTRICAL IMMUNITY</b>	Surge Suppression Installed (Minimum 10 KV / 5 KA)		
<b>PHOTOCONTROL</b>	Photo-control Receptacle Style	7-PIN	<input type="checkbox"/> YES
		TWIST-LOCK	<input type="checkbox"/> YES
	Long Life Photo-control	7-PIN Compatible	<input type="checkbox"/> YES <input type="checkbox"/> NO
	Shorting Cap Included		<input type="checkbox"/> YES <input type="checkbox"/> NO
<b>WARRANTY</b>	Minimum 10 Year All-Inclusive (Full Replacement) Warranty	<input type="checkbox"/> YES <input type="checkbox"/> NO	
PERFORMANCE CRITERIA: LED LUMINAIRE			
<b>NOMINAL CCT</b>	Rated Correlated Color Temperature (3000K)	<input type="checkbox"/> YES <input type="checkbox"/> NO	
<b>LIGHT LOSS FACTOR</b>	(LDD + Projected Lumen Depreciation @ 100,000 HRS in 25°C Ambient Temperature)		
<b>PHOTOPIC<sup>2</sup> DOWNWARD LUMINAIRE OUTPUT</b>	<i>Initial</i> Lumen Output Below Horizontal		
	Maintained Lumen Output Below Horizontal (From LM-79 Test)		
	Minimum <i>maintained</i> Luminaire Output Below Horizontal		
<b>BUG RATING:</b>	Backlight-Up light-Glare Rating		
<b>ANSI VIBRATION TEST LEVEL</b>	Level 1 (Normal) Level 2 (Bridge/Overpass)		
<b>THERMAL ENVIRONMENT</b>	Minimum Ambient Operating Temperature		
	Maximum Ambient Operating Temperature		

**SUGGESTED MANUFACTURERS**

THE FOLLOWING ARE SUGGESTED LED COBRA HEAD STYLE LUMINAIRES FOR USE IN THE CITY OF COLUMBUS.

- A. AMERICAN ELECTRIC LIGHTING (AUTOBAHN SERIES ATB0)  
  
EATON / COOPER LIGHTING (VERDEON SERIES)  
  
GENERAL ELECTRIC (EVOLVE SERIES)
- B. A SUGGESTED LUMINAIRE HAS BEEN PREVIOUSLY USED BY THE CITY OF COLUMBUS, AND SHALL BE USED AS THE BASIS OF DESIGN FOR THE PROJECT IN WHICH THIS SPECIFICATION IS APPLICABLE.
- C. SHOULD THE CONTRACTOR CHOOSE TO SUBSTITUTE THE BASIS OF DESIGN, THE CHOSEN LUMINAIRE MUST MEET ALL TARGET ILLUMINATION CRITERIA AS SPECIFIED BY THE PROJECT. NO MORE THAN A 10% INCREASE IN THE ACTUAL WATTAGE OF THE LUMINAIRE USED AS THE BASIS OF DESIGN WILL BE ALLOWED. THE SUBSTITUTED LUMINAIRE MUST MEET AND COMPLY WITH ALL ITEMS IN THIS SPECIFICATION.

**BASIS OF PAYMENT**

ITEM	UNIT	DESCRIPTION
MIS-800	EACH	LUMINAIRE, LED, COBRAHEAD

<h1>MIS-800</h1>	DEPARTMENT OF PUBLIC UTILITIES - DIVISION OF POWER CITY OF COLUMBUS, OHIO		
	<h2>LUMINAIRE, LED COBRA HEAD</h2>		
	DRAWN BY: SAW	DATE: 12/21/23	
	SCALE: NONE	SHEET: 4 OF 4	800