


ALL NUMBERING BEGINS FROM THE NORTHWEST CORNER AND GOES CLOCKWISE. EACH CORNER HAS ITS SPECIFIC NUMBER THAT SHALL BE USED IF CURB RAMPS ARE IN THESE LOCATIONS.

* MEDIAN RAMPS ON THE WEST AND/OR EAST LEGS WOULD BE M1, M8, AND M4, M5 RESPECTIVELY.

INTERSECTION CURB RAMP NUMBERING SYSTEM

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG
2319


CITY ENGINEER

3/30/2018
SHT 1 OF 21

GENERAL NOTES, CURB RAMPS

1. CURB RAMPS SHALL BE INSTALLED PER STD DWGS 2300, 2319, CMSC 608, AND DPS ADA RULES AND REGULATIONS.
2. MATERIAL: THE RAMP PANEL AND FLARED SIDES SHALL BE CONCRETE.
3. RAMP TYPES ARE CATEGORIZED BELOW IN TIERS BY REQUIRED ORDER OF USE. LOCATING THE RAMP AS CLOSE AS POSSIBLE TO THE INTERSECTION FOLLOWING THE CURB RAMP DESIGN BOUNDARY CONTAINED IN THE ADA RULES AND REGULATIONS IS THE FIRST PRIORITY. THE DESIGNER SHALL NOT USE A LOWER TIERED RAMP WITHOUT FIRST DETERMINING AND HAVING JUSTIFICATION THAT THE UPPER TIER RAMPS ARE NOT CONSTRUCTIBLE.

CITY OF COLUMBUS RAMP TYPE HIERARCHY

TIER 1 (THESE PERPENDICULAR RAMPS SHOULD BE UTILIZED WHENEVER POSSIBLE.)

- TYPE D
- TYPE C
- TYPE A

TIER 2 (PARALLEL RAMPS SHOULD ONLY BE USED DUE TO RIGHT OF WAY (ROW) OR OTHER SPACE CONSTRAINTS WHERE A TIER 1 RAMP CANNOT BE USED.)

- TYPE P-6 (6' OF ROW AVAILABLE)
- TYPE P-7 (7' OF ROW AVAILABLE)
- TYPE P-5 (5' OF ROW AVAILABLE)
- TYPE P-4 (4' OF ROW AVAILABLE)

TIER 3 (TIER 3 RAMPS CAN ONLY BE USED WITH WRITTEN APPROVAL BY THE CITY ENGINEER OR DESIGNEE. TIER 3 RAMPS SHALL BE IDENTIFIED IN THE DESIGN SCOPE OR APPROVAL REQUESTED BY THE DESIGNER JUSTIFYING THAT THIS RAMP TYPE IS NECESSARY.)

- TYPE J (MODIFIED ALLEY RAMP), USE SHOULD BE LIMITED DUE TO DRAINAGE CONCERNS
- RADIAL RAMPS
- SINGLE SHARED RAMPS

SPECIALTY RAMPS (SHALL ONLY BE USED FOR THE LISTED SITUATION, OR WRITTEN APPROVAL BY THE CITY ENGINEER OR DESIGNEE.)

- TYPE G - ONLY TO BE USED ON ALLEY CROSSINGS
 - TYPE H - ONLY TO BE USED ON ALLEY CROSSINGS
 - TYPE L-1 - ONLY FOR MEDIAN CROSSINGS
 - TYPE L-2 - ONLY FOR MEDIAN CROSSINGS
 - PEDESTRIAN PADS - USED FOR ACCESS TO PUSHBUTTONS WHERE THERE IS NO EXISTING SIDEWALK. THE INTENT IS TO PROVIDE ACCESS TO CROSS THE INTERSECTION IN BOTH DIRECTIONS WITHOUT ENTERING THE STREET TO ACCESS TO OTHER CROSSING. THE FOLLOWING IS THE ORDER OF PREFERENCE ON PEDESTRIAN PADS:
 1. PP-1 TWO CONNECTED RAMPS WITH UTILITY STRIP
 2. PP-2 TWO CONNECTED RAMPS WITH SIDEWALK AGAINST CURB
 3. PP-3 USED AS SINGLE SHARED RAMP THAT CAN ACCESS BOTH CROSSWALK LEGS AND THE PUSHBUTTON
 4. PP-3 USED TO ONLY ACCESS THE LEG OF THE INTERSECTION CONTROLLED BY THE PUSHBUTTON
4. RAMP RUNNING SLOPE: THE RUNNING SLOPE SHALL BE NO GREATER THAN 7.69%.
 5. ALL JOINTS BETWEEN NEW AND EXISTING MATERIALS SHALL BE FLUSH.
 6. LANDINGS:
 - LANDINGS SHALL HAVE A MAXIMUM 1.56% SLOPE IN ALL DIRECTIONS FOR ALL CURB RAMP TYPES.
 - A PARALLEL RAMP, CONSTRAINED ON TWO (2) SIDES, E.G., TYPE P-7, SHALL HAVE A LANDING 5-FT WIDE BY 5-FT DEEP A PARALLEL RAMP, CONSTRAINED ON ONE (1) SIDE, E.G., TYPES P-4, 5, & 6, SHALL HAVE A LANDING NO LESS THAN 4-FT MINIMUM BY 5-FT. THE 5-FT DIMENSION SHALL BE PROVIDED AS SHOWN IN THESE STANDARD DRAWINGS.

<h1>CURB RAMP GENERAL NOTES</h1>	
CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC SERVICE DIVISION OF DESIGN AND CONSTRUCTION	STD DWG 2319
	3/30/2018
	SHT 2 OF 21

- ALL PERPENDICULAR RAMPS SHALL HAVE A LANDING NO LESS THAN 4-FT MINIMUM BY 4-FT. A PERPENDICULAR RAMP THAT IS CONSTRAINED AT THE BACK OF SIDEWALK SHALL HAVE A LANDING 4-FT BY 5-FT. THE 5-FT DIMENSION SHALL BE PROVIDED IN THE DIRECTION OF RAMP RUN, AS SHOWN IN THESE STANDARD DRAWINGS.
 - LANDING AT INTERSECTING SIDEWALKS - WHEREVER SIDEWALKS INTERSECT, THERE SHALL BE A LANDING.
7. STREET COUNTER SLOPE: THE COUNTER SLOPE AT THE BASE OF THE RAMP SHALL BE A MAXIMUM OF 5% FOR A MINIMUM OF 2-FT.
 8. CLEAR SPACE: AT MARKED CROSSINGS THE RAMP AND STREET CLEAR SPACE MUST BE FULLY CONTAINED WITHIN THE MARKED CROSSWALK. AT UNMARKED CROSSINGS THE RAMP AND CLEAR MUST BE WITHIN THE CURB RAMP DESIGN BOUNDARY.
 9. SURFACES: RAMP, FLARE, AND LANDING SURFACES MUST BE STABLE AND SLIP RESISTANT. RAMPS SHALL BE BROOM FINISHED, TRANSVERSE TO THE DIRECTION OF TRAVEL. GRATINGS, VALVE BOXES, AND UTILITY BOXES SHALL NOT BE LOCATED IN THE RAMP OR LANDING.
 10. DETECTABLE WARNINGS: DETECTABLE WARNINGS SHALL BE INSTALLED ACCORDING TO THESE STANDARD DRAWINGS, CMSC 608, AND DPS ADA RULES AND REGULATIONS.
 11. CURB WALLS MAY BE NECESSARY FOR CURB RAMP CONSTRUCTION WHERE SPACE RESTRICTION DO NOT ALLOW FOR GRADING WITHIN ROW AT A 3:1 SLOPE OR FLATTER. THE MAXIMUM HEIGHT OF 6" THICK, NON-REINFORCED CURB WALL IS 12" ABOVE THE SIDEWALK SURFACE. THE BURIED PORTION OF THE NON-REINFORCED CURB WALL SHALL BE EQUAL TO THE EXPOSED REVEAL. RETAINING EMBANKMENT TO A HEIGHT OF MORE THAN 12" ABOVE THE SIDEWALK WILL REQUIRE A DESIGNED RETAINING WALL OR CELLULAR WALL.
 12. RAMPS MUST BE CONSTRUCTED TO ALLOW FOR POSITIVE DRAINAGE. THE RAMP ITSELF SHALL NOT HOLD EXCESS WATER AND THE ADJACENT PAVEMENT SHALL NOT BE ALTERED TO INHIBIT FLOW OF WATER. IF AN EXISTING CONSTRAINT PREVENTS BUILDING THE RAMP AND ADJACENT AREA WITH POSITIVE DRAINAGE IT MUST BE BROUGHT TO THE CITY'S ATTENTION PRIOR TO CONSTRUCTION AND FINAL DESIGN APPROVED BY THE CITY.

CURB RAMP GENERAL NOTES



CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG

2319

3/30/2018

SHT 3 OF 21

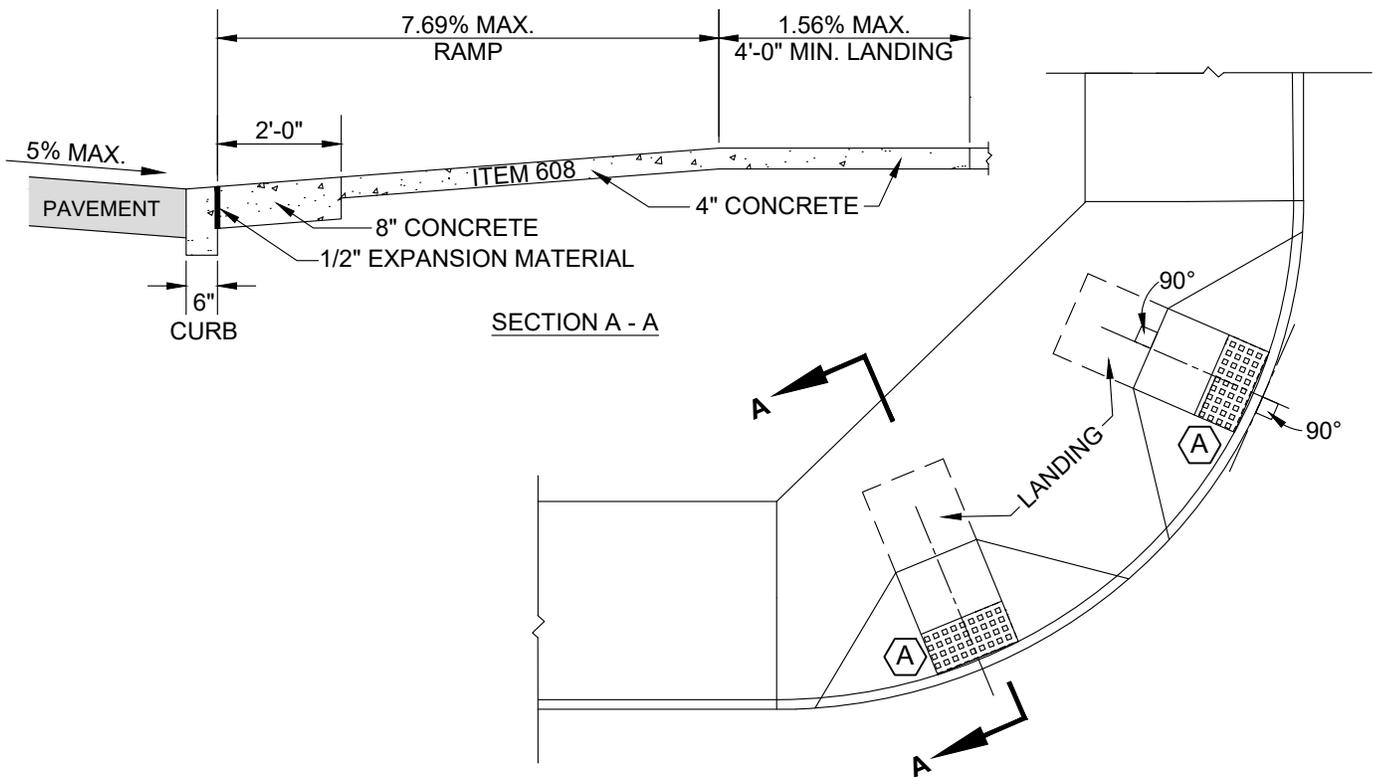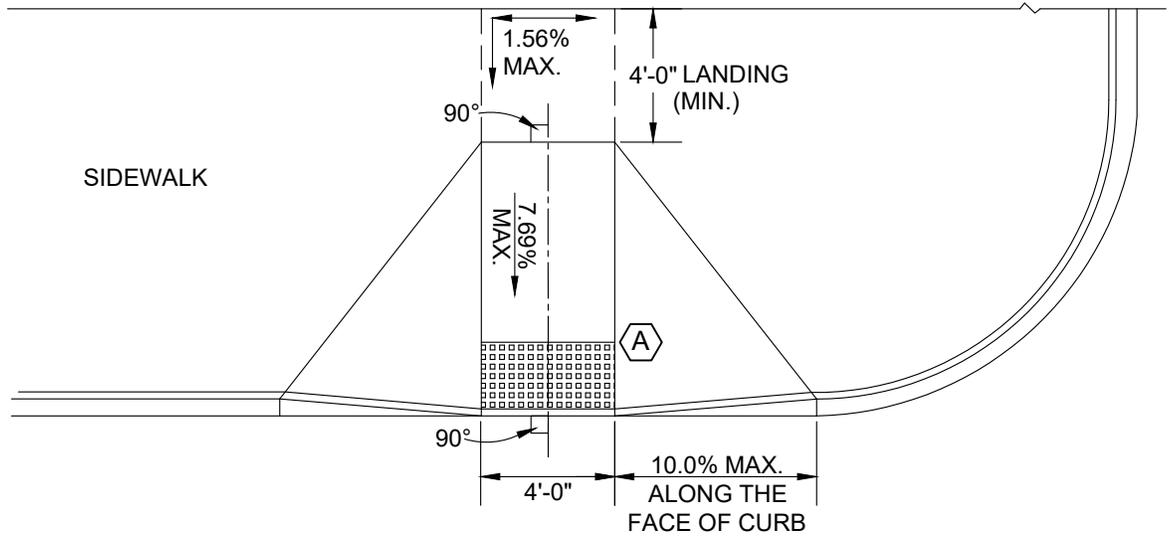

CODED NOTES:

(A) SEE SHEET 21 FOR DETECTABLE WARNING DETAILS

GENERAL NOTES:

1. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.



CURB RAMP TYPE A

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG
2319

3/30/2018

SHT 4 OF 21

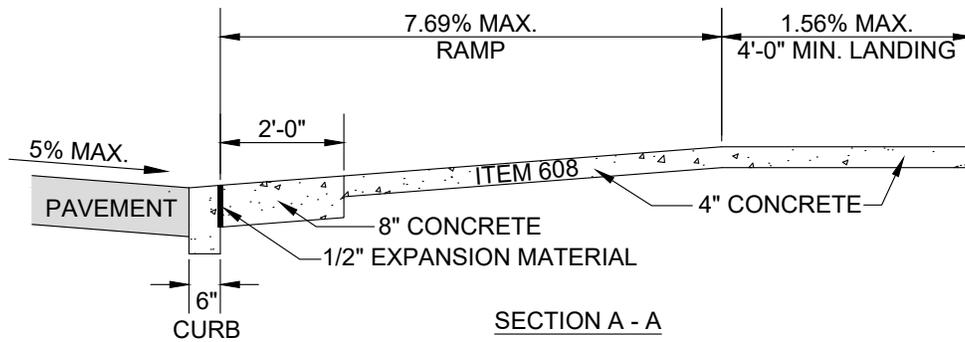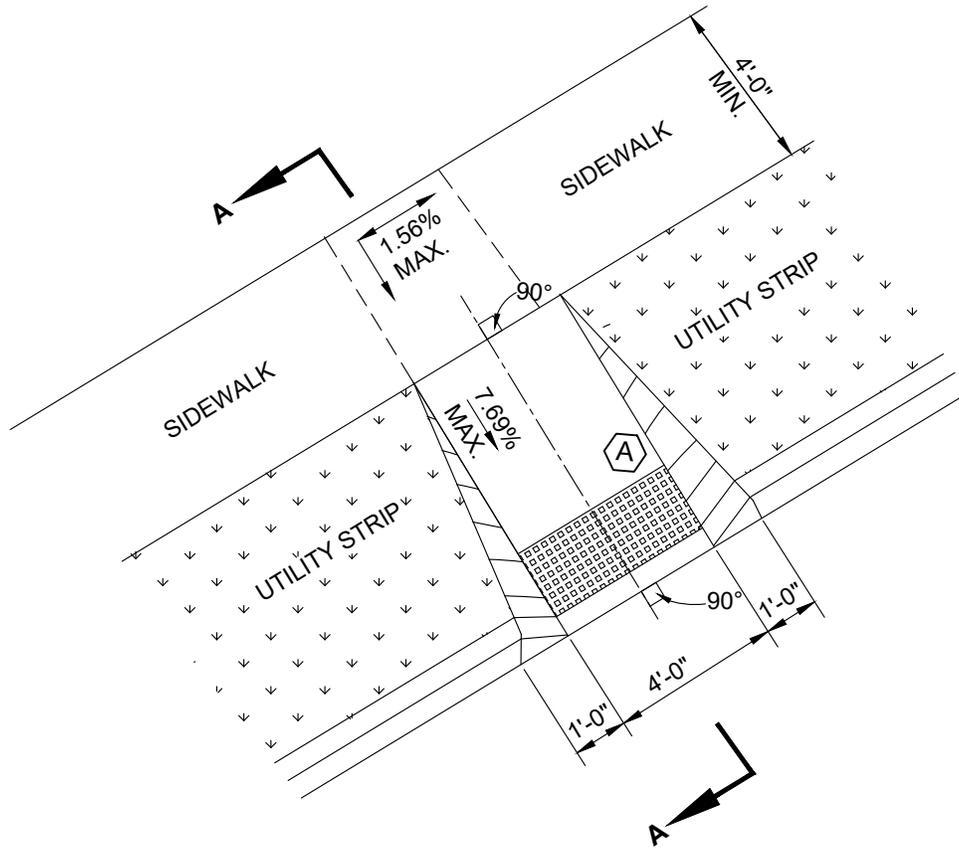

CODED NOTES:

(A) SEE SHEET 21 FOR DETECTABLE WARNING DETAILS

GENERAL NOTES:

1. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.

CURB RAMP TYPE C



CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG

2319

3/30/2018

SHT 5 OF 21

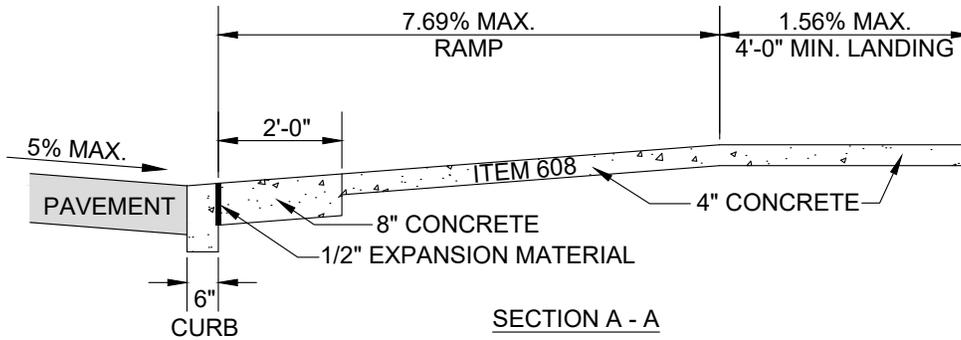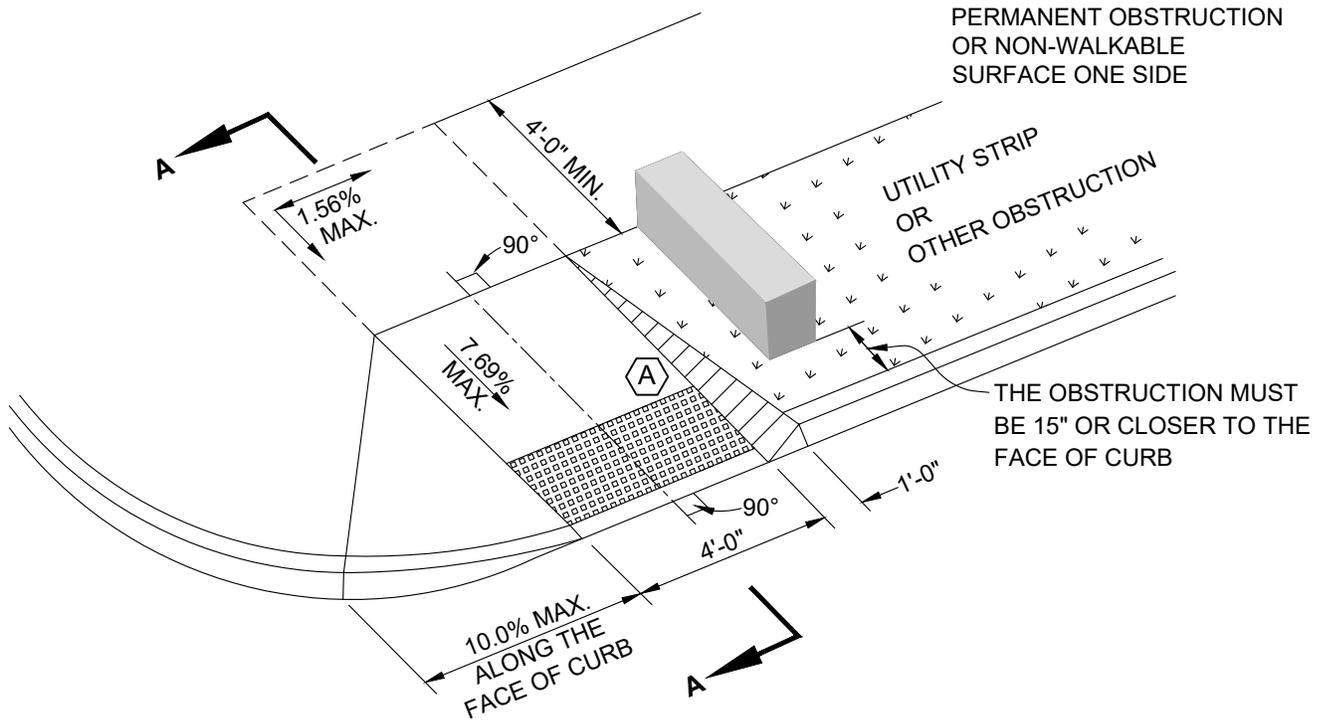

CODED NOTES:

(A) SEE SHEET 21 FOR DETECTABLE WARNING DETAILS

GENERAL NOTES:

1. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.

CURB RAMP TYPE D



CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG

2319

3/30/2018

SHT 6 OF 21

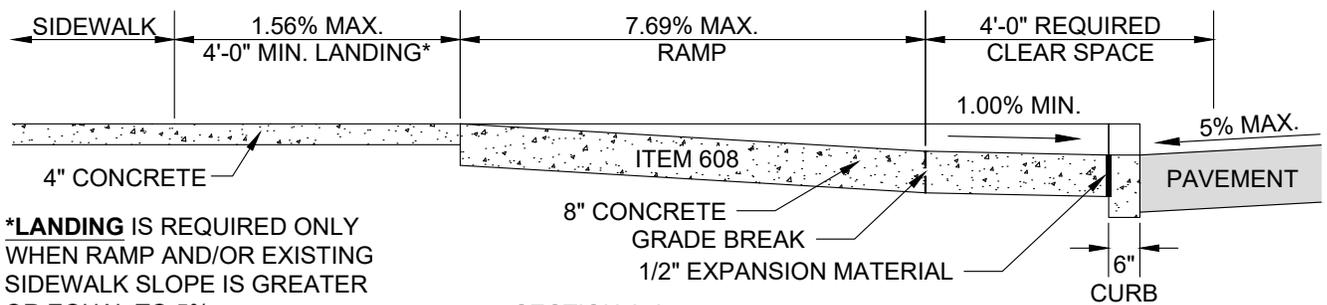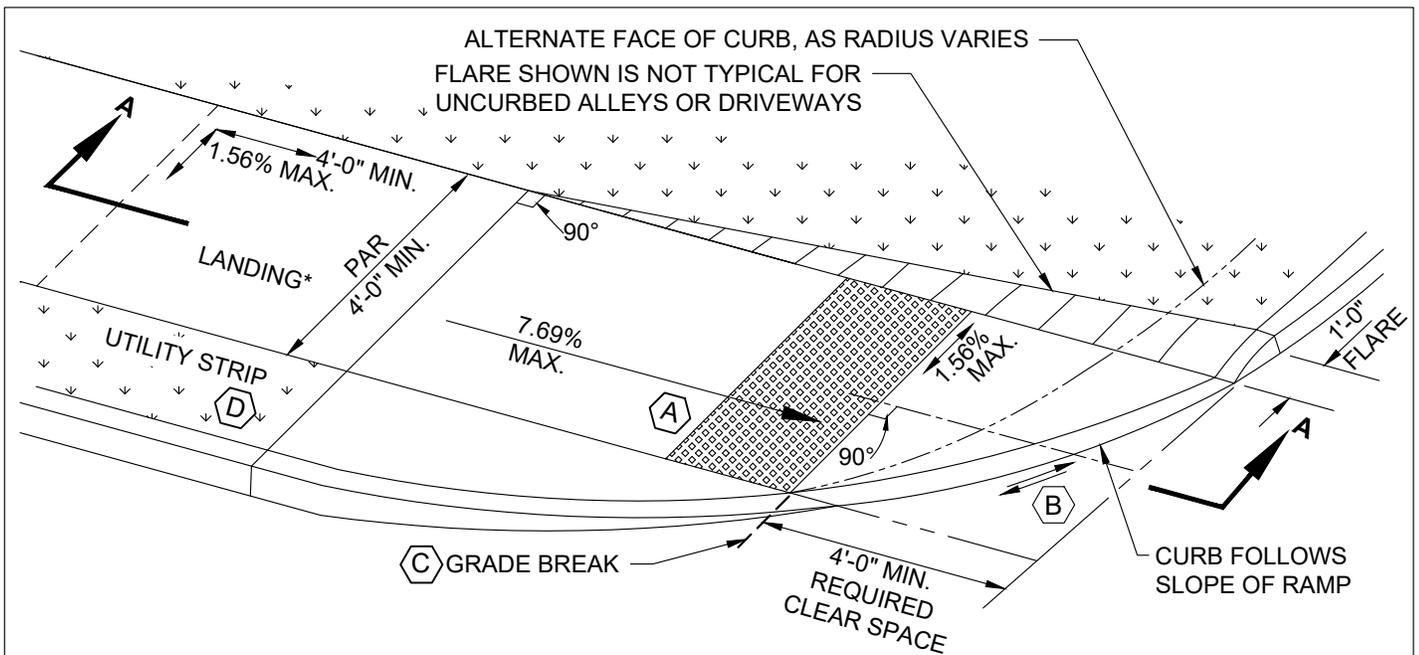

*LANDING IS REQUIRED ONLY WHEN RAMP AND/OR EXISTING SIDEWALK SLOPE IS GREATER OR EQUAL TO 5%

SECTION A-A

CODING NOTES:

- (A) SEE SHEET 21 FOR DETECTABLE WARNING DETAILS
- (B) PROVIDE POSITIVE DRAINAGE ALONG CURBLINE, SHOULD BE 1.00% MINIMUM SLOPE
- (C) WHERE THE DISTANCE FROM EITHER END OF THE BOTTOM OF THE GRADE BREAK TO THE BACK OF CURB IS GREATER THAN 5-FT, THE DETECTABLE WARNING SHALL BE PLACED AT THE BACK OF CURB
- (D) FOR THE LENGTH OF THE RAMP, THE UTILITY STRIP MAY BE REMOVED AND REPLACED WITH 8" CONCRETE (ITEM 608), PROVIDED THE UTILITY STRIP IS NO WIDER THAN 2-FT

GENERAL NOTES:

1. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.
2. THE EDGE OF THE CURB WITHIN THE CLEAR SPACE SHALL BE FLUSH WITH THE EDGE OF THE ADJACENT PAVEMENT AND GUTTER.



CURB RAMP TYPE H

CITY OF COLUMBUS, OHIO
 DEPARTMENT OF PUBLIC SERVICE
 DIVISION OF DESIGN AND CONSTRUCTION

STD DWG
2319

3/30/2018

SHT 8 OF 21

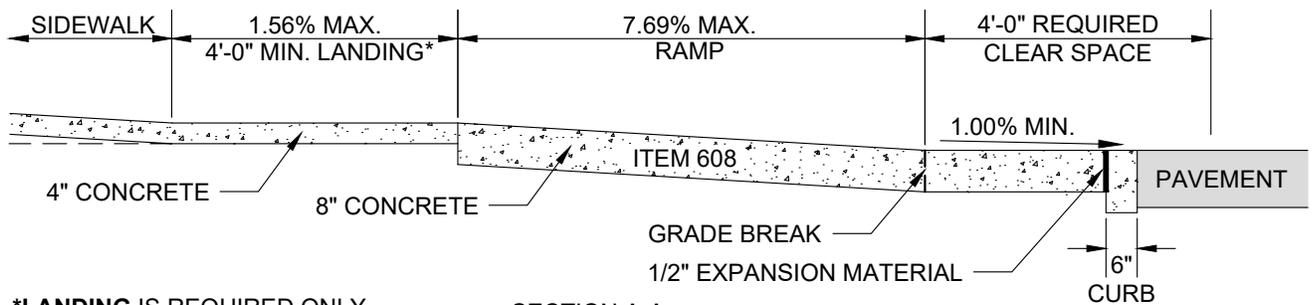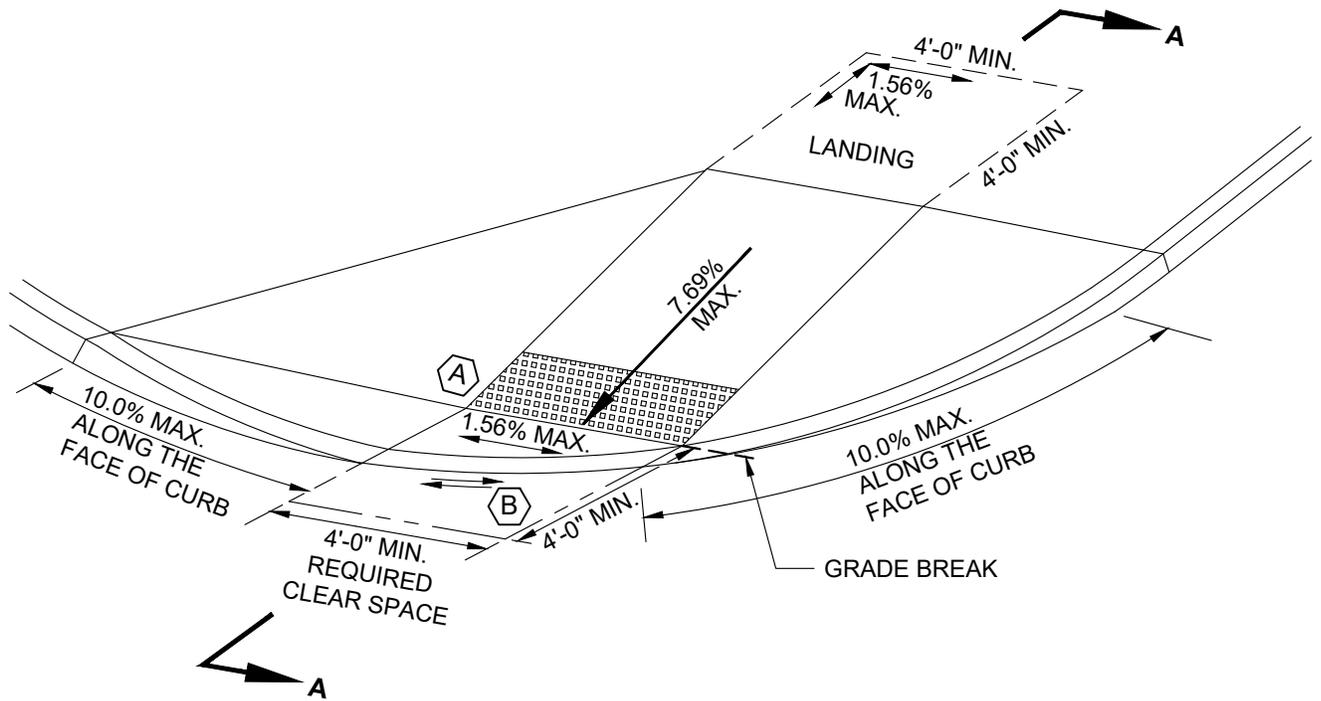

***LANDING** IS REQUIRED ONLY WHEN RAMP AND/OR EXISTING SIDEWALK SLOPE IS GREATER OR EQUAL TO 5%

SECTION A-A

CODED NOTES:

- (A) SEE SHEET 21 FOR DETECTABLE WARNING DETAILS
- (B) PROVIDE POSITIVE DRAINAGE ALONG CURBLINE, SHOULD BE 1.00% MINIMUM SLOPE

GENERAL NOTES:

1. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.
2. THE EDGE OF THE CURB WITHIN THE CLEAR SPACE SHALL BE FLUSH WITH THE EDGE OF THE ADJACENT PAVEMENT AND GUTTER.


CURB RAMP TYPE J

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG
2319


3/30/2018

SHT 9 OF 21

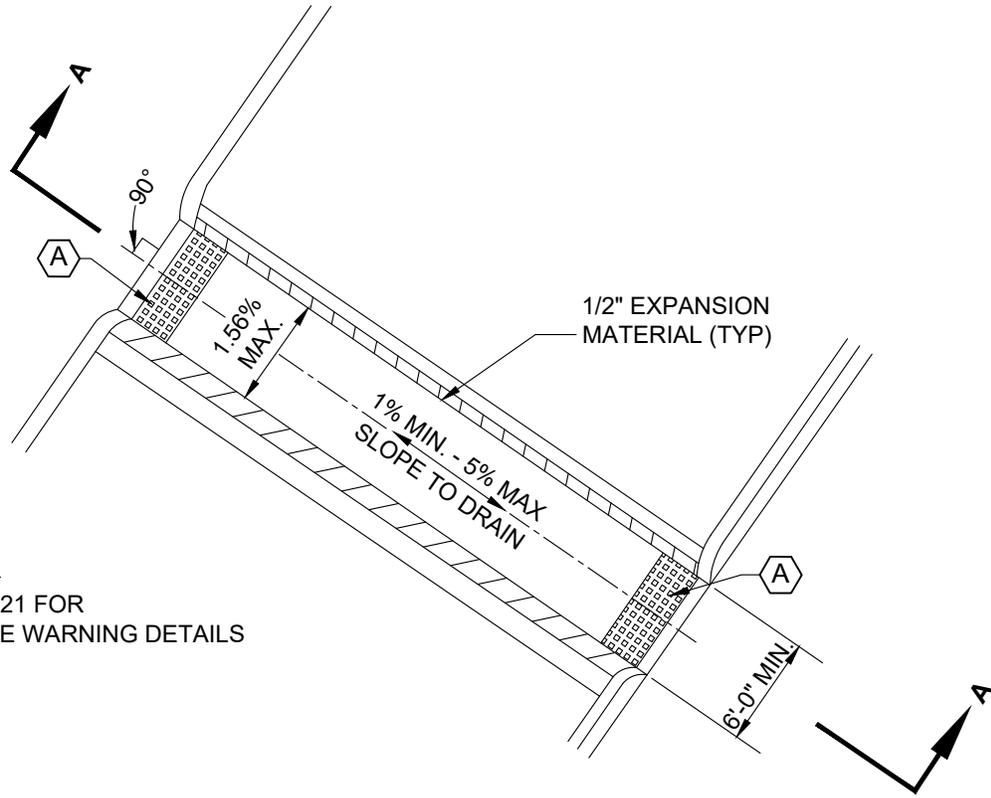

CODED NOTES:


A SEE SHEET 21 FOR
DETECTABLE WARNING DETAILS

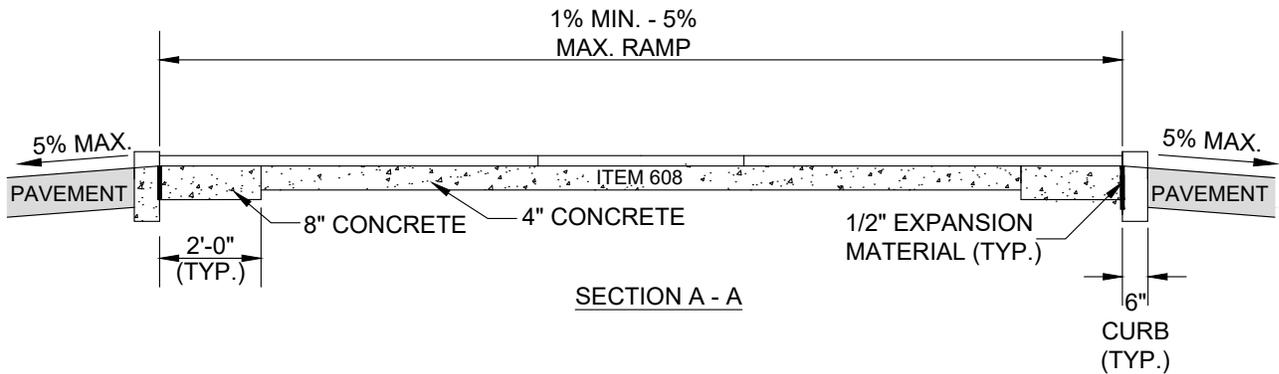

GENERAL NOTES:


1. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.
2. RAMP L-1 SHALL BE USED IN ALL CIRCUMSTANCES WHERE NOT PROHIBITED BY DRAINAGE ISSUES. AN L-1 RAMP SHOULD NOT BE PLACED IN A WAY THAT WOULD CONVEY THE CURB FLOW OF WATER THROUGH THE MEDIAN PASSTHROUGH. WHERE THE ROADWAY CROSS-SLOPE DIRECTS WATER TOWARDS THE MEDIAN AND FLOWS THROUGH THE GUTTER LINE ADJACENT TO THE PASSTHROUGH, USE AN L-2 RAMP.
3. MEDIANS / ISLANDS WITHIN COMMERCIAL DRIVES REQUIRE DETECTABLE WARNINGS ONLY WHEN OPPOSING CURB RAMPS REQUIRE DETECTABLE WARNINGS. (SEE SHEET 21 OF 21, NOTE 1)

<h1 style="margin: 0;">CURB RAMP TYPE L-1</h1>	
CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC SERVICE DIVISION OF DESIGN AND CONSTRUCTION	STD DWG 2319
	3/30/2018
	SHT 10 OF 21

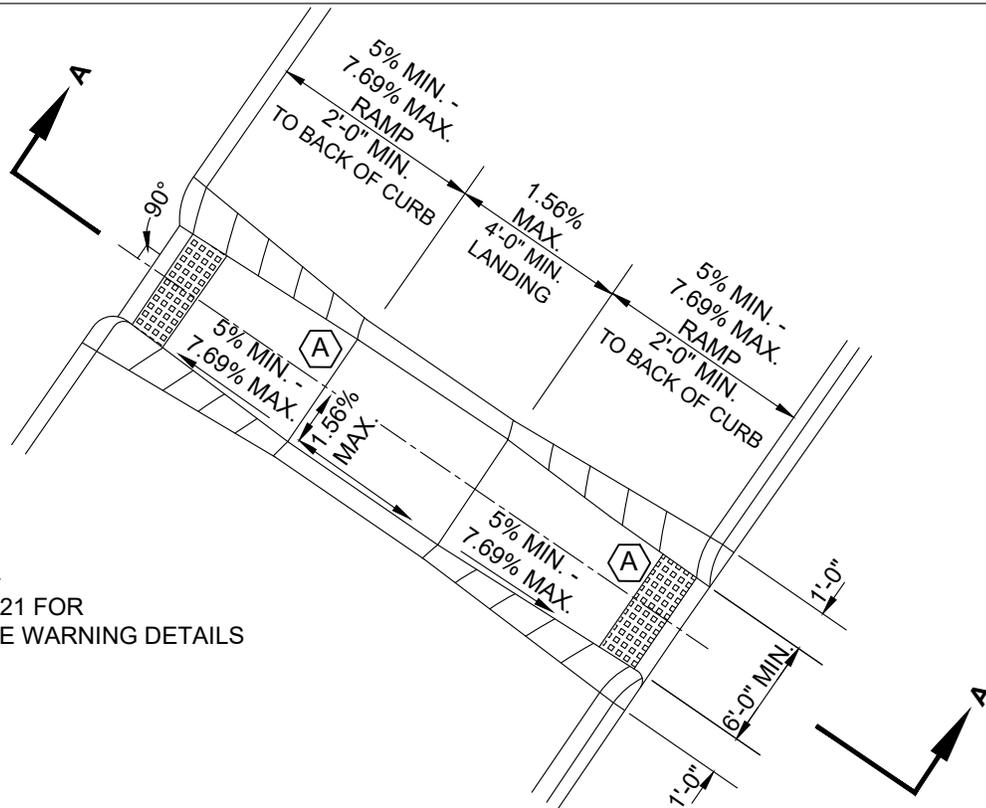

CODED NOTES:

A SEE SHEET 21 FOR
DETECTABLE WARNING DETAILS

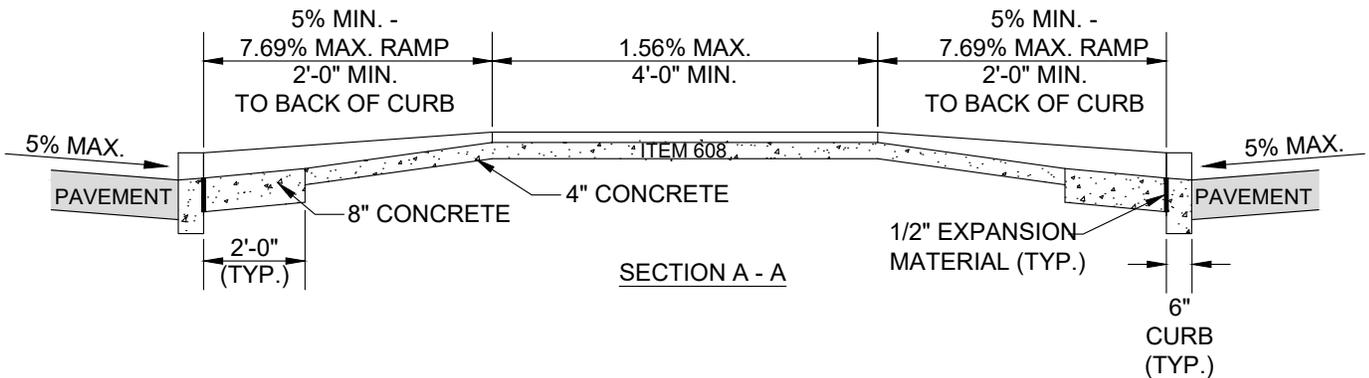

GENERAL NOTES:

1. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.
2. MEDIANS / ISLANDS WITHIN COMMERCIAL DRIVES REQUIRE DETECTABLE WARNINGS ONLY WHEN OPPOSING CURB RAMPS REQUIRE DETECTABLE WARNINGS. (SEE SHEET 21 OF 21, NOTE 1).
3. TYPE L-2 RAMPS ARE ONLY TO BE INSTALLED WHEN IT IS NOT POSSIBLE TO INSTALL A TYPE L-1 RAMP DUE TO DRAINAGE ISSUES.
4. TYPE L-2 RAMPS CAN ONLY BE USED ON MEDIANS 8 FEET WIDE OR MORE.

CURB RAMP TYPE L-2



CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG

2319

3/30/2018

SHT 11 OF 21

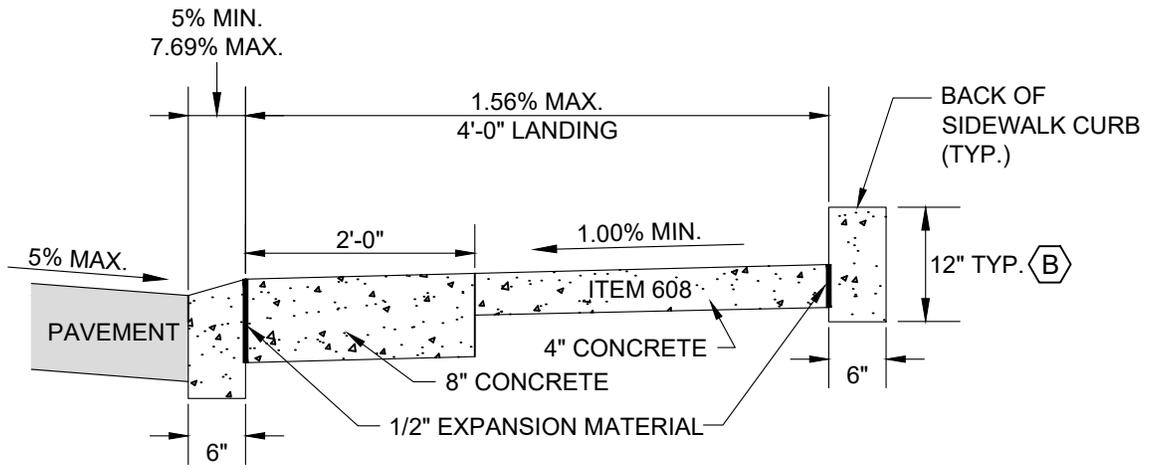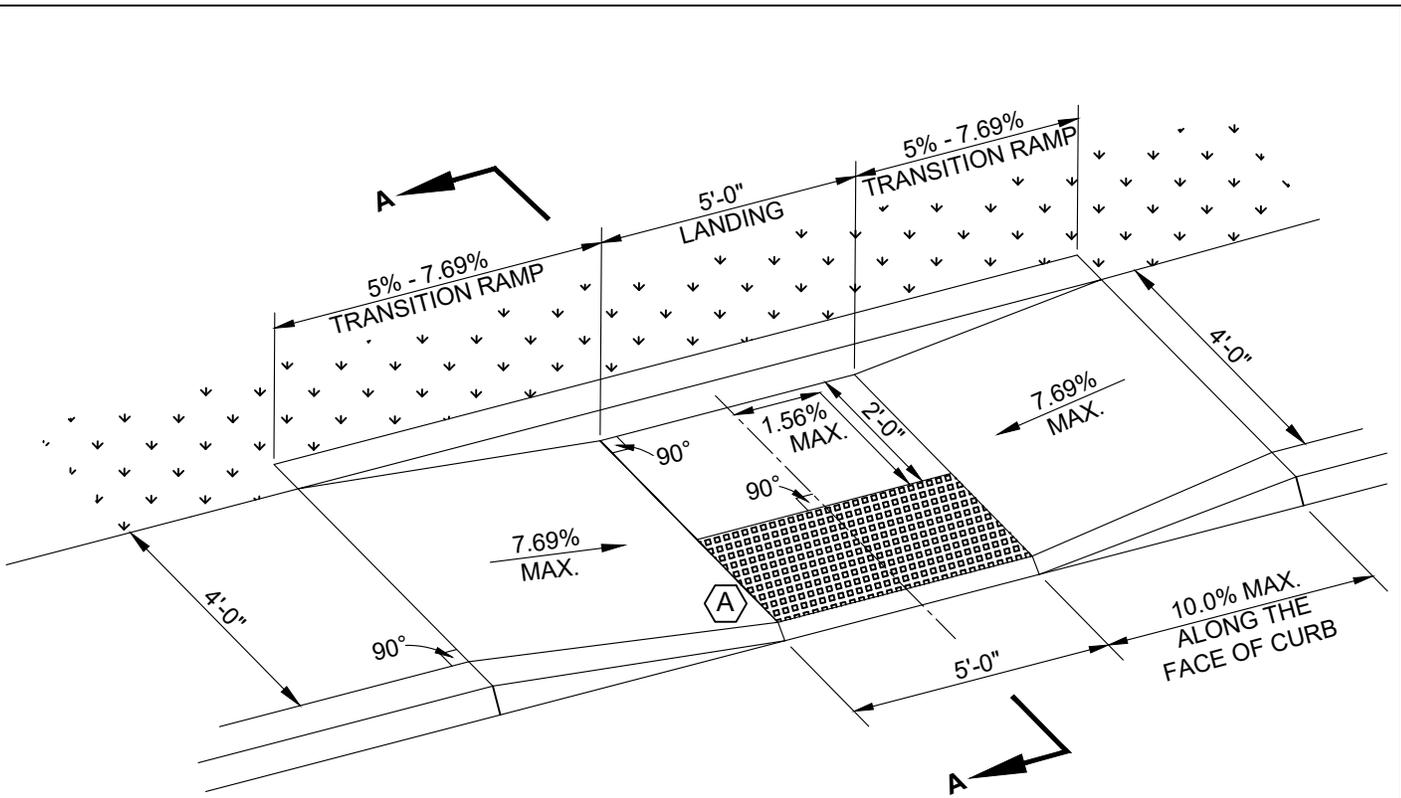

SECTION A-A



CODED NOTES:

- (A) SEE SHEET 21 FOR DETECTABLE WARNING DETAILS
- (B) EXPOSED REVEAL MUST EQUAL BURIED DEPTH; 12" MAXIMUM REVEAL; FOR ADDITIONAL DETAILS SEE CURB WALL SPECIFICATION

GENERAL NOTES:

1. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.

<h2 style="margin: 0;">CURB RAMP TYPE P-4</h2>	
CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC SERVICE DIVISION OF DESIGN AND CONSTRUCTION	STD DWG 2319 3/30/2018 SHT 12 OF 21

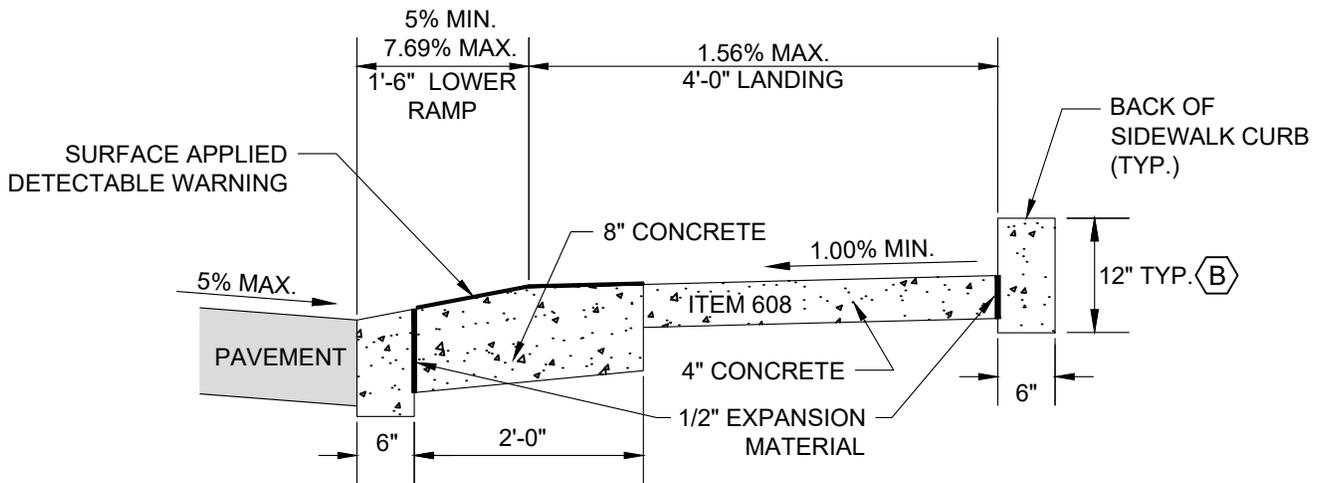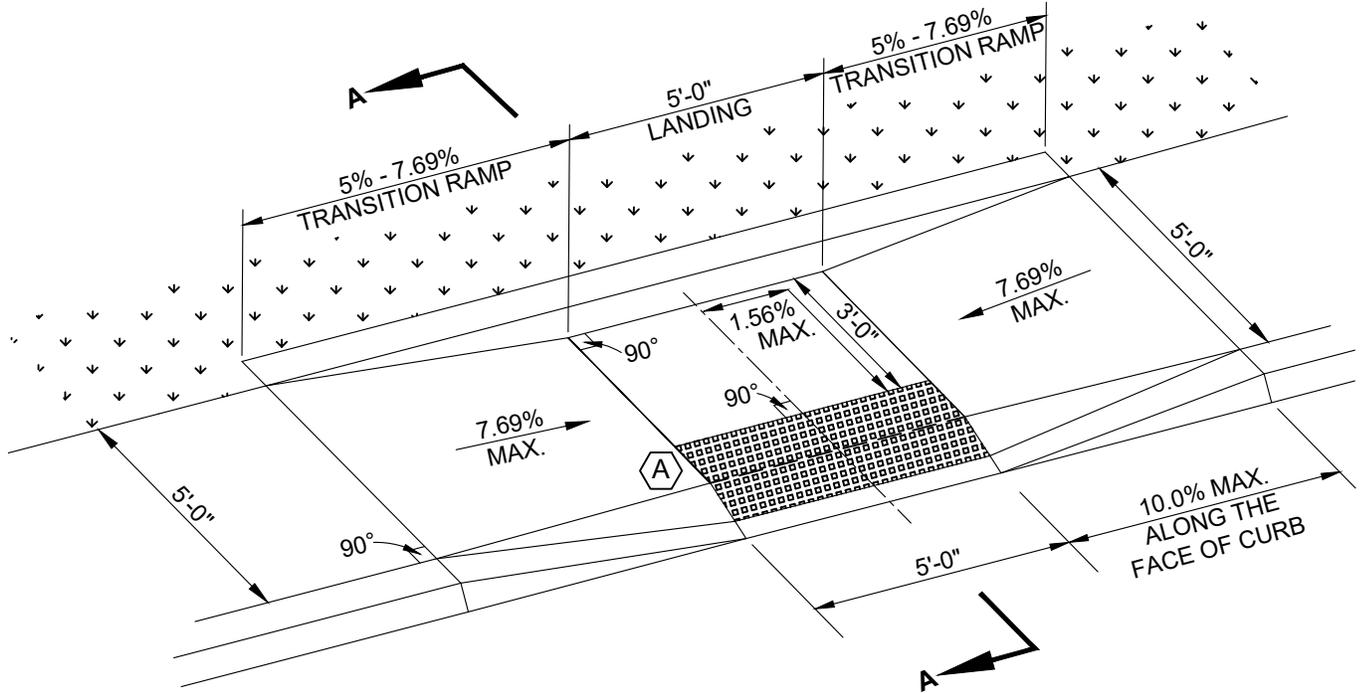

SECTION A-A



CODED NOTES:

- (A) SEE SHEET 21 FOR DETECTABLE WARNING DETAILS
- (B) EXPOSED REVEAL MUST EQUAL BURIED DEPTH; 12" MAXIMUM REVEAL; FOR ADDITIONAL DETAILS SEE CURB WALL SPECIFICATION

GENERAL NOTES:

1. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.

<h2 style="margin: 0;">CURB RAMP TYPE P-5</h2>	
CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC SERVICE DIVISION OF DESIGN AND CONSTRUCTION	STD DWG <h1 style="margin: 0;">2319</h1>
3/30/2018	
SHT 13 OF 21	

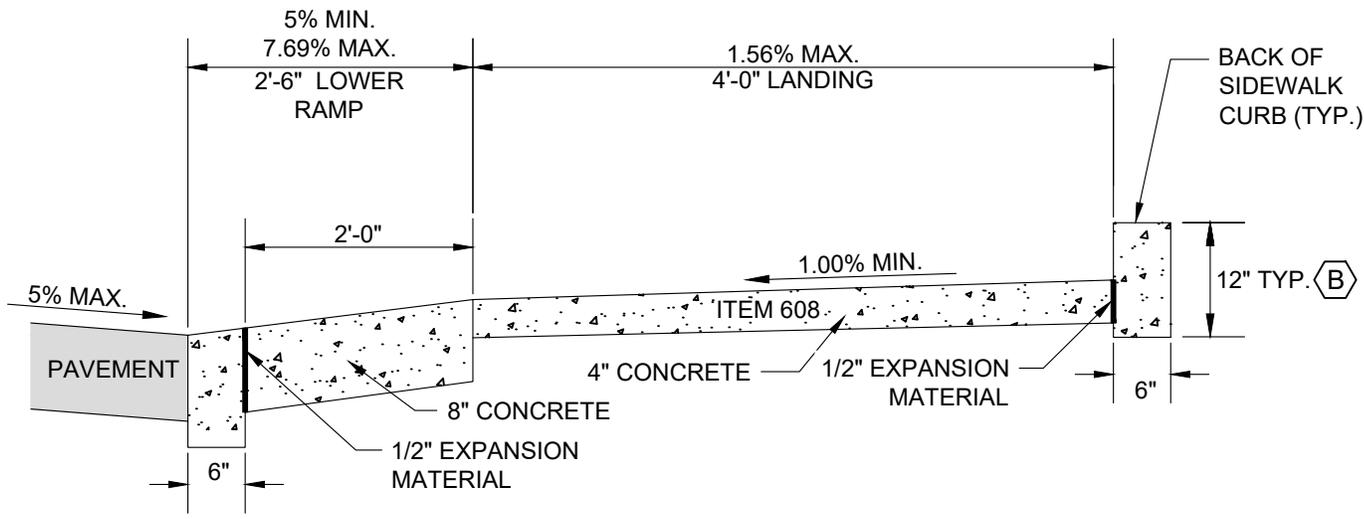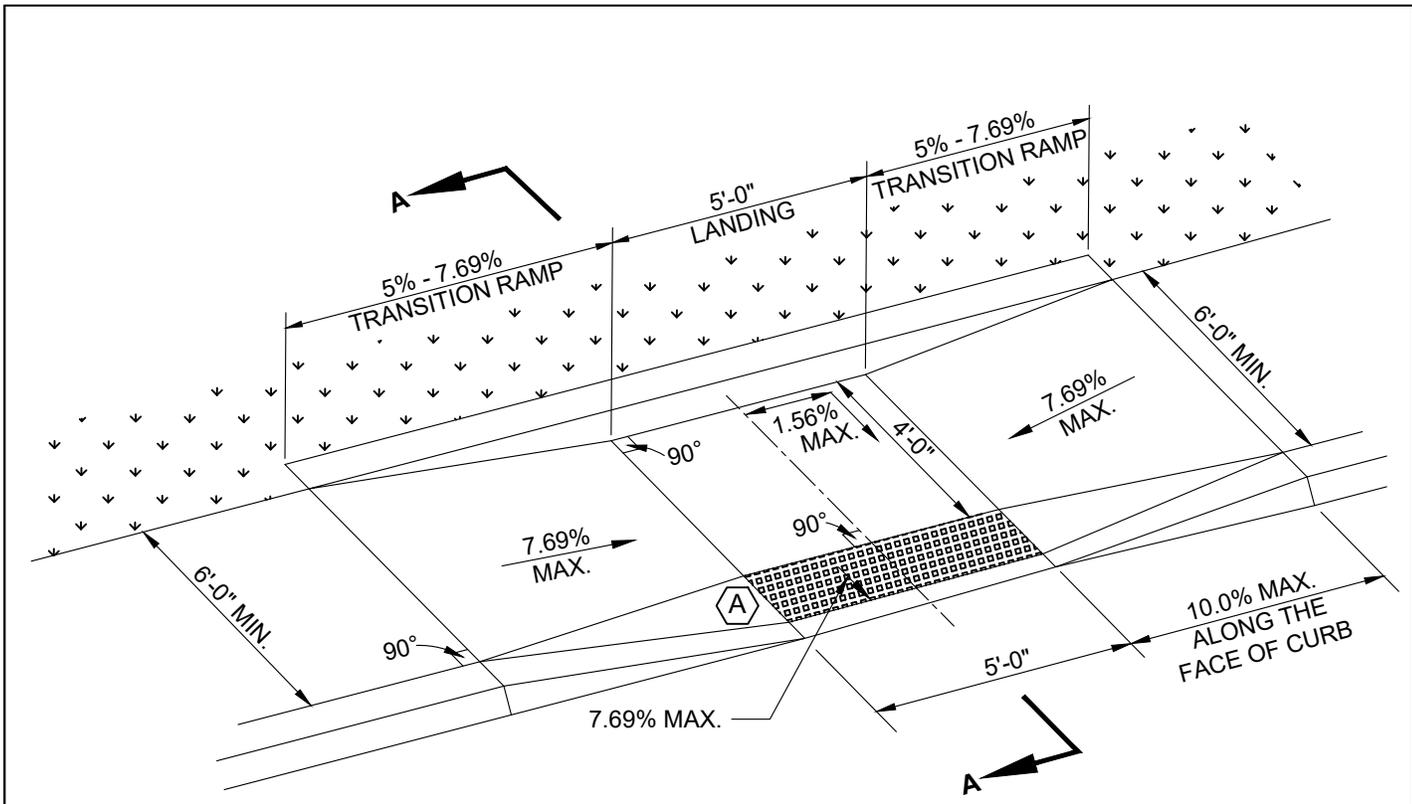

SECTION A-A



CODED NOTES:

- (A) SEE SHEET 21 FOR DETECTABLE WARNING DETAILS
- (B) EXPOSED REVEAL MUST EQUAL BURIED DEPTH; 12" MAXIMUM REVEAL; FOR ADDITIONAL DETAILS SEE CURB WALL SPECIFICATION

GENERAL NOTES:

1. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.

<h2 style="margin: 0;">CURB RAMP TYPE P-6</h2>	
CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC SERVICE DIVISION OF DESIGN AND CONSTRUCTION	STD DWG 2319 3/30/2018 SHT 14 OF 21

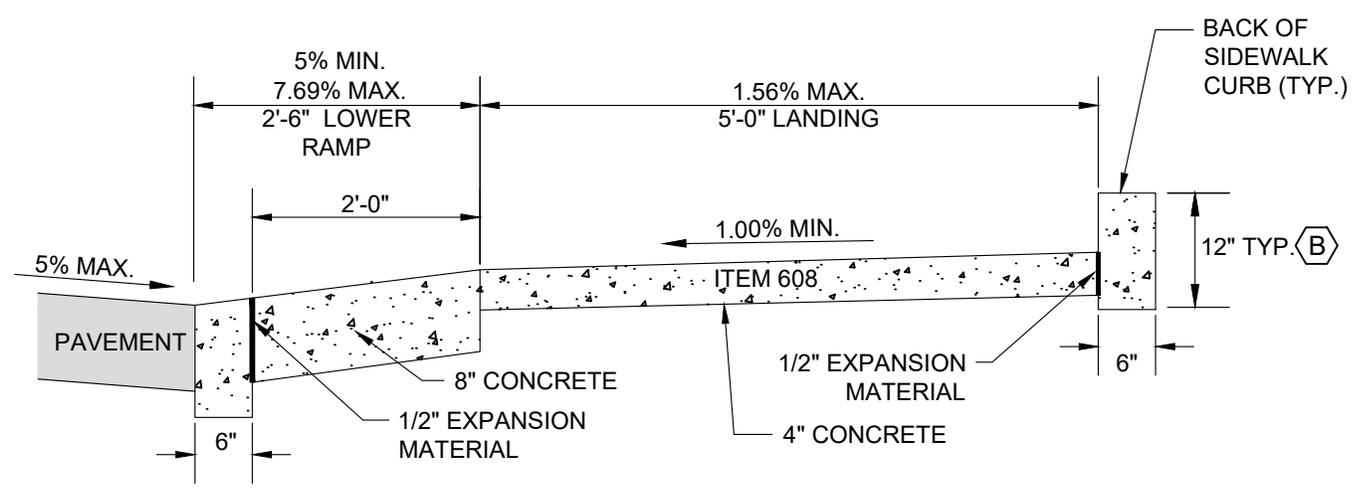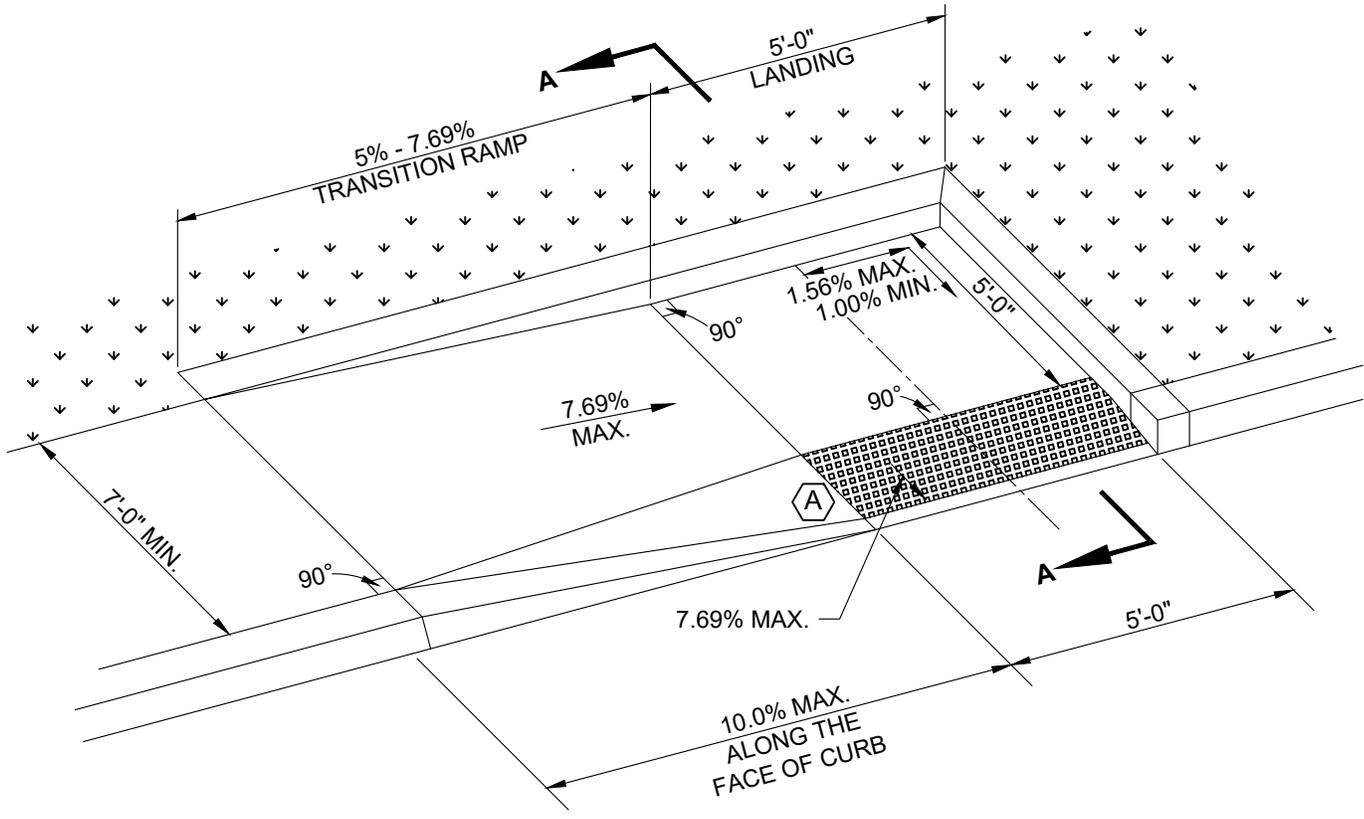

SECTION A-A

CODED NOTES:


- (A) SEE SHEET 21 FOR DETECTABLE WARNING DETAILS
- (B) EXPOSED REVEAL MUST EQUAL BURIED DEPTH; 12" MAXIMUM REVEAL; FOR ADDITIONAL DETAILS SEE CURB WALL SPECIFICATION

GENERAL NOTES:

1. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.

<h2 style="margin: 0;">CURB RAMP TYPE P-7</h2>	
CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC SERVICE TRANSPORTATION DIVISION	STD DWG 2319 3/30/2018 SHT 15 OF 21

PEDESTRIAN PAD (PP) TYPE 1 CONDITION-CONNECTED SEPARATED FROM CURB

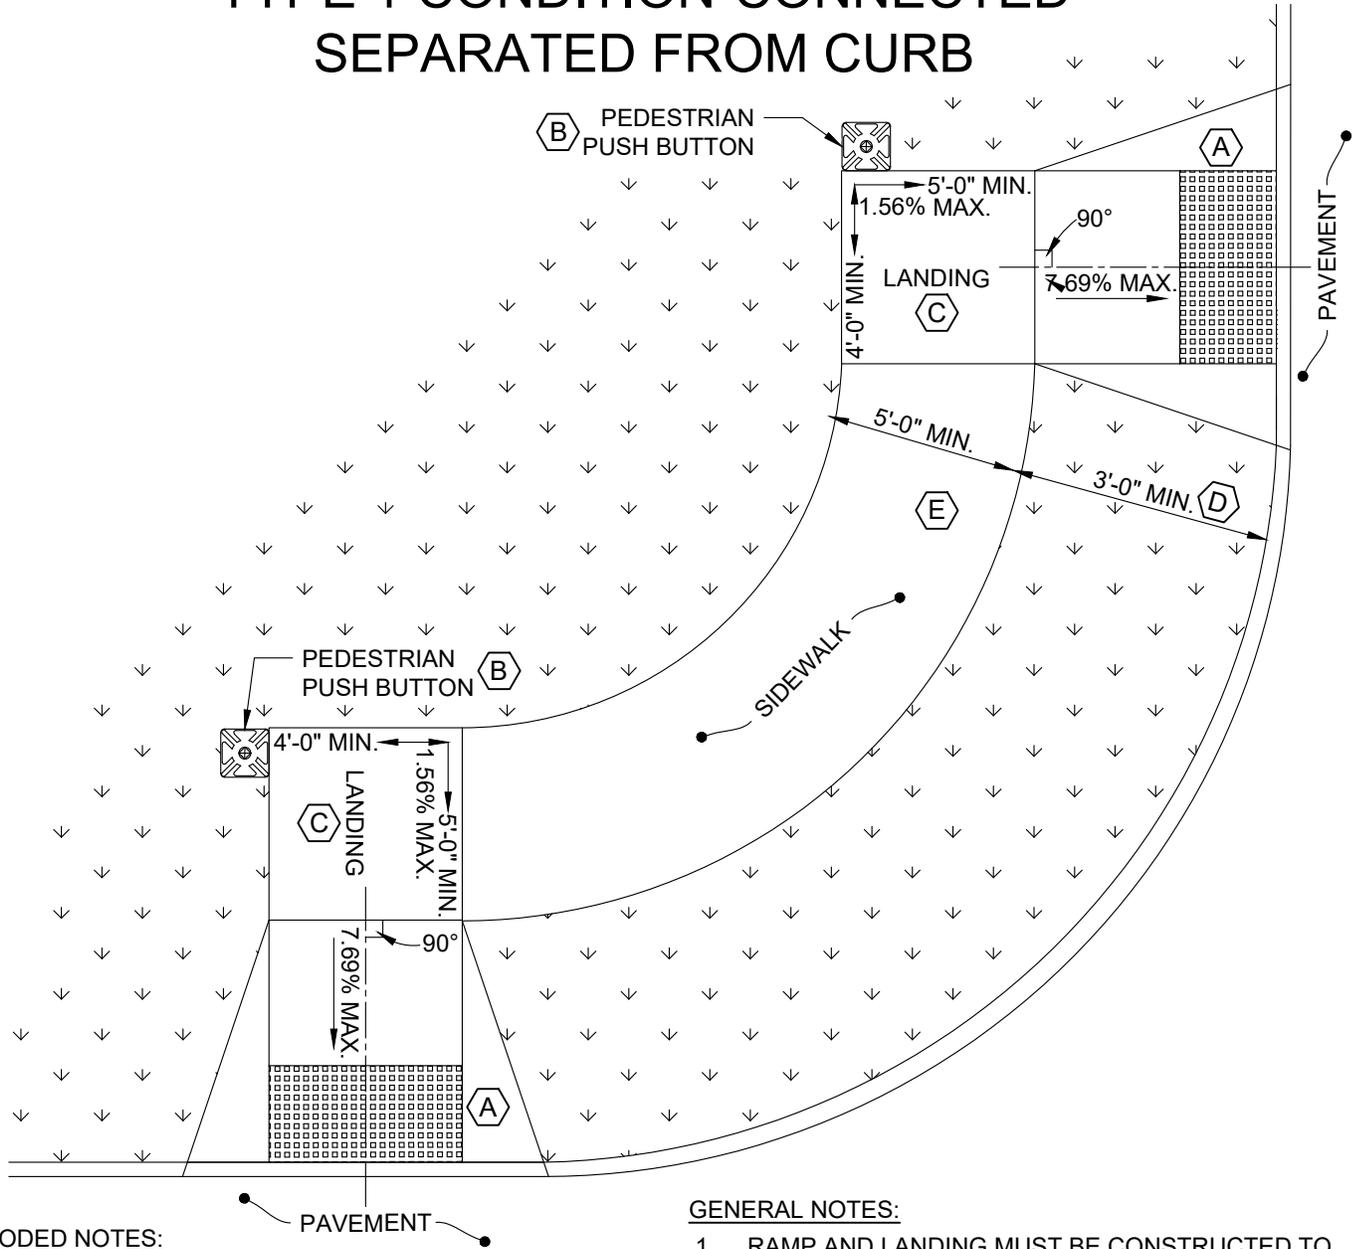

CODING NOTES:

- (A)** USE 1-FT FLARES ON CURBED ROADWAY. ON UNCURBED ROADWAY RAMP SHALL BE CONSTRUCTED WITHOUT FLARES, SEE STANDARD DRAWING FOR DETECTABLE WARNING PLACEMENT DETAILS. THE FRONT TWO FEET OF THE RAMP AND FLARES SHALL BE CONSTRUCTED USING CONCRETE 8" THICK AND TRANSITIONING TO 4" CONCRETE FURTHER THAN 2 FEET FROM THE BACK OF THE CURB
- (B)** ORIENTATION/LOCATION OF PUSH BUTTON/PEDESTAL TO BE PER POLICY
- (C)** LANDING SHALL BE 5-FT BY 5-FT WHEN SURROUNDED BY CURB WALL, AND THE PEDESTRIAN PUSH BUTTON SHALL BE INTEGRAL WITH THE CURB WALL
- (D)** IF UTILITY STRIP IS LESS THAN 3-FT, SIDEWALK SHALL BE CONSTRUCTED ADJACENT TO CURB, SEE PP-2
- (E)** SIDEWALK WIDTH AND LANDING DEPTH MAY BE REDUCED TO 4' DUE TO CONSTRAINTS.

GENERAL NOTES:

1. RAMP AND LANDING MUST BE CONSTRUCTED TO DRAIN, TYPICALLY TOWARDS THE ROADWAY, BUT MAY VARY BASED ON EXISTING TOPOGRAPHY. WEEP HOLES ARE NOT PERMITTED FOR DRAINAGE.
2. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.

CURB RAMP TYPE PP-1

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG
2319


3/30/2018

SHT 16 OF 21

PEDESTRIAN PAD (PP) TYPE 2 CONDITION-CONNECTED ADJACENT TO CURB

GENERAL NOTES:

1. RAMP AND LANDING MUST BE CONSTRUCTED TO DRAIN, TYPICALLY TOWARDS THE ROADWAY, BUT MAY VARY BASED ON EXISTING TOPOGRAPHY. WEEP HOLES ARE NOT PERMITTED FOR DRAINAGE.
2. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.

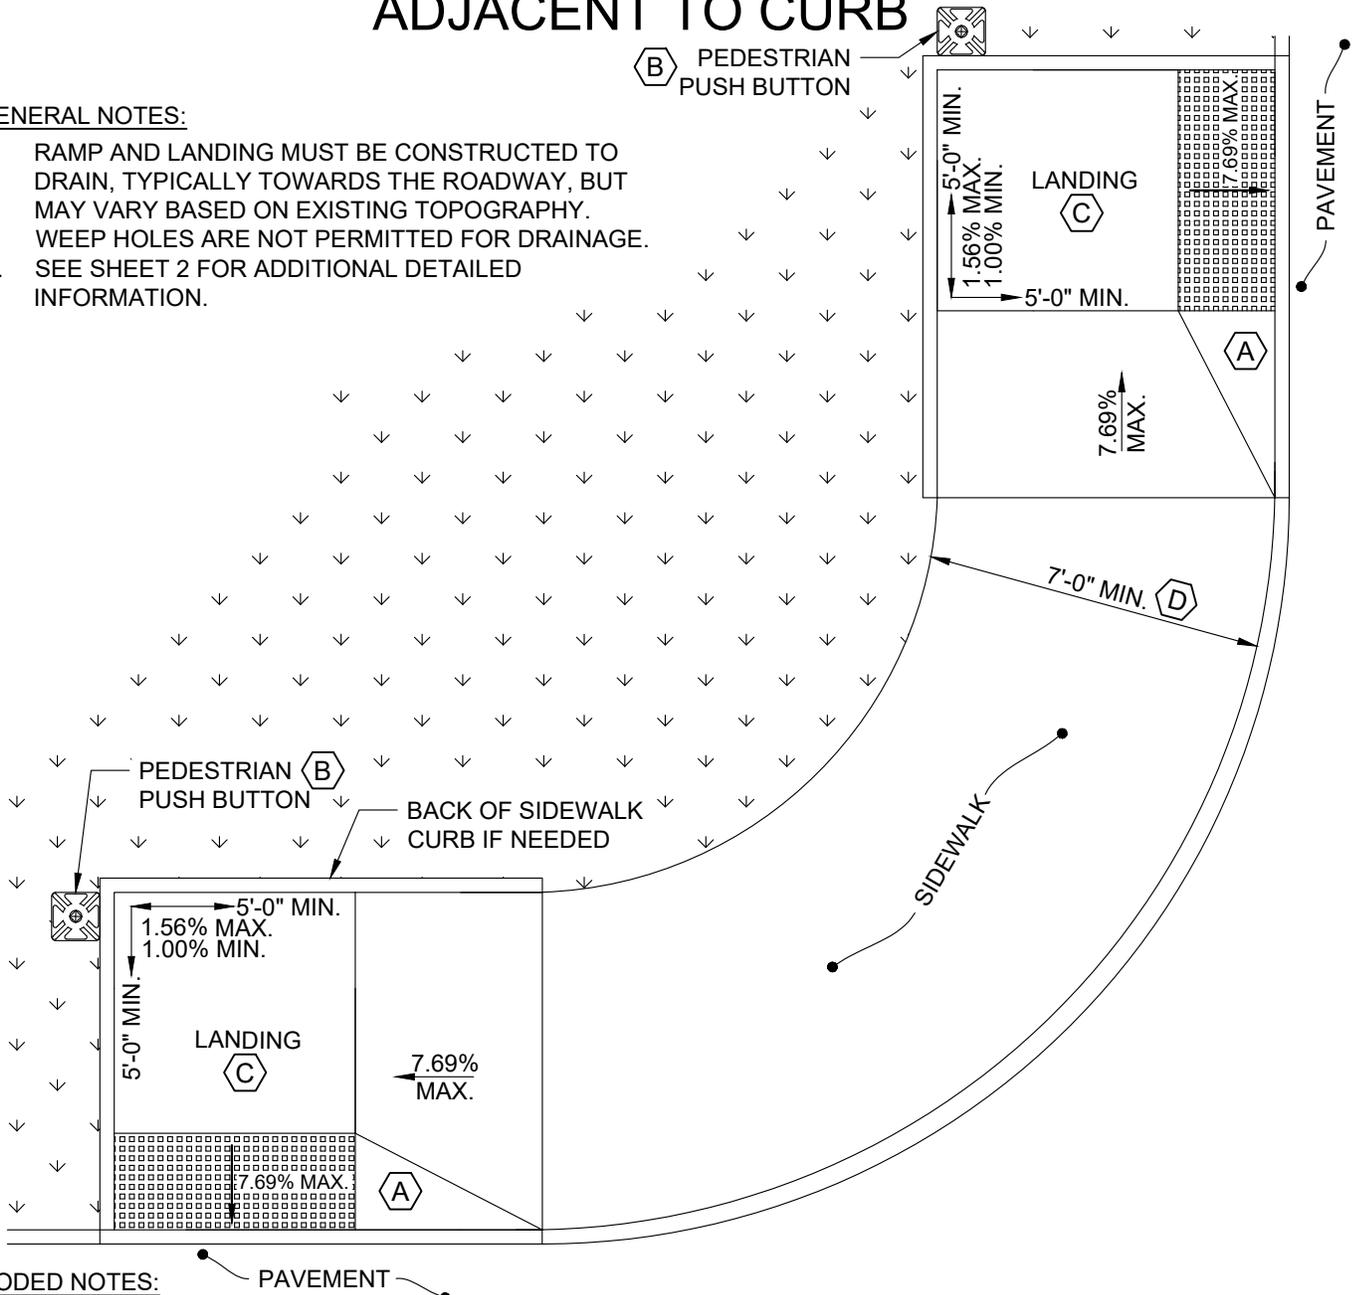


CODED NOTES:

- (A) SEE SHEET 21 FOR DETECTABLE WARNING DETAILS. THE FRONT TWO FEET OF THE RAMP AND FLARES SHALL BE CONSTRUCTED USING CONCRETE 8" THICK AND TRANSITIONING TO 4" CONCRETE FURTHER THAN 2 FEET FROM THE BACK OF THE CURB
- (B) ORIENTATION/LOCATION OF PUSH BUTTON/PEDESTAL TO BE PER POLICY
- (C) WIDTH OF THE RAMP AND LANDING MAY BE REDUCED TO 4-FT WHERE NO CURB WALL IS PRESENT
- (D) SIDEWALK WIDTH MAY BE REDUCED TO 5-FT MIN. WHEN CONSTRAINED. SEE RAMP TYPE P-4, SECTION A-A FOR RAMP AND LANDING

CURB RAMP TYPE PP-2	
CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC SERVICE DIVISION OF DESIGN AND CONSTRUCTION	STD DWG 2319
	3/30/2018
	SHT 17 OF 21

PEDESTRIAN PAD (PP) TYPE 3 CONDITION-SHARED CURB IS PRESENT

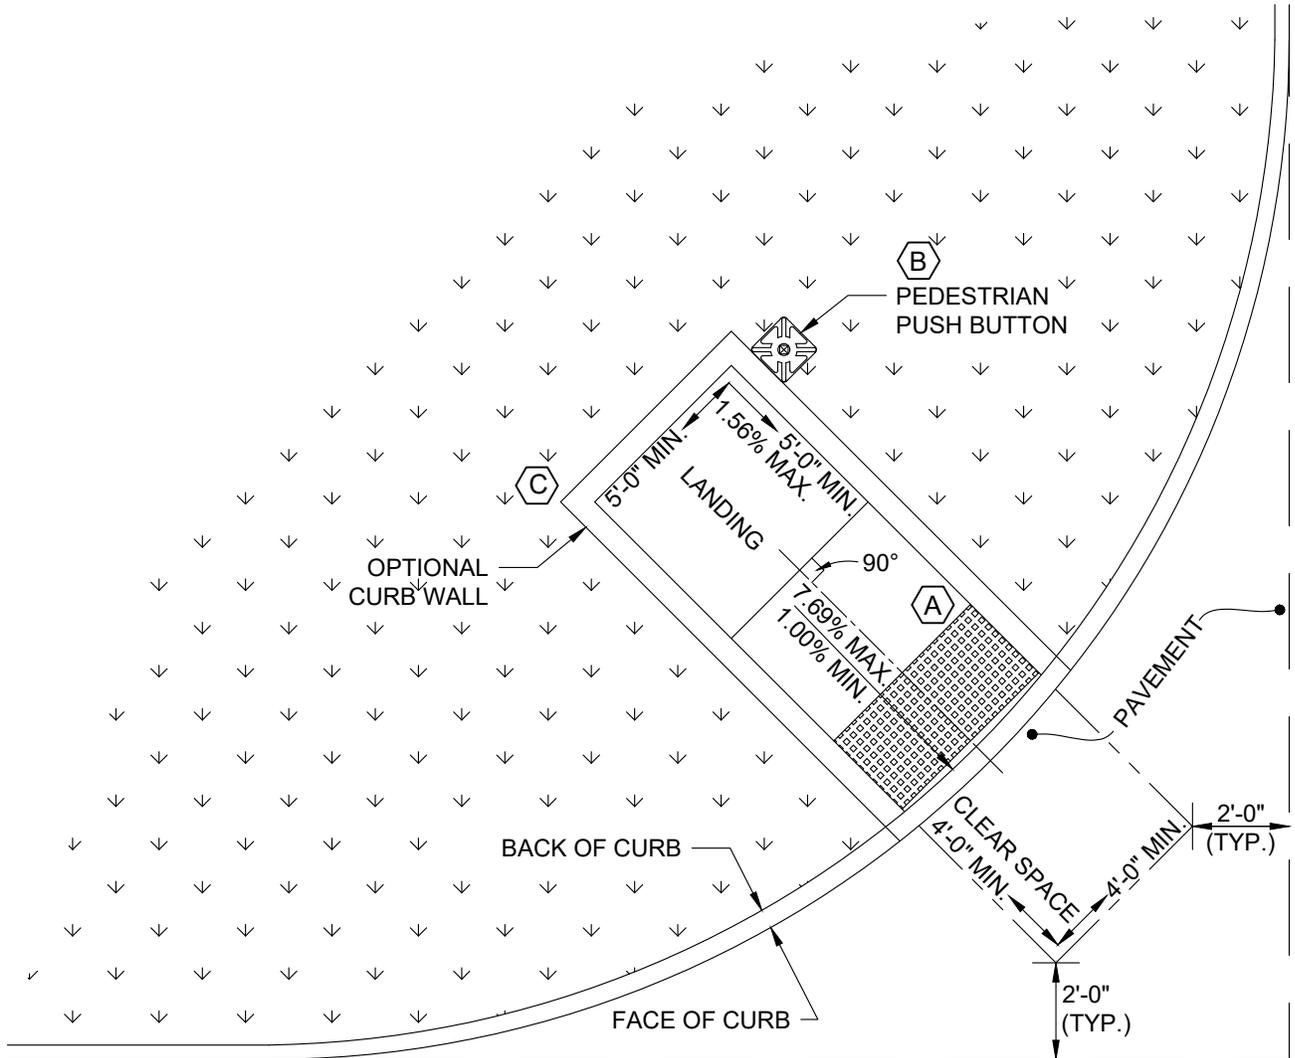

CODED NOTES:

- (A)** SEE SHEET 21 FOR DETECTABLE WARNING DETAILS. THE FRONT TWO FEET OF THE RAMP AND FLARES SHALL BE CONSTRUCTED USING CONCRETE 8" THICK AND TRANSITIONING TO 4" CONCRETE FURTHER THAN 2 FEET FROM THE BACK OF THE CURB
- (B)** ORIENTATION/LOCATION OF PUSH BUTTON/PEDESTAL TO BE PER POLICY
- (C)** CURB WALL MAY BE NECESSARY BASED ON EXISTING TOPOGRAPHY. IF CURB WALL IS NOT CONSTRUCTED, THE LANDING WIDTH CAN BE REDUCED TO 4'x4'.

GENERAL NOTES:

1. RAMP AND LANDING MUST BE CONSTRUCTED TO DRAIN, TYPICALLY TOWARDS THE ROADWAY, BUT MAY VARY BASED ON EXISTING TOPOGRAPHY. WEEP HOLES ARE NOT PERMITTED FOR DRAINAGE.
2. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.



CURB RAMP TYPE PP-3

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG
2319

3/30/2018

SHT 18 OF 21

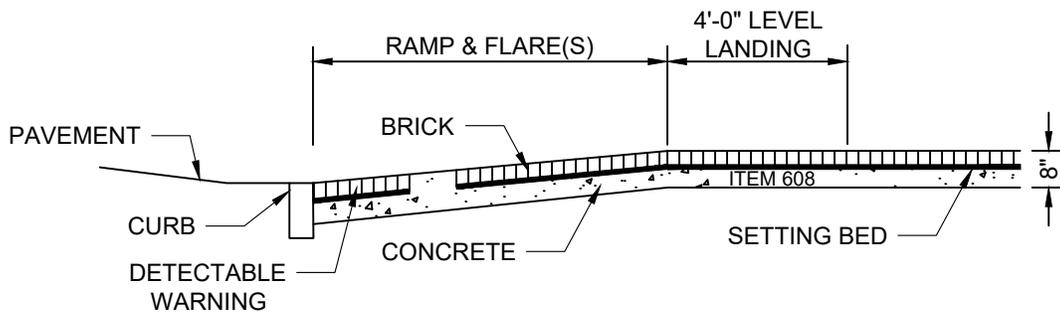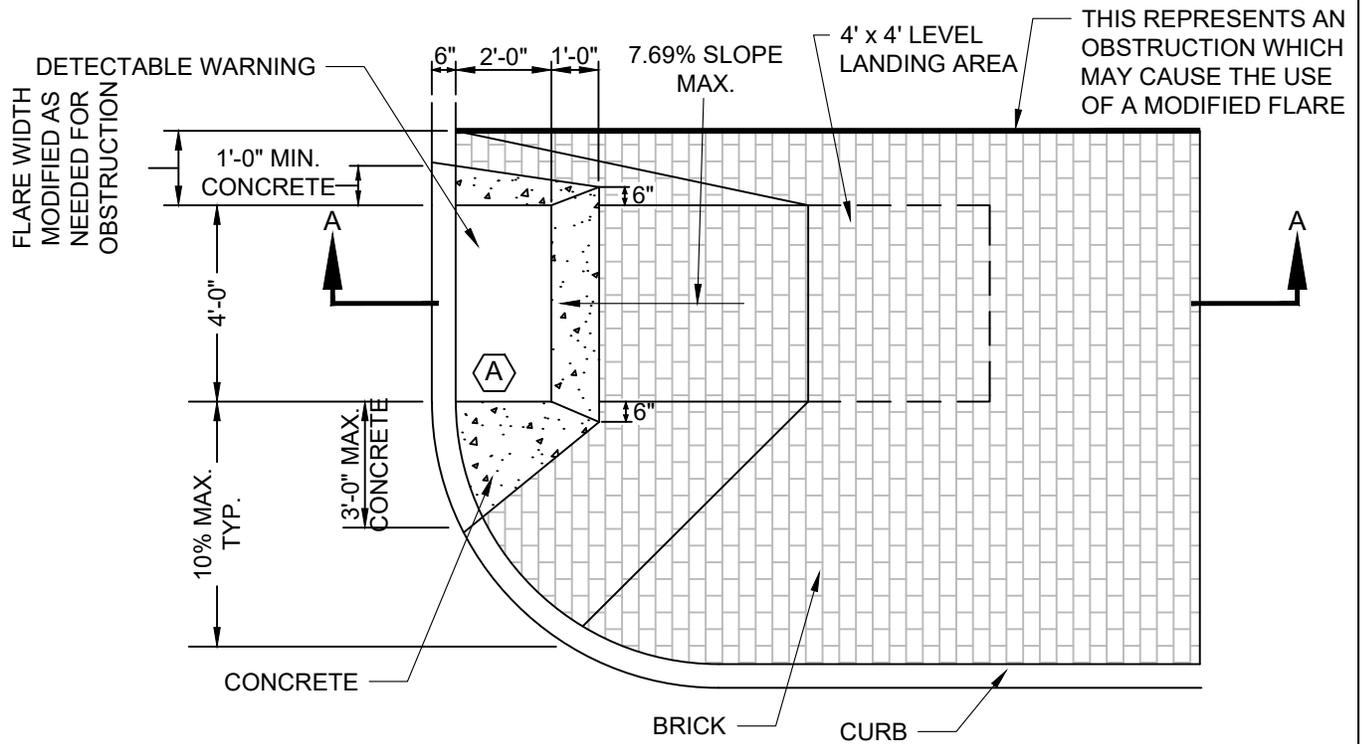

SECTION A-A

1. WRITTEN APPROVAL FROM THE CITY ENGINEER OR AN AUTHORIZED REPRESENTATIVE SHALL BE OBTAINED PRIOR TO THE DESIGN OR CONSTRUCTION OF GRANITE OR AN ALTERNATE MATERIAL CURB RAMP.
2. ALONG WITH THE REQUIREMENT OF THIS SHEET FOR BRICK OR GRANITE CURB RAMPS, ALL OTHER APPLICABLE REQUIREMENTS OF 2319 SHALL BE FOLLOWED.
3. BRICK OR GRANITE CURB RAMPS SHALL BE TYPED PER 2319. TYPICALLY TYPE A OR TYPE D WILL BE USED. ALL APPLICABLE DIMENSIONS AND REQUIREMENTS FOR THE SELECTED TYPE OF RAMP SHALL BE FOLLOWED.
4. LONG FLARES WILL BE USED WHEREVER POSSIBLE. A MODIFIED FLARE SHALL BE USED WHEN AN OBSTRUCTION EXISTS.
5. THE INSTALLATION OF THE BRICK OR GRANITE PAVERS SHALL BE DONE PER STD DWG 2301, BRICK SIDEWALK.

CODED NOTES:

 SEE SHEET 21 FOR DETECTABLE WARNING DETAILS

PERPENDICULAR CURB RAMP BRICK SIDEWALK


CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG

2319

3/30/2018

SHT 19 OF 21



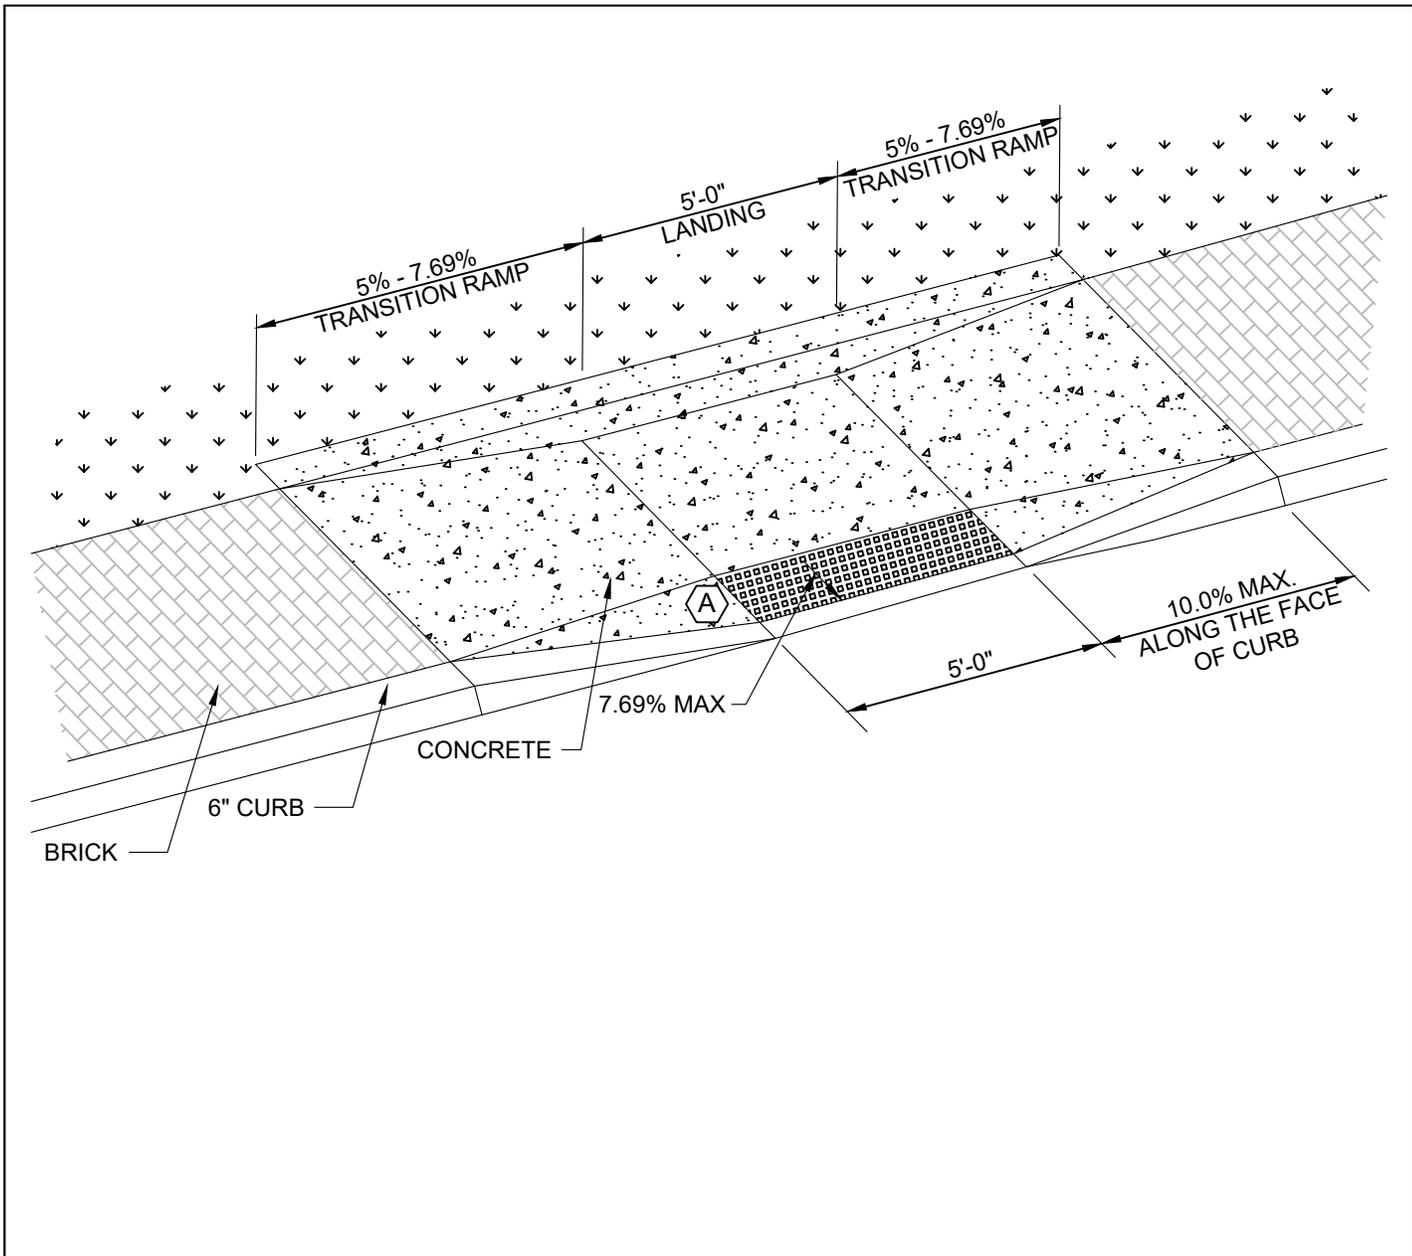


1. WRITTEN APPROVAL FROM THE CITY ENGINEER OR AN AUTHORIZED REPRESENTATIVE SHALL BE OBTAINED PRIOR TO THE DESIGN OR CONSTRUCTION OF GRANITE OR AN ALTERNATE MATERIAL CURB RAMP.
2. ALONG WITH THE REQUIREMENT OF THIS SHEET FOR BRICK OR GRANITE CURB RAMPS, ALL OTHER APPLICABLE REQUIREMENTS OF 2319 SHALL BE FOLLOWED.
3. BRICK OR GRANITE CURB RAMPS SHALL BE TYPED PER 2319. TYPICALLY TYPE A OR TYPE D WILL BE USED. ALL APPLICABLE DIMENSIONS AND REQUIREMENTS FOR THE SELECTED TYPE OF RAMP SHALL BE FOLLOWED.
4. LONG FLARES WILL BE USED WHEREVER POSSIBLE. A MODIFIED FLARE SHALL BE USED WHEN AN OBSTRUCTION EXISTS.
5. THE INSTALLATION OF THE BRICK OR GRANITE PAVERS SHALL BE DONE PER STD DWG 2301, BRICK SIDEWALK.

CODED NOTES:


 SEE SHEET 21 FOR DETECTABLE WARNING DETAILS

<h2 style="margin: 0;">PARALLEL CURB RAMP BRICK SIDEWALK</h2>	
CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC SERVICE DIVISION OF DESIGN AND CONSTRUCTION	STD DWG 2319
3/30/2018	
SHT 20 OF 21	

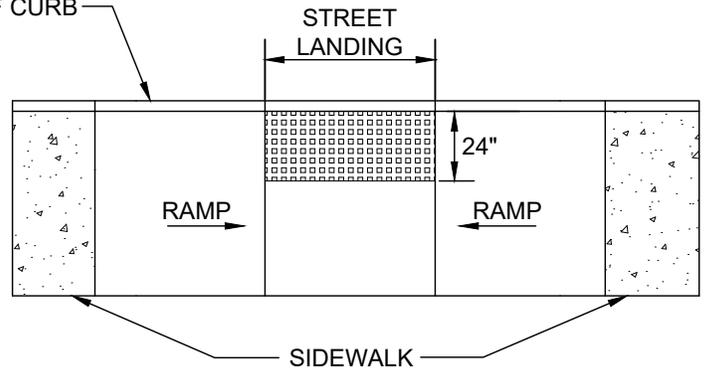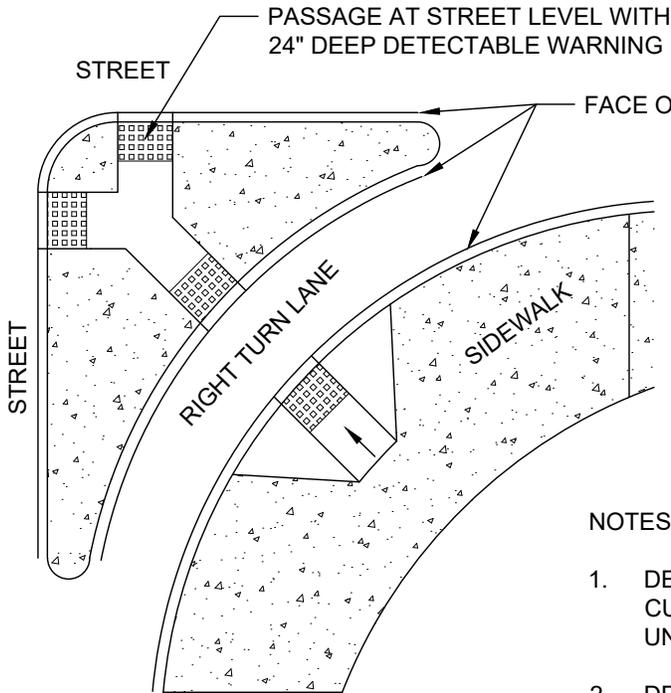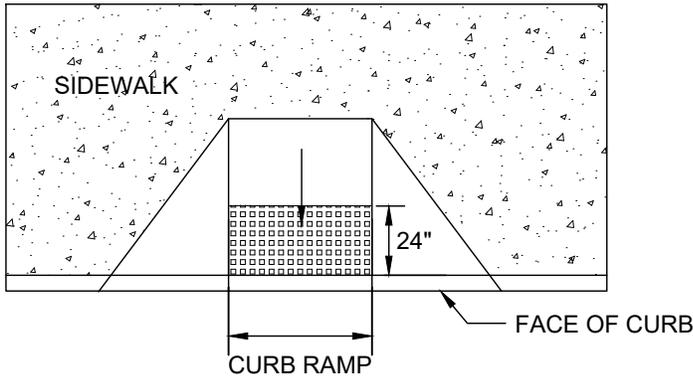

NOTES:

1. DETECTABLE WARNINGS SHALL BE PROVIDED WHEREVER A CURB RAMP CROSSES A VEHICULAR WAY. EXCLUDING UNSIGNALIZED DRIVEWAY CROSSINGS.
2. DETECTABLE WARNINGS SHALL BE PROVIDED 24" IN THE DIRECTION OF TRAVEL AND EXTEND THE FULL WIDTH OF THE CURB RAMP OR FLUSH SURFACE. THE DETECTABLE WARNING SHALL BE LOCATED ADJACENT TO THE CURB LINE.
3. MATERIALS SHALL COMPLY WITH CMSC 608 AND DPS ADA RULES AND REGULATIONS.
4. DETECTABLE WARNINGS SHALL BE PLACED 6" TO 8" BEHIND THE FACE OF CURB AND BEHIND THE CURB JOINT.
5. CAST IN PLACE OR ANY NON-SURFACE APPLIED DETECTABLE WARNING SHALL HAVE A MINIMUM OF 3" OF CONCRETE ON EACH SIDE OF THE WARNING.

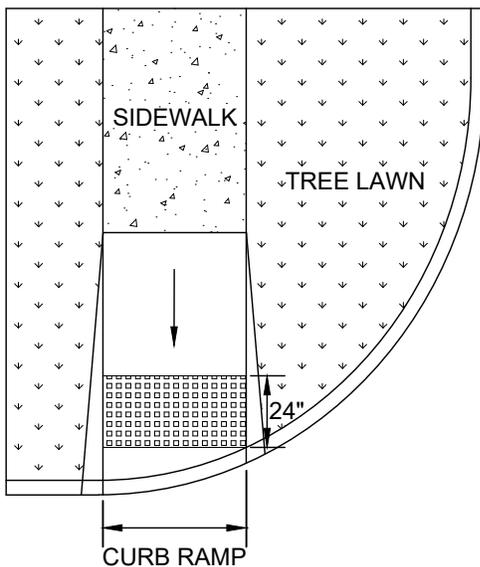

CURB RAMP DETECTABLE WARNINGS

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG

2319

3/30/2018

SHT 21 OF 21