

POLE KEY ANCHOR

I. Quantity

The base bid shall include the specified number of pole key anchors furnished and installed as hereinafter specified.

II. Material



Pole Key - The pole shall be an expanding type with a minimum expanded area of 270 sq. in. The key shall be Chance #P4817 or approved equal.

III. Installation

- a. The installation shall be as shown on drawing 01S0069.
- b. Pole shall be set and tamped in accordance with the specification titled WOODEN POLES.

IV. Quotation

The down pole key anchor, as hereinbefore specified shall be quoted on as a unit price each in the appropriate place of this document.

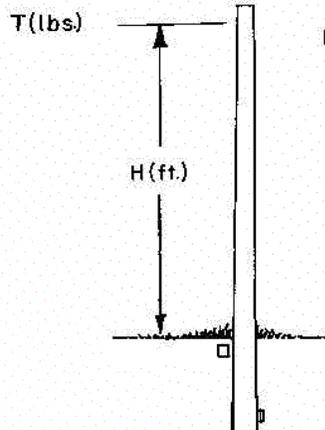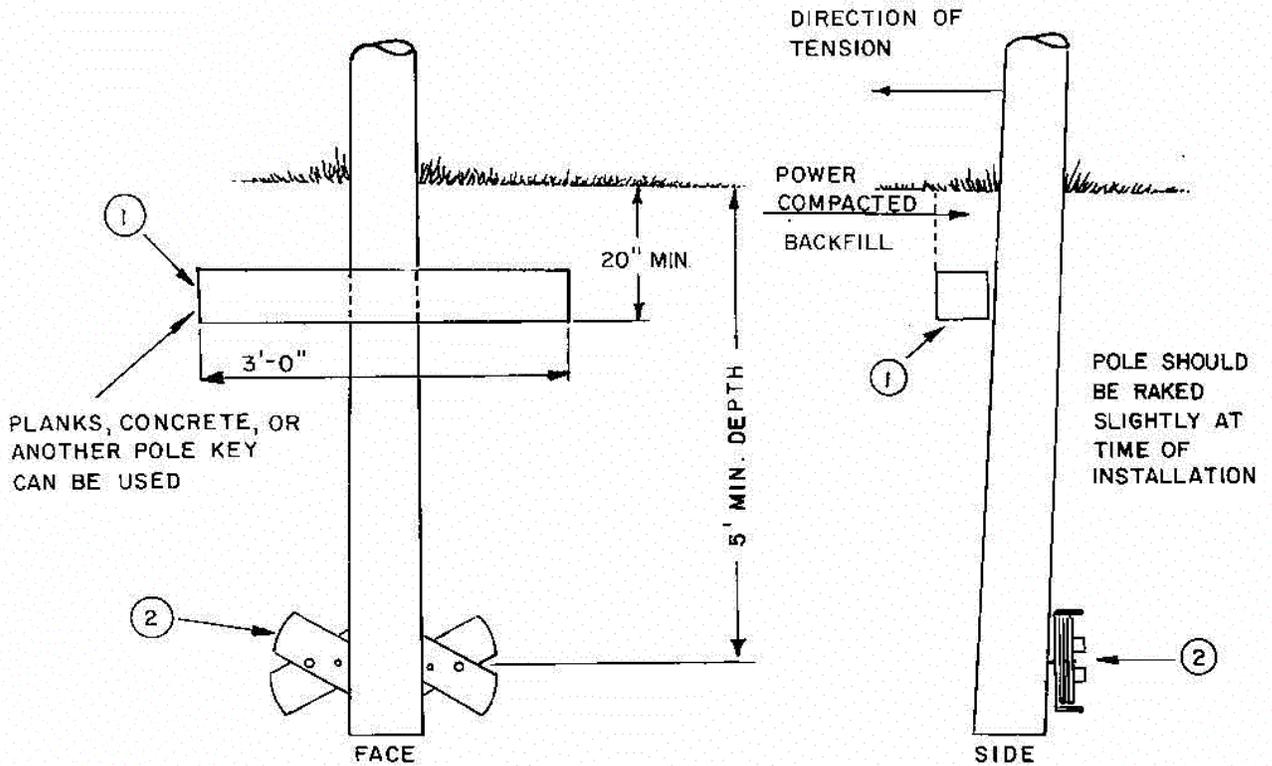

NOTE:
 MAXIMUM SUPPORTED
 LOAD (T) SHALL NOT
 EXCEED THE VALUE
 OF $\frac{28,800}{H}$

ITEM	PART NO.	NO. REQ'D.	DESCRIPTION
1		1	ANCHOR, POLE KEY, CONCRETE, OR PLANKS
2		1	POLE KEY EXPANDING ANCHOR

MEL & P MUNICIPAL ELECTRIC LIGHT & POWER SYSTEM
 CITY OF COLUMBUS, OHIO
 DEPT. OF PUBLIC SERVICE DIV. OF ELECTRICITY

POLE KEY ANCHOR ASSEMBLY - LIGHT DUTY

SCALE NONE	DRAWN LSZ 12/80	DRAWING NO.
PROJECT NO.	APPROVED B 12-80	01 S 0069
		SHEET 1 OF 1