

EXISTING LIGHT POLE FOUNDATION EXTENSIONS

I. Quantity

The base bid shall include the indicated number existing light pole foundation extensions located as shown on the drawing and made as hereinafter specified.

II. Material


- a. Anchor bolt extension shall be the same diameter as the existing bolt, threaded on both ends, length as required.
- b. The conduit shall be the same type and size as the existing conduit.
- c. Concrete shall be Item 499 Class C.

III. Installation

Installation shall be as shown on Division of Electricity drawing 01S0116.

IV. Quotation

Existing light pole foundation extensions as hereinbefore specified shall be quoted for as a unit price each in the appropriate section of this document.

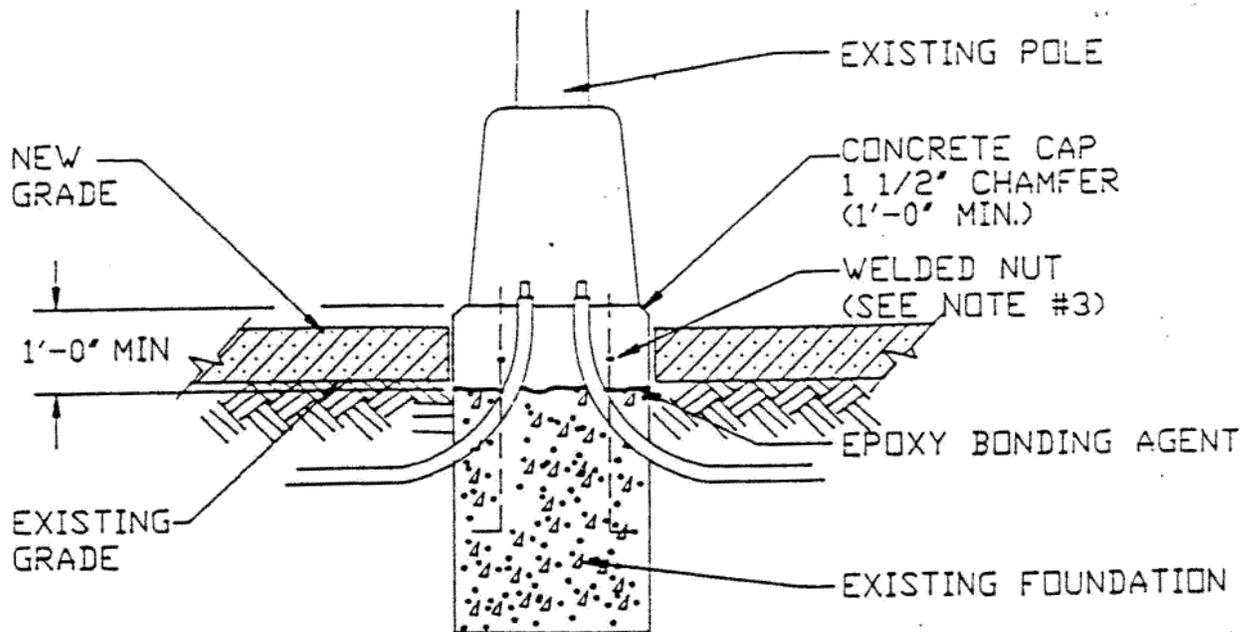

CAP NOTES

1. REMOVE POLE
2. REMOVE CONCRETE AS REQUIRED FOR MINIMUM CAP DEPTH (1'-0") EXTEND CONDUIT AS REQUIRED.
3. ATTACH ANCHOR BOLT EXTENSION TO EXISTING ANCHOR BOLT AND WELD IN PLACE.
4. THE TOP 6" OF THE CONCRETE CAP SHALL BE FORMED.
5. RESET POLE AFTER CONCRETE HAS CURED.
6. RECONNECT ELECTRICAL POWER & GROUNDING.
7. ALL CIRCUITS WHICH ARE DISCONNECTED FOR CONSTRUCTION ACTIVITIES MUST BE TEMPORARILY RECONNECTED AT END OF EACH WORK DAY.

MELP

MUNICIPAL ELECTRIC LIGHT & POWER SYSTEM
CITY OF COLUMBUS, OHIO
DEPT. OF UTILITIES & AVIATION - DIV. OF ELECTRICITY

EXTENDING EXISTING LIGHT POLE FOUNDATION

REVISIONS

SCALE NONE

DRAWN LM 09/93

DRAWING NO.

C. I. NUMBER

APPROVED

01S0116
SHEET 1 OF 1