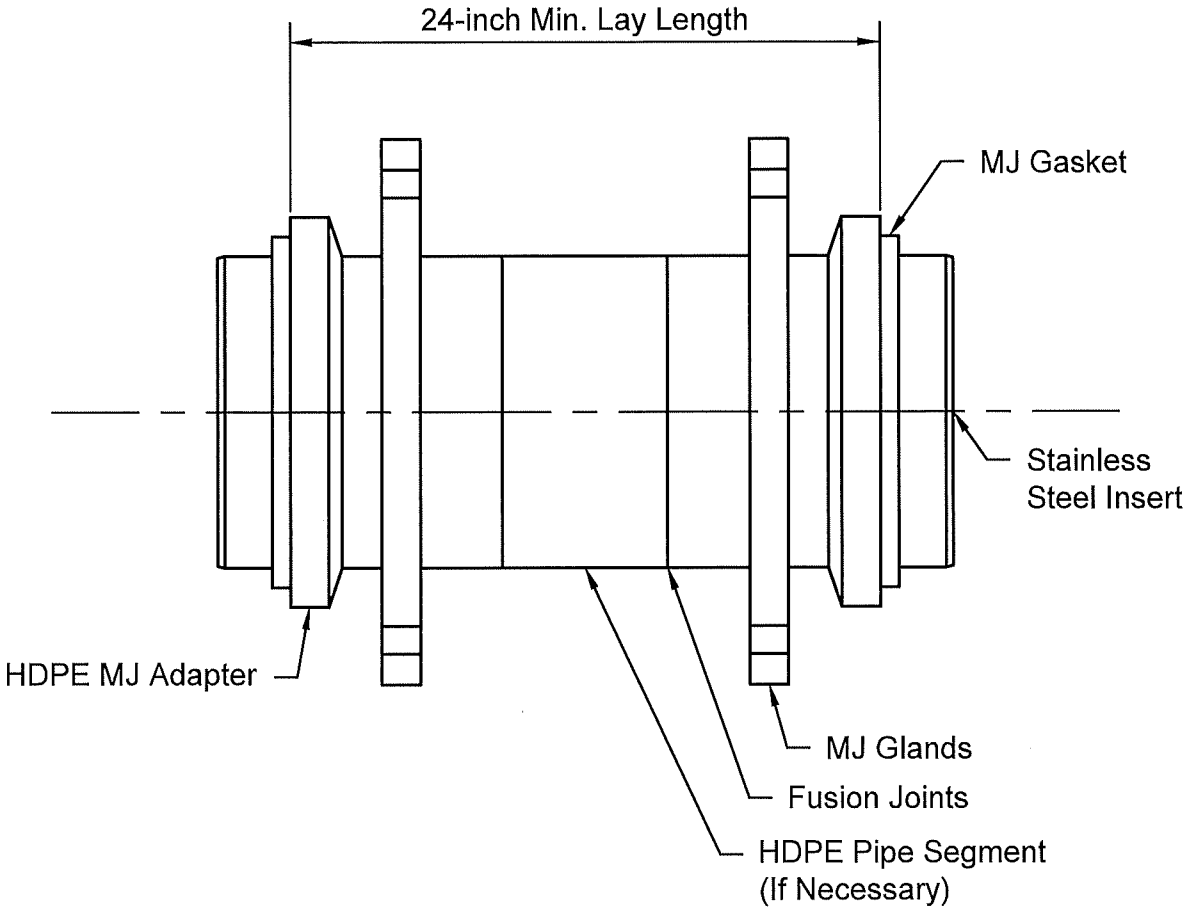

Note:

1. Butt Fusion X Mechanical Joint Adapters shall be SDR 9, PE 4710 HDPE, Ductile Iron Pipe Size.

CITY OF COLUMBUS DEPARTMENT OF PUBLIC UTILITIES DIVISION OF WATER APPROVED: Danella Pottenski 3/10/22 ADMINISTRATOR DATE	STANDARD DETAIL **Fabricated HDPE MJ Isolation Adapter, 6"–48"**	L–2102

L–2102.Dwg Revision Date: 01/14/22