


SERVICE BOX (IN PAVEMENT)
SEE L-6320

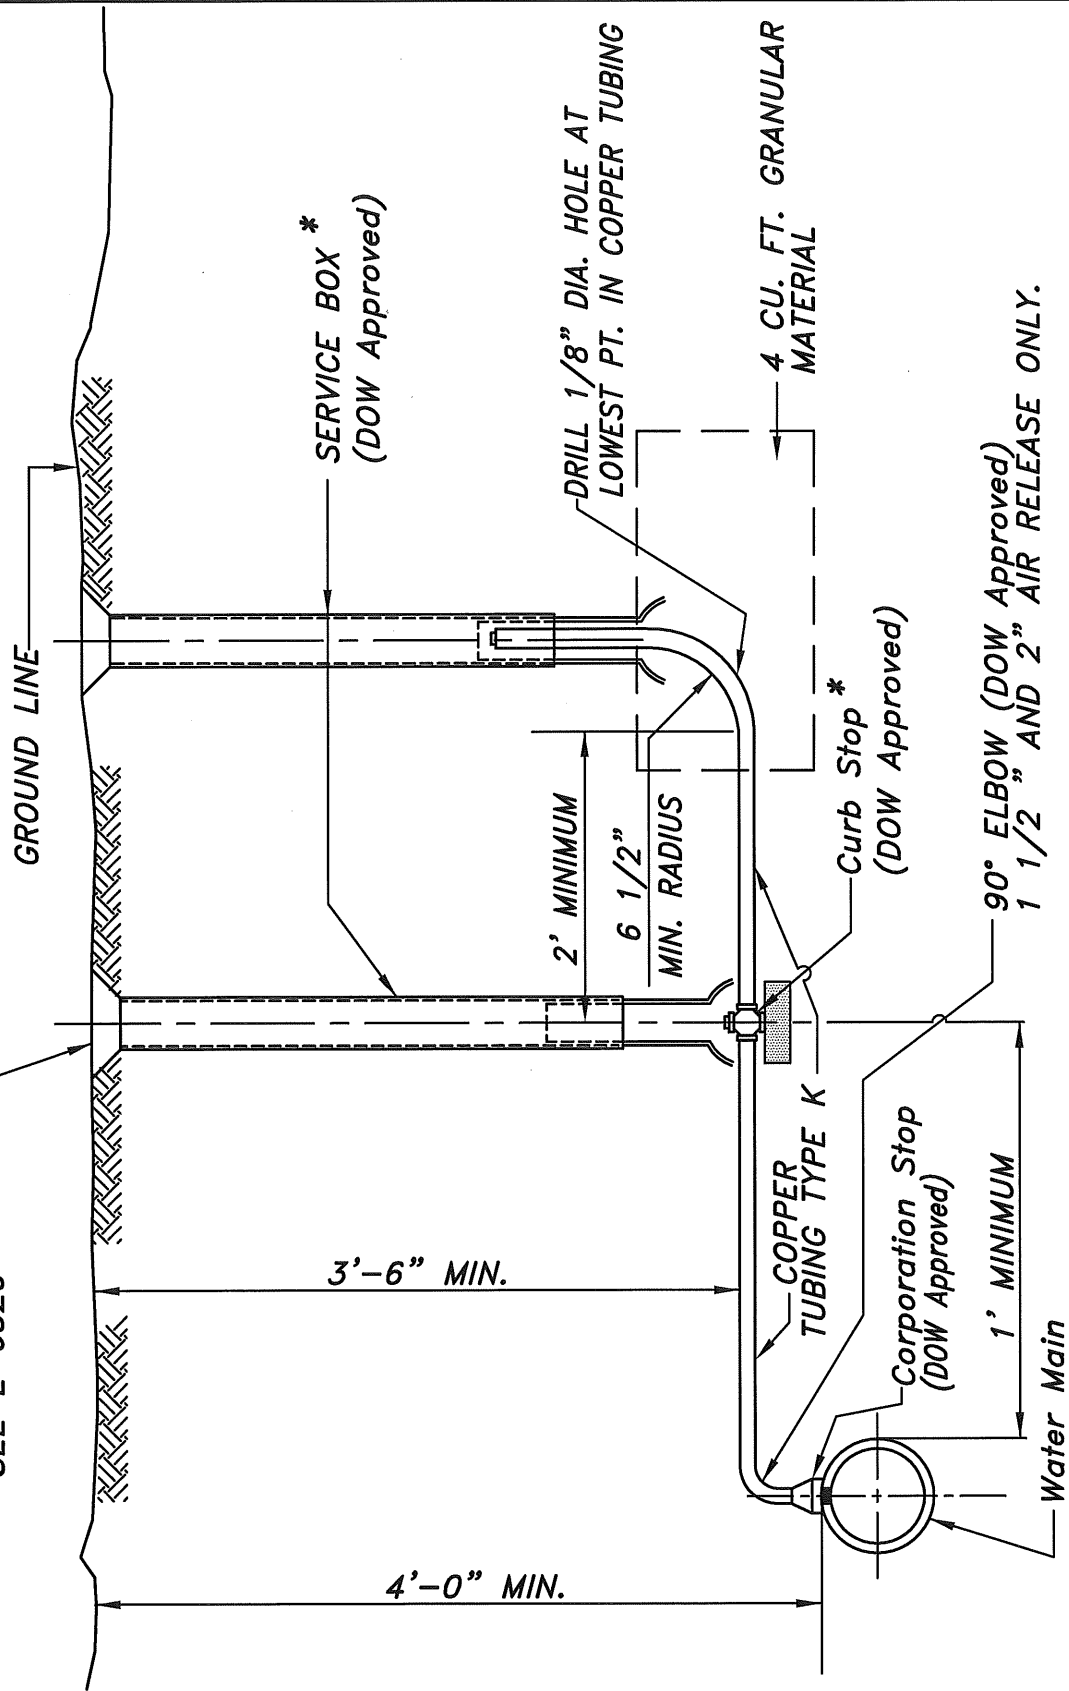

SERVICE BOX *
(DOW Approved)

DRILL 1/8" DIA. HOLE AT
LOWEST PT. IN COPPER TUBING

4 CU. FT. GRANULAR
MATERIAL

2' MINIMUM

6 1/2" MIN. RADIUS

Curb Stop *
(DOW Approved)

90° ELBOW (DOW Approved)
1 1/2" AIR RELEASE ONLY.

3'-6" MIN.

COPPER TUBING TYPE K

Corporation Stop
(DOW Approved)

1' MINIMUM

Water Main

4'-0" MIN.

* NOTE:
For reference in placing new curb stops and curb boxes see L-9901.

CITY OF COLUMBUS
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

STANDARD DETAIL
TYPICAL AIR RELEASE
3/4" THRU 2"
(BERM & SIDE DITCH AREAS)



APPROVED:
RC Westerfield
ADMINISTRATOR

11-5-15
DATE