


*** NOTE:**
For reference in placing new curb stops and relocated curb boxes see L-9901.

Detail "A"
(w/ Sidewalk)

**** NOTE:**
Should Poly tubing, Galvanized or Lead material be encountered the entire Service Line shall be replaced w/ Copper from the existing Corporation Stop to the new Curb Stop. Pipe shall be Copper Tubing Size (C.T.S.).

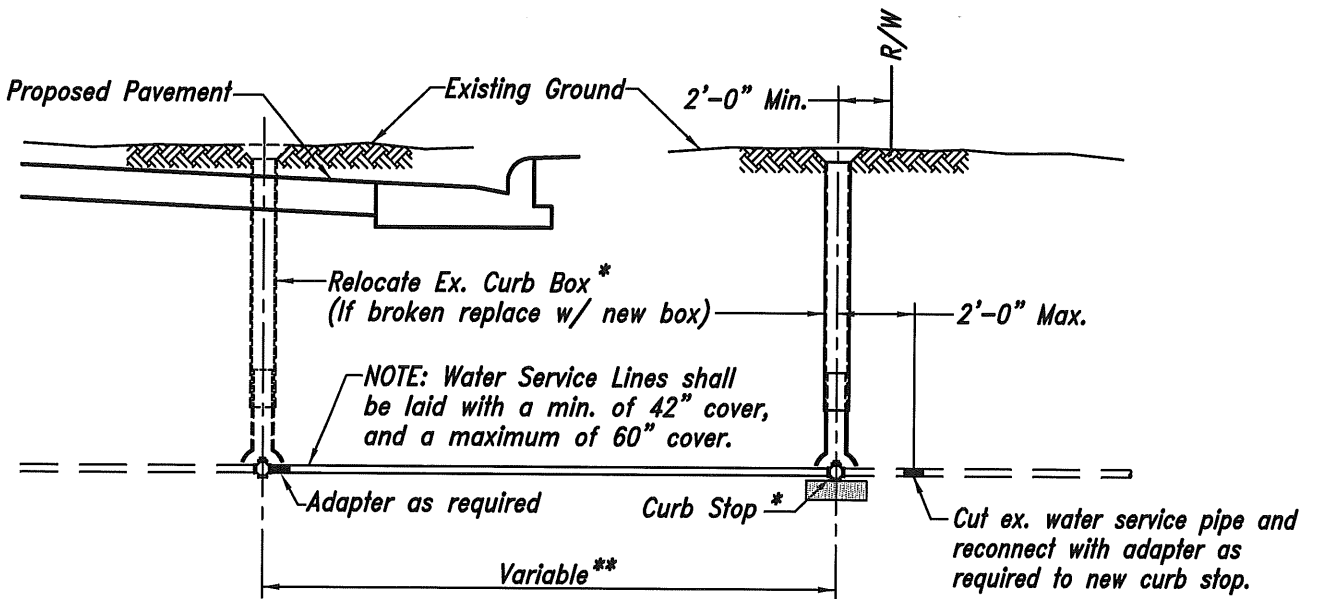

Detail "B"
(w/o Sidewalk)

L-7102A.Dwg Revision Date: 10/30/15

CITY OF COLUMBUS
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

APPROVED:
RC Westerfield 11-5-15
ADMINISTRATOR DATE

STANDARD DETAIL
WATER SERVICE EXTENSION
AND
CURB BOX RELOCATION

