


Top View

NOTE:
Refer to Division of Water Standard Details "L-6317D", "L-9002A & L-9002B" for additional information.

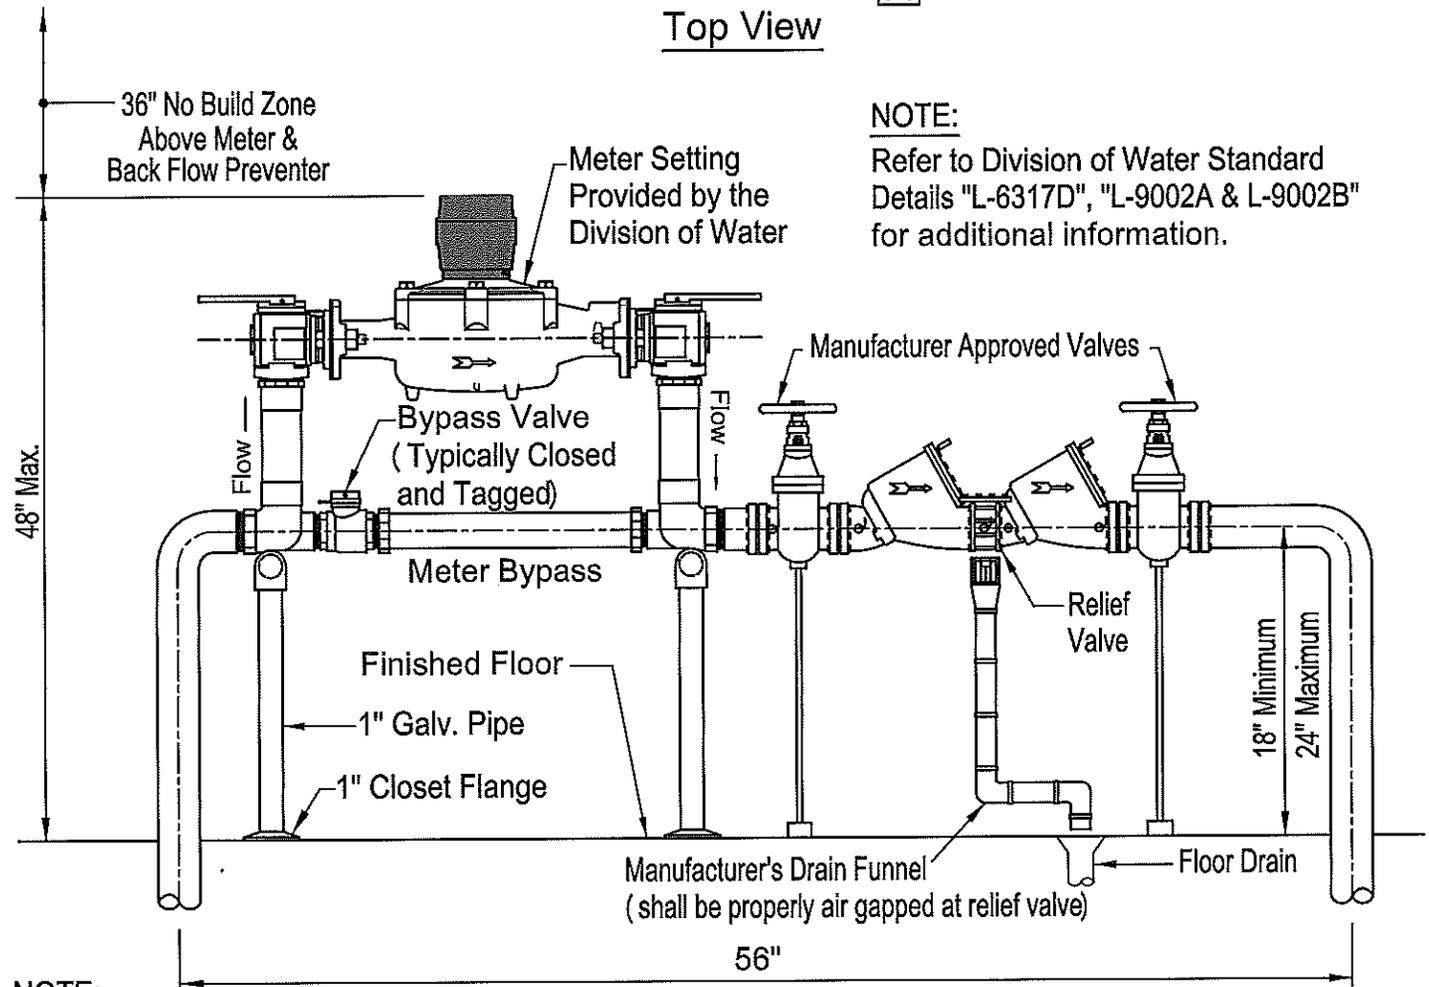

Side View

NOTE:
A 1.5" Meter is typically installed on a 2" Water Service. A 2" Meter on a 2" Water Service requires pre-approval by the Division of Water Distribution Engineering Office.

L-9002C.Dwg Revision Date: 4/30/13

CITY OF COLUMBUS DEPARTMENT OF PUBLIC UTILITIES DIVISION OF WATER	
APPROVED: <i>RC Westerfield</i> ADMINISTRATOR	5-16-13 DATE

STANDARD DETAIL
TYPICAL 1 1/2" METER
SETTING w/ BACKFLOW PREVENTER

