



Note:
 For Manhole and Valve Box
 Details please refer to
 Division of Water Standard
 Drawing "L-9401B".

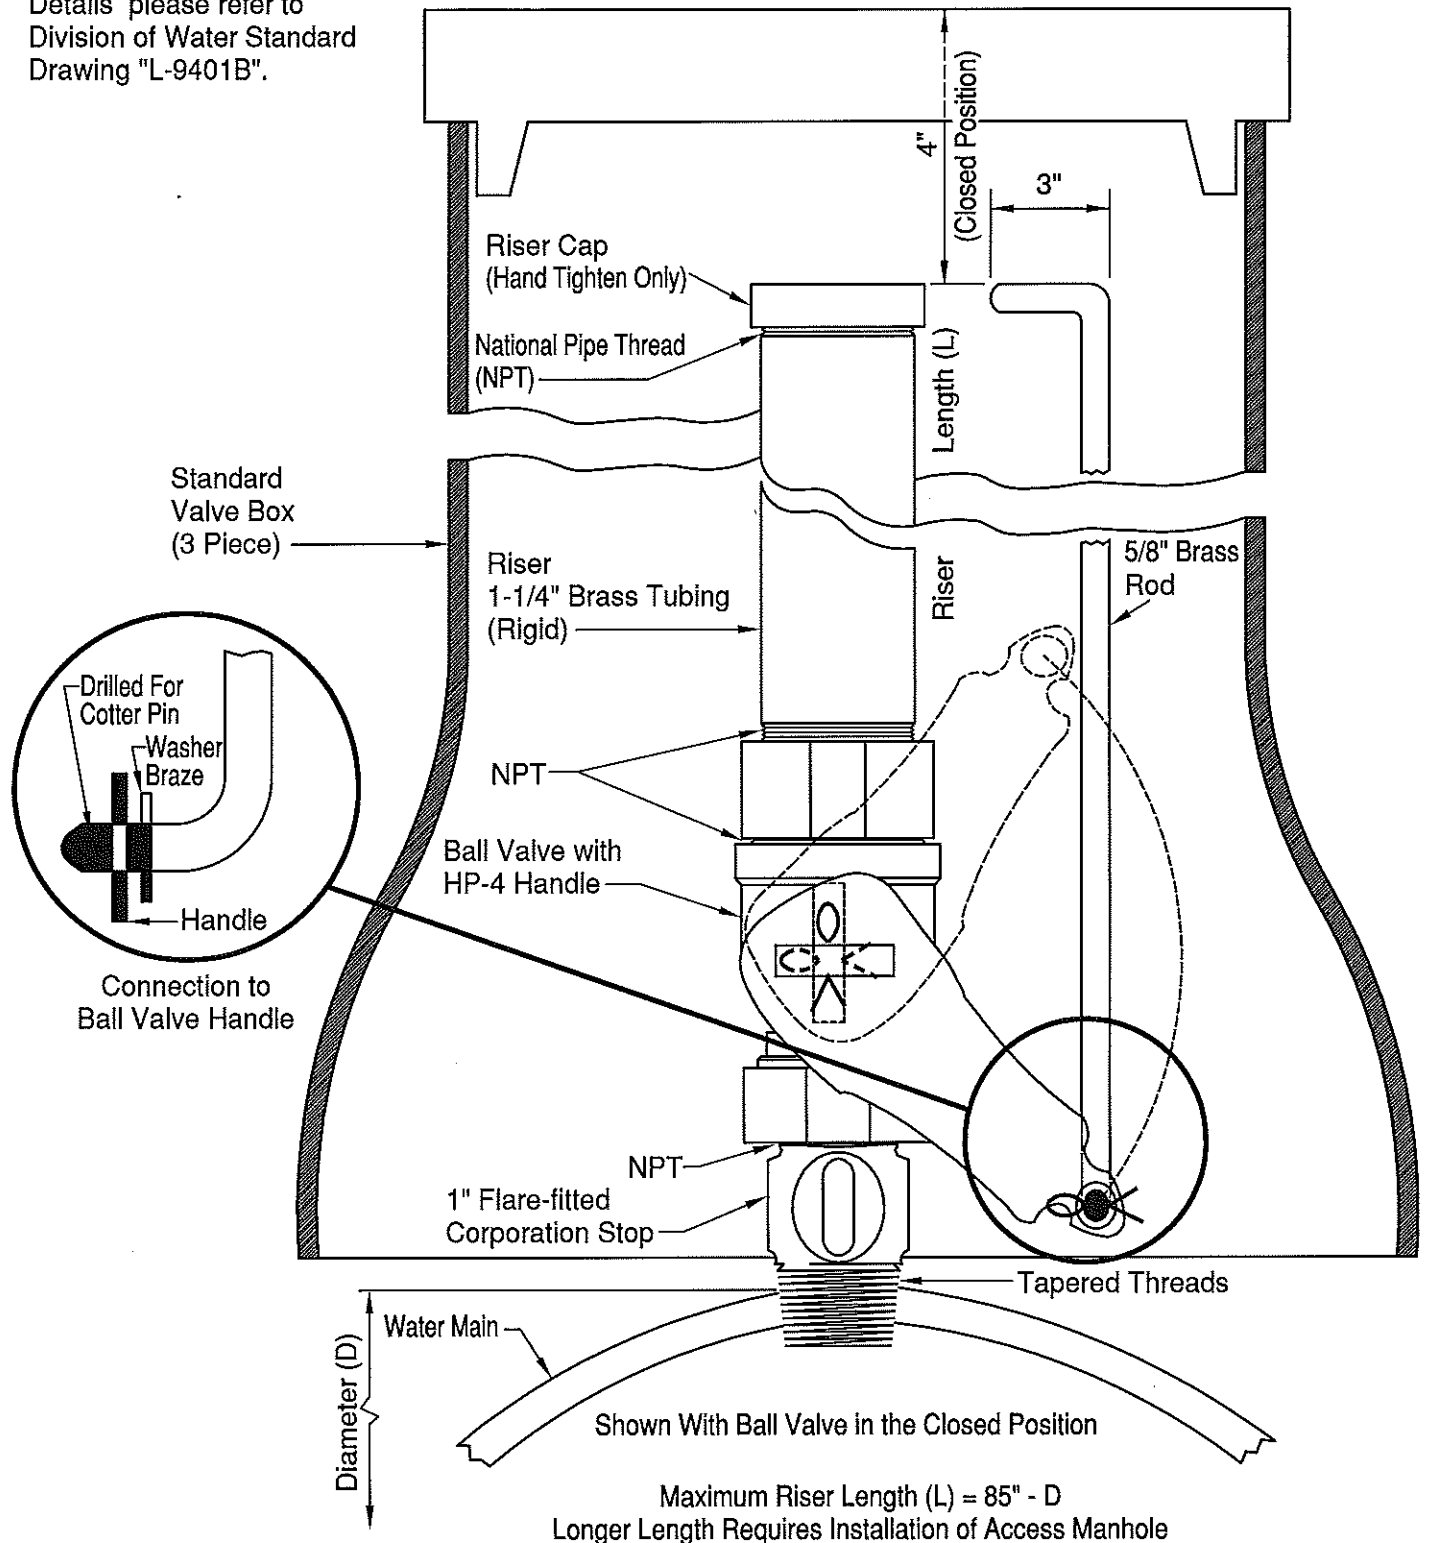

Maximum Riser Length (L) = 85" - D
 Longer Length Requires Installation of Access Manhole

L-9401A.Dwg. Revision Date: 1/2/13

CITY OF COLUMBUS DEPARTMENT OF PUBLIC UTILITIES DIVISION OF WATER	STANDARD DETAIL	
APPROVED: <i>RC Westerfield</i> 5-16-13 ADMINISTRATOR DATE	PITOMETER CONNECTIONS	