

NOTES:


The Curb Box shall be placed 1'-0" from the streetedge of the proposed or existing sidewalk/bikepath, or 2 feet inside the right-of-way or easement line when no sidewalk/bikepath is present or proposed.

When a curb box is installed within a traveled area, the contractor shall install a C.I. Ferrule Box per "L-6320".

The Curb Stop Shall Be Installed with Valve Opening Facing the Structure to be served. The Curb Stop Shall Turn "1/4 Turn" Clockwise From On to Off Position. (Typical)

*** NOTE:**

Pipe Shall Be Copper Tubing Size (C.T.S.)

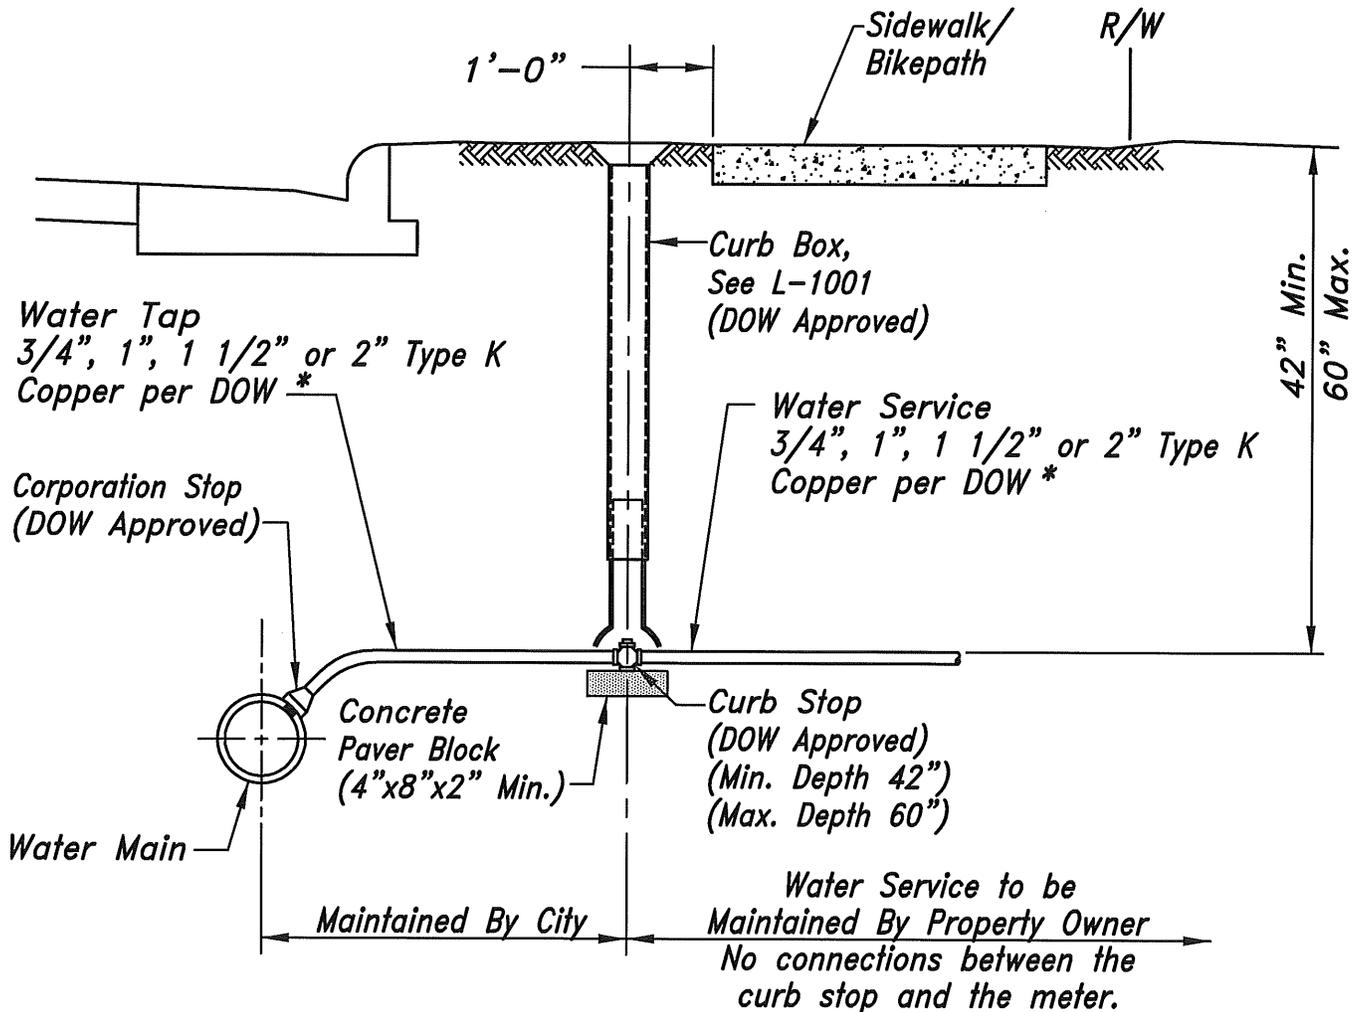

L-9901.Dwg Revision Date: 10/30/15

CITY OF COLUMBUS
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

APPROVED:
R.C. Westerfield 11-5-15
ADMINISTRATOR DATE

STANDARD DETAIL
CURB BOX INSTALLATION
3/4" THRU 2"

