



**NOTES:**

1. PIPES DRAINING INTO THE INLET SHALL BE PLACED 2"± ABOVE ELEVATION OF OUTLET PIPE.
2. MAXIMUM SIZE PIPE WITH 42"Ø BASIN IS 24".
3. INLETS SHALL BE BUILT OF BRICK, PRECAST SOLID CONCRETE BLOCKS, CAST IN PLACE CONCRETE, OR PRE CAST CONCRETE.
4. PRECAST BASINS MUST BE 48" DIAMETER.
5. PRECAST UNITS SHALL HAVE MEET THE REQUIREMENTS OF ASTM C478 AND SHALL HAVE A MINIMUM WALL THICKNESS OF 5" AND BE REINFORCED SUFFICIENTLY TO PERMIT SHIPPING AND HANDLING WITHOUT DAMAGE.
6. CONNECTIONS SHALL BE MADE IN ACCORDANCE WITH 604.06.

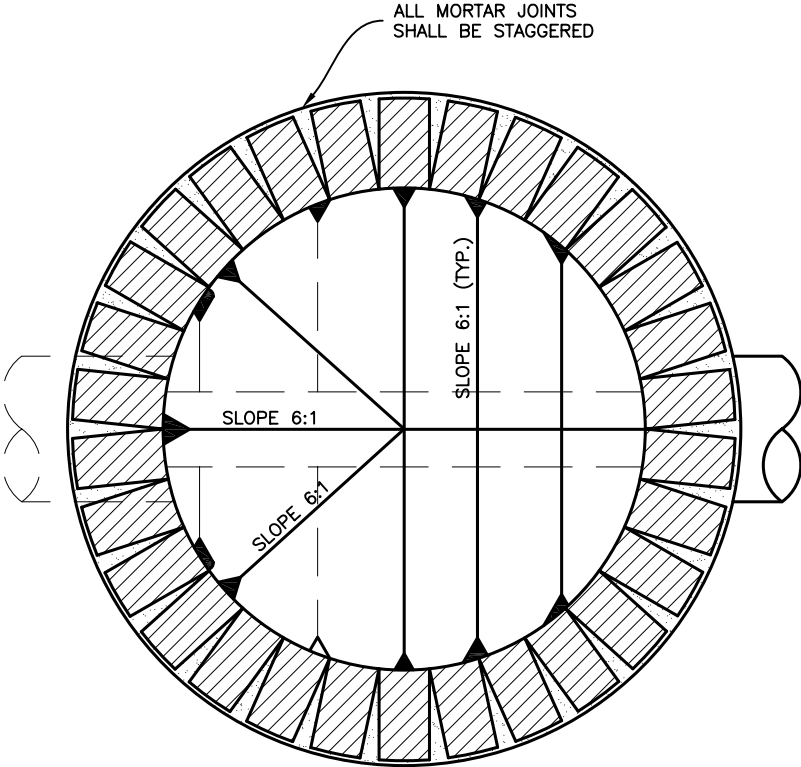

**SECTIONAL PLAN**

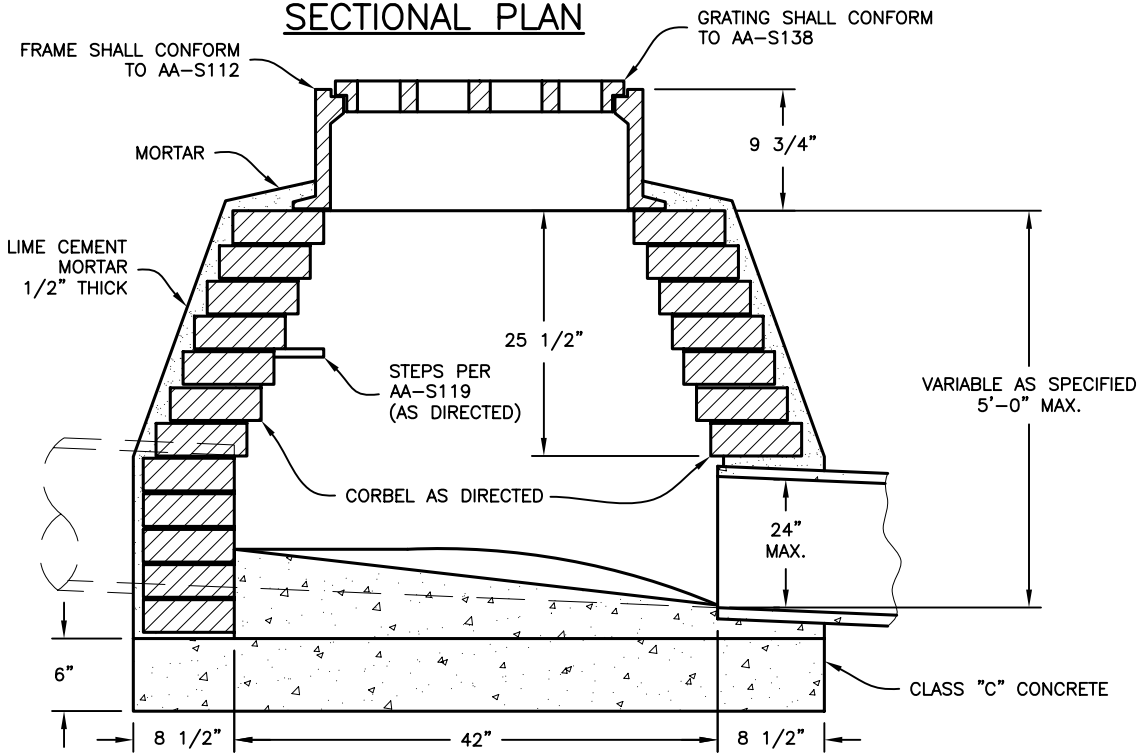

**SECTIONAL ELEVATION**

CITY OF COLUMBUS, OHIO  
 DEPARTMENT OF PUBLIC UTILITIES  
 DIVISION OF SEWERAGE & DRAINAGE

*John J. Newson*

SSS MANAGER

CATCH BASIN  
 42" DIAMETER

STANDARD DRAWING  
 AA-S132

REVISED 10/30/12

PAGE

1

1