
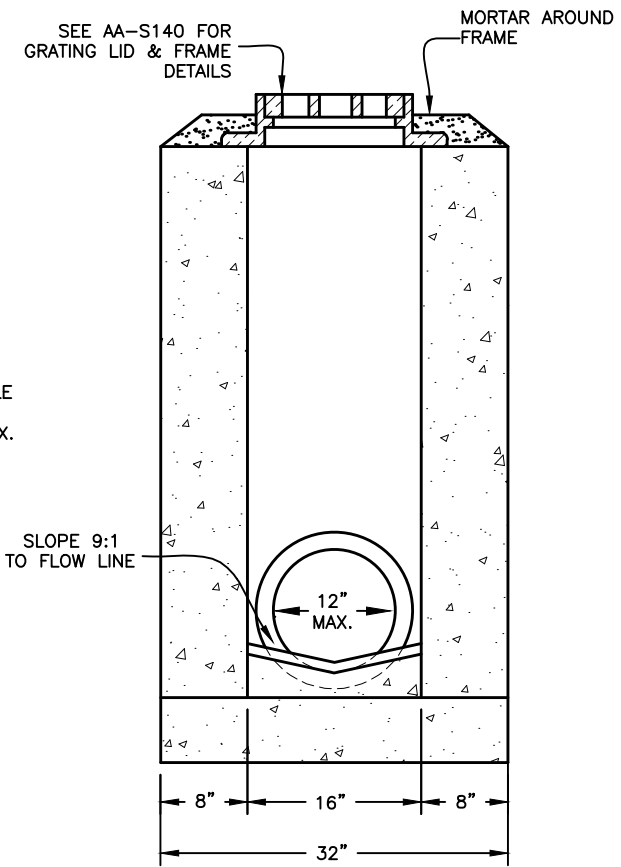


TYPE OF STRUCTURE	A	B
STRUCTURE FOR SINGLE TRACK FRAME	40	24
STRUCTURE FOR DOUBLE TRACK FRAME	64	48

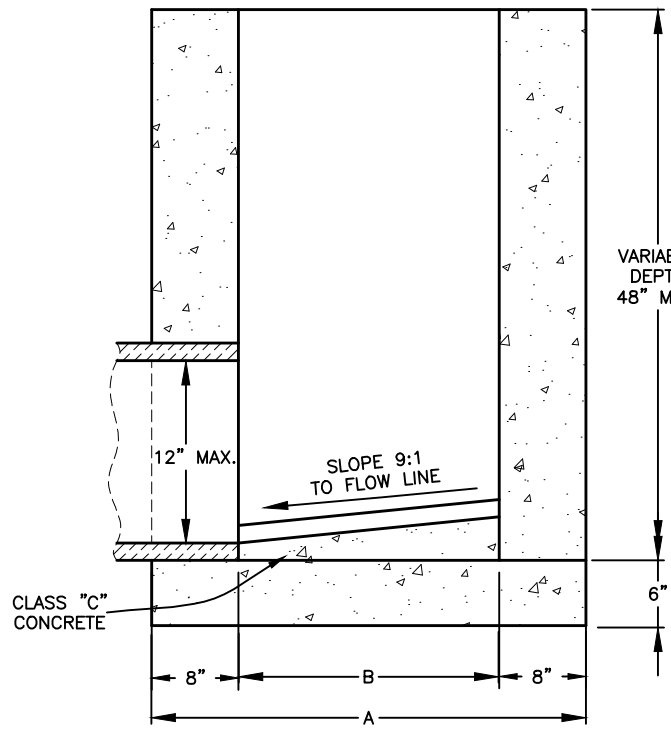

NOTE:

1. OUTLET PIPE MAY BE LOCATED IN END OR SIDE WALL. IN EITHER CASE OUTLET PIPE TO BE DIRECTED TOWARDS CENTER OF BASIN.
2. ALL CONCRETE SHALL BE CLASS "C".
3. PRECAST UNITS SHALL BE IN ACCORDANCE WITH ASTM C913, HAVE A MINIMUM THICKNESS OF 6" AND BE REINFORCED SUFFICIENTLY TO PERMIT SHIPPING AND HANDLING WITHOUT DAMAGE.

CITY OF COLUMBUS, OHIO
 DEPARTMENT OF PUBLIC UTILITIES
 DIVISION OF SEWERAGE & DRAINAGE

John J. Newson

SSES MANAGER

PRECAST
 RECTANGULAR
 CATCH BASIN

STD. DWG.
 AA-S135

REVISED 8/8/14

PAGE 1 / 1