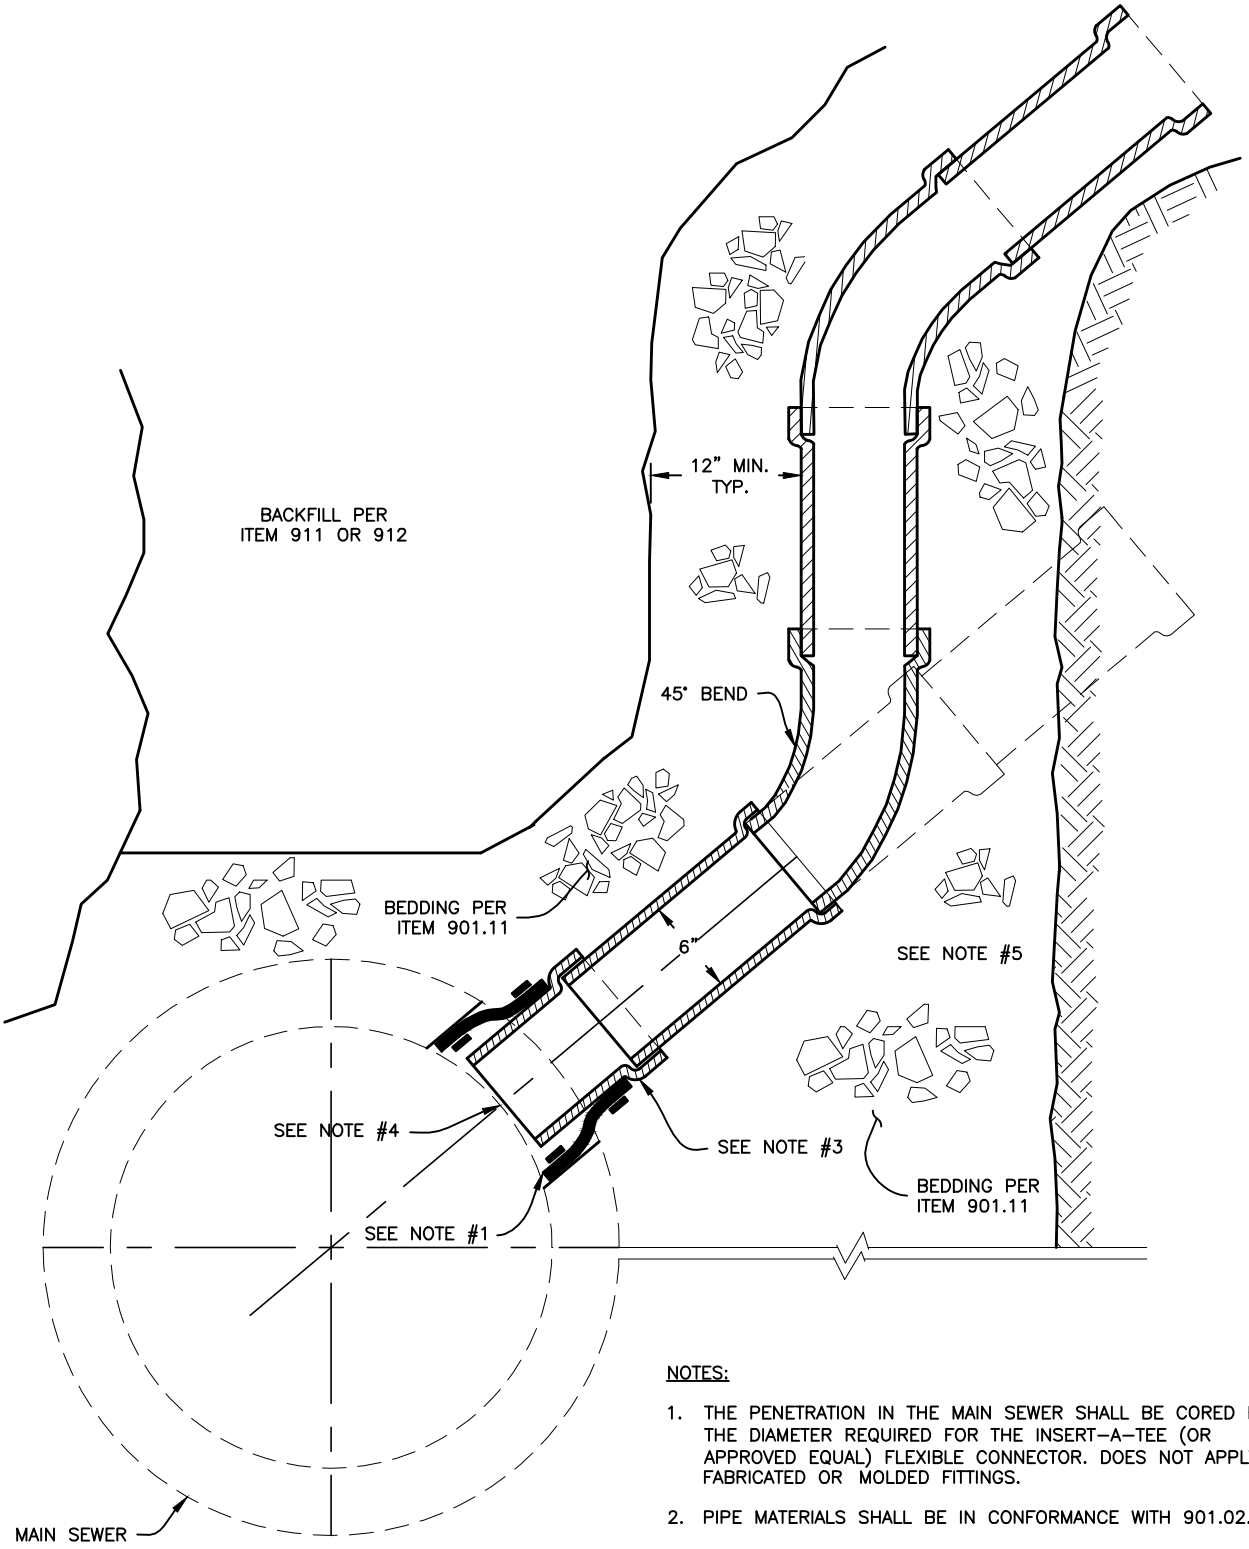

NOTES:

1. THE PENETRATION IN THE MAIN SEWER SHALL BE CORED FOR THE DIAMETER REQUIRED FOR THE INSERT–A–TEE (OR APPROVED EQUAL) FLEXIBLE CONNECTOR. DOES NOT APPLY TO FABRICATED OR MOLDED FITTINGS.
2. PIPE MATERIALS SHALL BE IN CONFORMANCE WITH 901.02.
3. BEGINNING OF BELL SECTION OF STUB PIPE TO BE FLUSH WITH END OF FLEXIBLE CONNECTOR.
4. STUB PIPE SHALL NOT EXTEND INTO MAIN SEWER.
5. VERTICAL RISER MAY LAY AGAINST UNDISTURBED SOIL.

CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC UTILITIES DIVISION OF SEWERAGE & DRAINAGE	TYPICAL CORED RISER DETAIL (FLEXIBLE SEWER)	STANDARD DRAWING AA–S162
SSES MANAGER		REVISED 7/9/12
		PAGE 1 / 1