


THE CLIP SHALL BE MADE FROM A36 METAL, HD GALV (ASTM A123) AND IN THE SHAPE SHOWN.

TOP VIEW OF CONCRETE PULL BOX

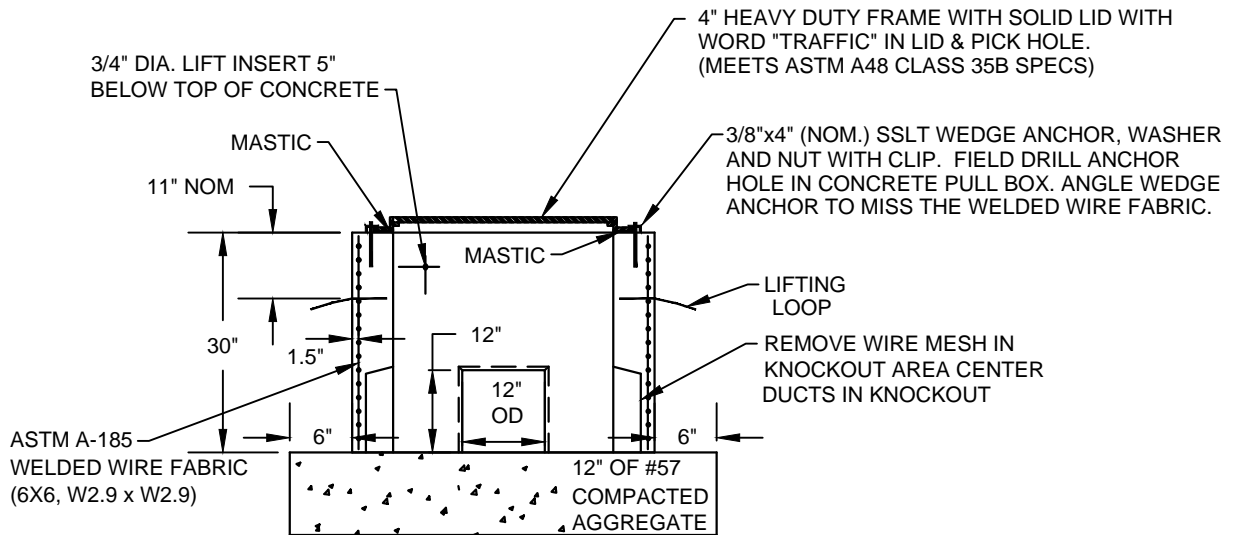

SECTION X-X PULL BOX WITH FRAME AND LID

PULL BOX 27"

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG
4021



[Signature]
CITY ENGINEER

8/10/2017


SHT 1 OF 3

2" RAISED LETTERS
FLUSH W/TOP SURFACE

4" HEAVY DUTY FRAME WITH SOLID LID WITH
WORD "TRAFFIC" IN LID & PICK HOLE.
(MEETS ASTM A48 CLASS 35B SPECS)

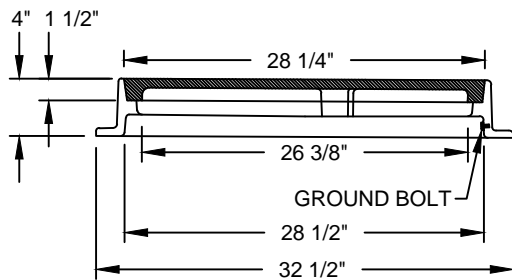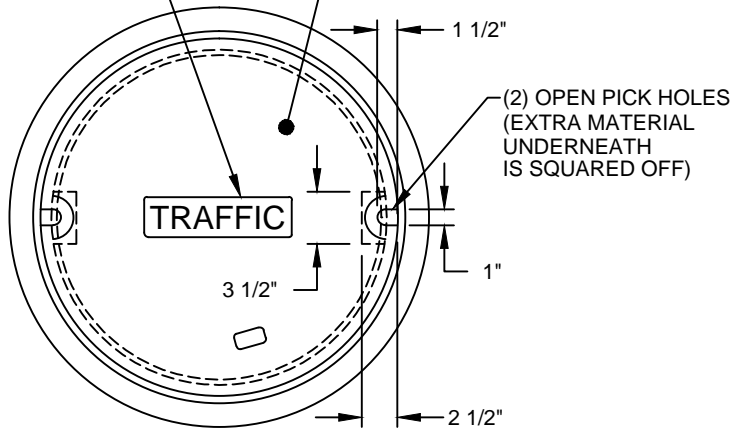

FRAME AND COVER DETAIL

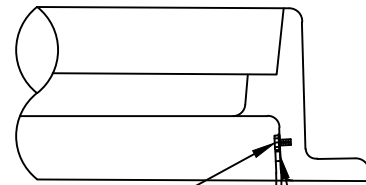

1/2" STAINLESS STEEL
(UNC) GROUND BOLT
FIELD DRILL AND TAP
27/64" HOLE

NON-INSULATED ONE
HOLE TIN PLATED
COPPER COMPRESSION
TERMINAL, UL LISTED
AND APPROVED FOR #4
AWG COPPER WIRE

BONDING WIRE

GROUND BOLT INSTALLATION DETAIL

PULL BOX 27"

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG

4021

8/10/2017

CITY ENGINEER

SHT 2 OF 3

NOTES:

ONE COAT OF WATER REPELLENT SEALER (SEE CITY OF COLUMBUS QUALIFIED PRODUCTS LIST) SHALL BE APPLIED TO THE INSIDE & OUTSIDE OF THE PULL BOX.

CONCRETE SHALL HAVE AIR ENTRAPMENT OF 6% ± 2% AND SHALL HAVE 4500 PSI STRENGTH AT 28 DAYS.

LID RING LOAD TRANSFER IS TO BE DISTRIBUTED BY USE OF A PREFORMED MASTIC JOINT MATERIAL.

CUT OFF CONDUITS SO THEY EXTEND NO MORE THAN THREE INCHES BEYOND THE INSIDE PULL BOX WALL AND PROVIDE BUSHINGS.

WHENEVER POSSIBLE, CONDUITS SHOULD ENTER THE PULL BOX VIA A KNOCKOUT. WHEN APPROVED BY THE DIVISION OF DESIGN AND CONSTRUCTION PERSONNEL, CONDUITS MAY ENTER THE PULL BOX THROUGH ITS WALL ONLY IF THE OPENING IS SAWN OR CORE DRILLED. CONDUITS SHALL NOT ENTER VIA THE BOTTOM OF THE PULL BOX WITHOUT APPROVAL BY THE DIVISION OF DESIGN AND CONSTRUCTION PERSONNEL. CONDUIT SHALL ENTER KNOCKOUT AS CLOSE TO 90° AS POSSIBLE.

THE WEDGE ANCHOR ASSEMBLY SHALL BE OMITTED WHENEVER THE ENTIRE AREA ABOVE THE KNOCKOUT (1/4 OF THE CASTING) IS EITHER ENCASED IN CONCRETE OR ASPHALT. THE ENCASEMENT SHALL BE CENTERED AROUND THE KNOCKOUT.

ENLARGING THE KNOCKOUT AREA IF REQUIRED SHALL BE DONE BY SAW CUTTING THE CONCRETE. NO OTHER METHOD IS ALLOWED. CONTRACTOR SHALL REPLACE THE CONCRETE HOUSING IF DAMAGED AT HIS EXPENSE.

AFTER THE CONDUITS HAVE BEEN INSTALLED, ANY OPENING IN THE PULL BOX WALL SHALL BE TOTALLY FILLED WITH MORTAR OR CONCRETE AND FINISHED FLUSH WITH THE INSIDE PULL BOX WALL. (NO VOIDS)

PULL BOX BEARING CAPACITY TO EXCEED 40,000 POUNDS.

ANY CONDUIT THAT EXITS A PULL BOX, AND DIRECTLY ENTERS ANY ELECTRONIC CABINET, SHALL BE DUCT SEALED IN THE PULL BOX.

THE CONTRACTOR SHALL INSTALL NON-ORGANIC FIBERGLASS PULL TAPE WITH A MINIMUM 1800 FT./LBS TENSION STRENGTH IN CONDUIT TO FACILITATE CABLE PLACEMENT.

ALL UNUSED CONDUITS SHALL BE CAPPED AND THE CAPS SECURED TO THE CONDUITS WITH TAPE.

PULL BOX 27"

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG
4021



CITY ENGINEER

8/10/2017

SHT 3 OF 3