


NOTES:

1. IF THE TOP OF THE SUBGRADE IS BELOW THE BOTTOM OF THE CURB, THE UNDERDRAIN SHALL BE ADJUSTED TO KEEP THE TOP OF THE UNDERDRAIN AT LEAST 8" BELOW THE TOP OF THE SUBGRADE; AGGREGATE DEPTH BETWEEN BOTTOM OF CURB AND TOP OF UNDERDRAIN MAY VARY IF THIS OCCURS.
2. SUBGRADE COMPACTION SHALL BE COMPLETED BEFORE UNDERDRAIN INSTALLATION.
3. WHEN A CURB AND GUTTER INLET IS INSTALLED, THE TOP OF THE CASTING SHALL BE THE SAME AS THE TOP OF CURB ELEVATION. THE CASTING SHALL BE A SQUARE BACK CASTING PER CITY DIVISION OF SEWER & DRAINS STANDARD DRAWING AA-S128. THE EDGE OF PAVEMENT ELEVATION SHALL BE 3/8" HIGHER THAN THE GRATE WHEREVER THEY MEET.
4. CURB SHALL BE IN NOMINAL LENGTHS OF 11 FT. FOR CLOSURE & FILL IN, THE MINIMUM CURB LENGTH ALLOWED IS 3 FT.
5. FOR REPLACEMENT WORK, THE CURB SHALL BE REMOVED AT AN EXISTING JOINT AND USE MINIMUM 36" LENGTHS.
6. PLANS TO SPECIFY GRANITE MATERIAL AND TYPE OF SURFACE FINISH.
7. 1/2" EXPANSION MATERIAL WILL BE INSTALLED BEHIND THE CURB WHEN A CONCRETE WALK, DRIVE, OR OTHER CONCRETE ITEM IS ADJOINING IT.
8. REMOVE ANY CONCRETE BEYOND FACE-OF-CURB TO PROVIDE FULL DEPTH PAVEMENT SECTION.
9. GRANITE CURB SHALL BE FIELD CUT AT CURB RAMPS TO ALLOW FOR FIELD ADJUSTMENTS AS DIRECTED BY THE PROJECT ENGINEER.
10. UNDERDRAIN IS NOT REQUIRED WHEN CURB IS ALONG CONCRETE MEDIAN.

<h1 style="margin: 0;">CURB GRANITE</h1>	
CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC SERVICE DIVISION OF DESIGN AND CONSTRUCTION	STD DWG 2005
 CITY ENGINEER	3/30/2018 SHT 1 OF 2

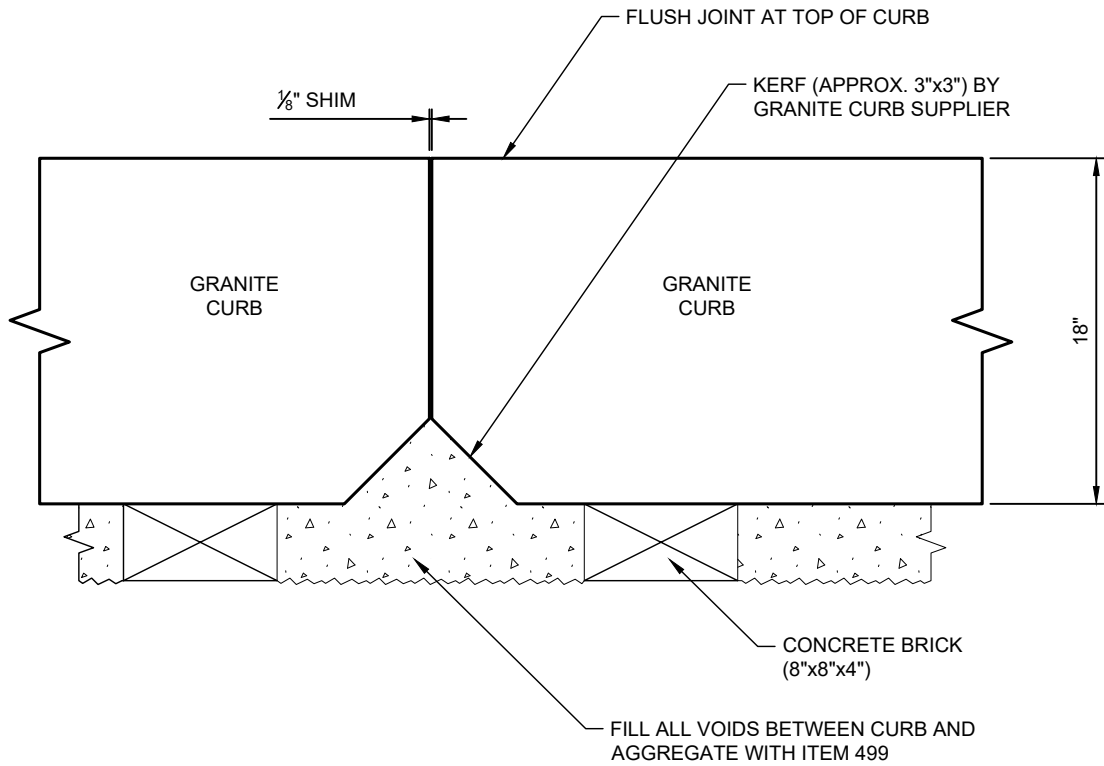

ELEVATION

CURB GRANITE

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG
2005

3/30/2018

SHT 2 OF 2