



PLAN (COVER SLAB REMOVED)

REINFORCING STEEL DETAIL

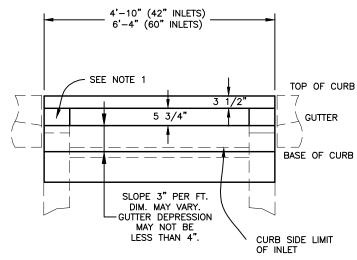

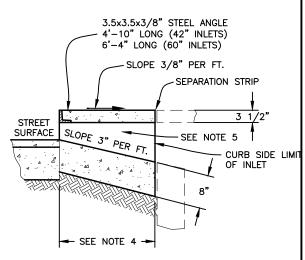

ELEVATION SECTION A-A

NOTES:

SSES MANAGER

- IN BRICK WALL CONSTRUCTION, SUITABLE CONCRETE OR STONE BLOCKS NOT LESS THAN 8"x8"x16" IN SIZE SHALL BE USED AT CORNERS ABUTTING CURB.
- IN EXISTING PAVEMENTS ON AREAS APPROX. 12'x4' FOR 60" INLETS, AND 10'x4' FOR 42" INLETS, OR AS OTHERWISE ORDERED SHALL BE CUT OUT SO THAT REPAVING MAY BE SHAPED TO MEET THE DEPRESSED LIP OF THE INLET OPENING AS DIRECTED.
- FOR ANCHORS USE 6"x3/8" BOLTS OR #3 REBAR 10" LONG WITH 2" 90" BENDS WITH ONE END WELDED TO INSIDE FACE OF ANGLE IN APPROVED MANNER WITH A MIN. 1 1/4" COVER.
- 4. THIS DIMENSION TO BE AS SPECIFIED ON PLANS.
- 5. END WALLS TO BE BRICK OR CONCRETE.

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF SEWERAGE & DRAINAGE

CURB OPENING EXTENSION FOR 42' OR 60' CURB INLETS STANDARD DRAWING AA-S124

REVISED 7/9/12

PAGE 1

John I Newsone