


Type A Basin: Plan View

No Scale

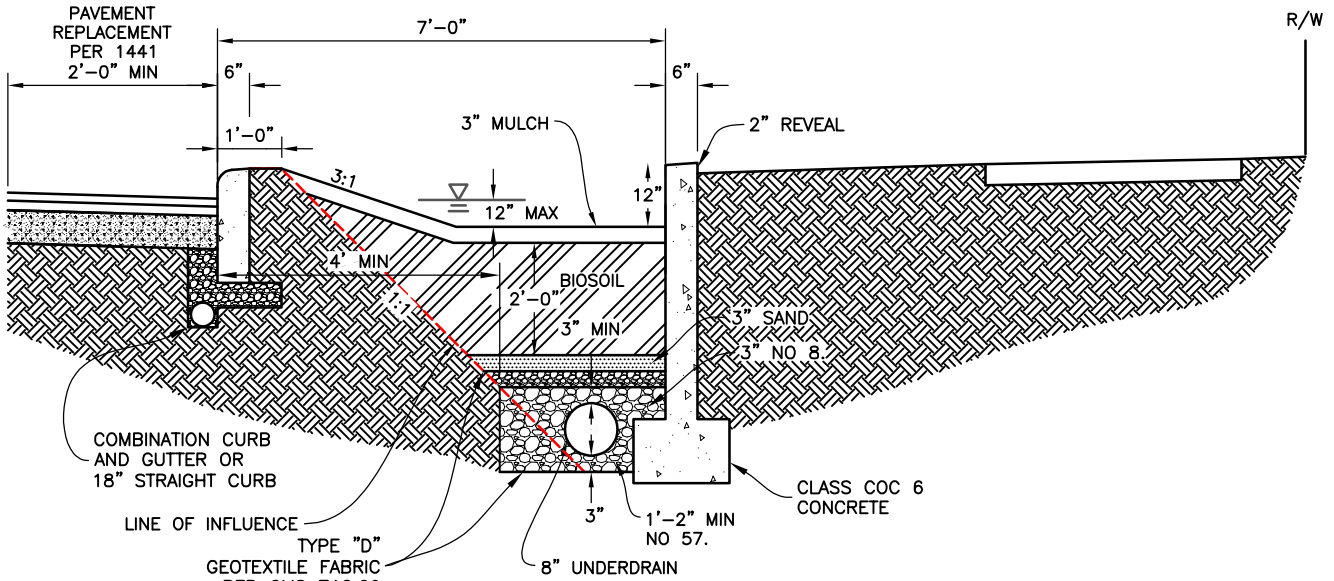

Type A Basin: Section A-A

No Scale

NOTES

- 1) OUTLET AND/OR OVERFLOW CONTROLS ARE GENERALLY ONLY NEEDED AT SAGS OR IN FACILITIES THAT REQUIRE A MINIMUM DRAW DOWN TIME. IF CONTROL IS NOT NECESSARY, A CLEAN OUT SHALL BE INSTALLED.
- 2) PRECAST WALLS SHALL BE IN ACCORDANCE WITH ASTM C-913 UNLESS DETAILED DESIGNS ARE PROVIDED WITHIN THE CONSTRUCTION DOCUMENTS.
- 3) SMOOTH DRAINAGE NOTCHES TO BE INSTALLED ON THE REAR WALL AT BASIN CORNERS AND ON 20' SPACING.

CITY OF COLUMBUS, OHIO
 DEPARTMENT OF PUBLIC UTILITIES
 DIVISION OF SEWERAGE & DRAINAGE

BUMP OUT BASIN WITH
 REAR WALL CONTINUOUS
 CURB

STANDARD DRAWING
 AA-S182

REVISED 8/19/22

APPROVED:

[Signature]

SSES MANAGER

8/26/22

DATE

PAGE

1

1