


Type C Basin: Plan View

No Scale

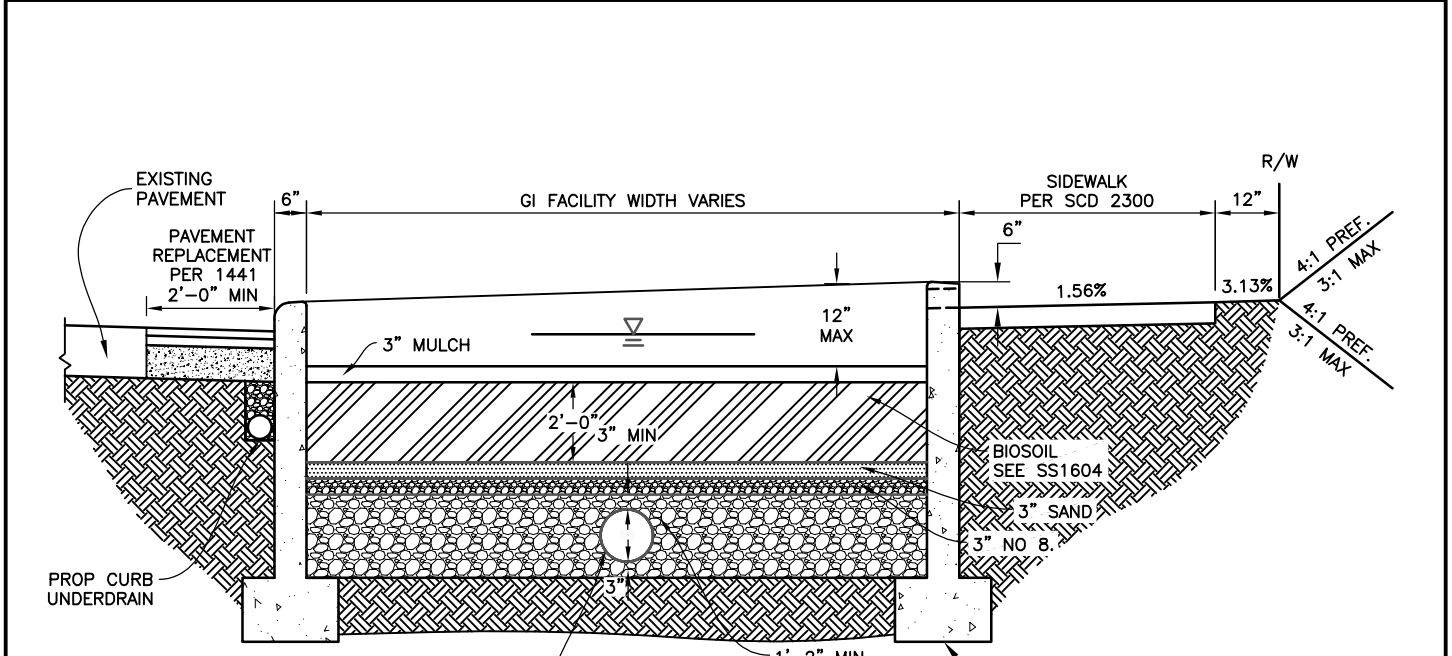

Type C Basin: Profile View

No Scale

- NOTES:**
1. IF EXISTING WALKS ARE PRESENT THE NEW WALK SHALL BE IMMEDIATELY ADJACENT TO THE REAR WALL.
 2. THE INTERIOR WALL EXPOSED FACES SHALL BE STAMPED CONCRETE.
 3. PRECAST WALLS/BOXES SHALL BE IN ACCORDANCE WITH ASTM-C913 UNLESS DETAILED DESIGNS ARE PROVIDED WITHIN THE CONSTRUCTION DOCUMENTS.
 3. DRAINAGE NOTCHES/HOLES TO BE INSTALLED AT BASIN CORNERS AND ON 20' SPACING WHEN BASIN IS ADJACENT TO SIDEWALK

4. OUTLET AND/OR OVERFLOW CONTROLS ARE GENERALLY ONLY NEEDED AT SAGS OR IN FACILITIES THAT REQUIRE A MINIMUM DRAW DOWN TIME. IF CONTROL IS NOT NECESSARY, A CLEAN OUT SHALL BE INSTALLED.

CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC UTILITIES DIVISION OF SEWERAGE & DRAINAGE		BUMP OUT/BUMP IN WITH TWO WALLS NOT CONTINUOUS WITH CURB	STANDARD DRAWING AA-S184	
APPROVED: <i>[Signature]</i>	8/26/22		REVISED 8/19/22	
SSS MANAGER	DATE	PAGE 1		