


TYPE "B": Long Side Bend to Tee.

TYPE "B" MODIFIED: Short Side Bend to Tee.

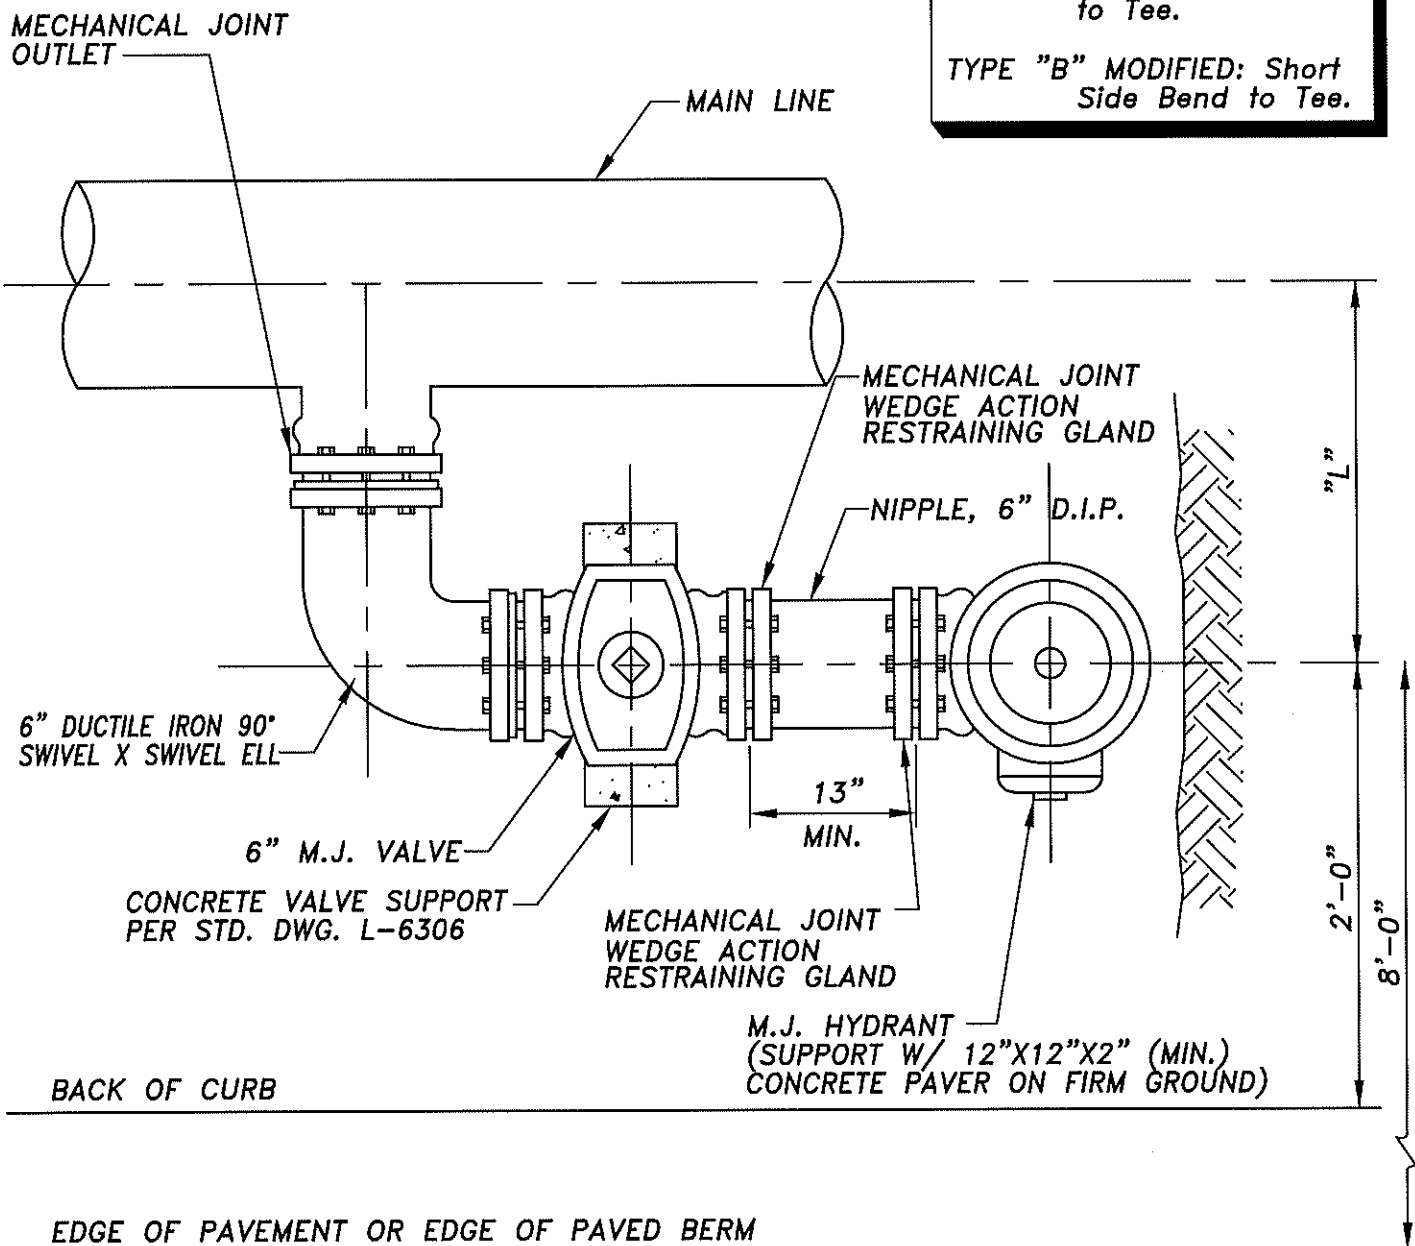

**NOTES:**

1. FIRE HYDRANT SHALL HAVE A MAXIMUM BURY OF 7'-0". MODIFICATION OF THE HYDRANT LEAD TO MEET THIS REQUIREMENT SHALL BE IN THAT SECTION FROM THE VALVE TO THE HYDRANT AS PER STANDARD DETAIL L-7601.
2. FIRE HYDRANTS SHALL BE SET A MINIMUM OF 6' FROM RESIDENTIAL DRIVEWAY OPENINGS, AND 10' FROM COMMERCIAL DRIVEWAY OPENINGS.
3. WEDGE TYPE BELL RESTRAINT HARNESS TO BE USED IF JOINT IS NEEDED IN HYDRANT LEAD.

MAIN LINE	DIMENSION "L"	
	TYPE "B"	TYPE "B" MOD.
20"	33"	28"
24"	36"	31"
30"	39"	34"
36"	43"	38"
42"	46"	41"
48"	49"	44"

CITY OF COLUMBUS  
DEPARTMENT OF PUBLIC UTILITIES  
DIVISION OF WATER

APPROVED:

*B. B. Bunnell*  
ADMINISTRATOR

7/21/22  
DATE

STANDARD DETAIL  
**TYPICAL HYDRANT SETTING**  
TYPE "B" AND "B" MODIFIED  
FOR CONCRETE AND STEEL PIPE

