


This meter setting is only allowed with prior approval from the City of Columbus, Division of Water.

Approved for use by: _____ Date: _____

Premise No.: _____ Address: _____

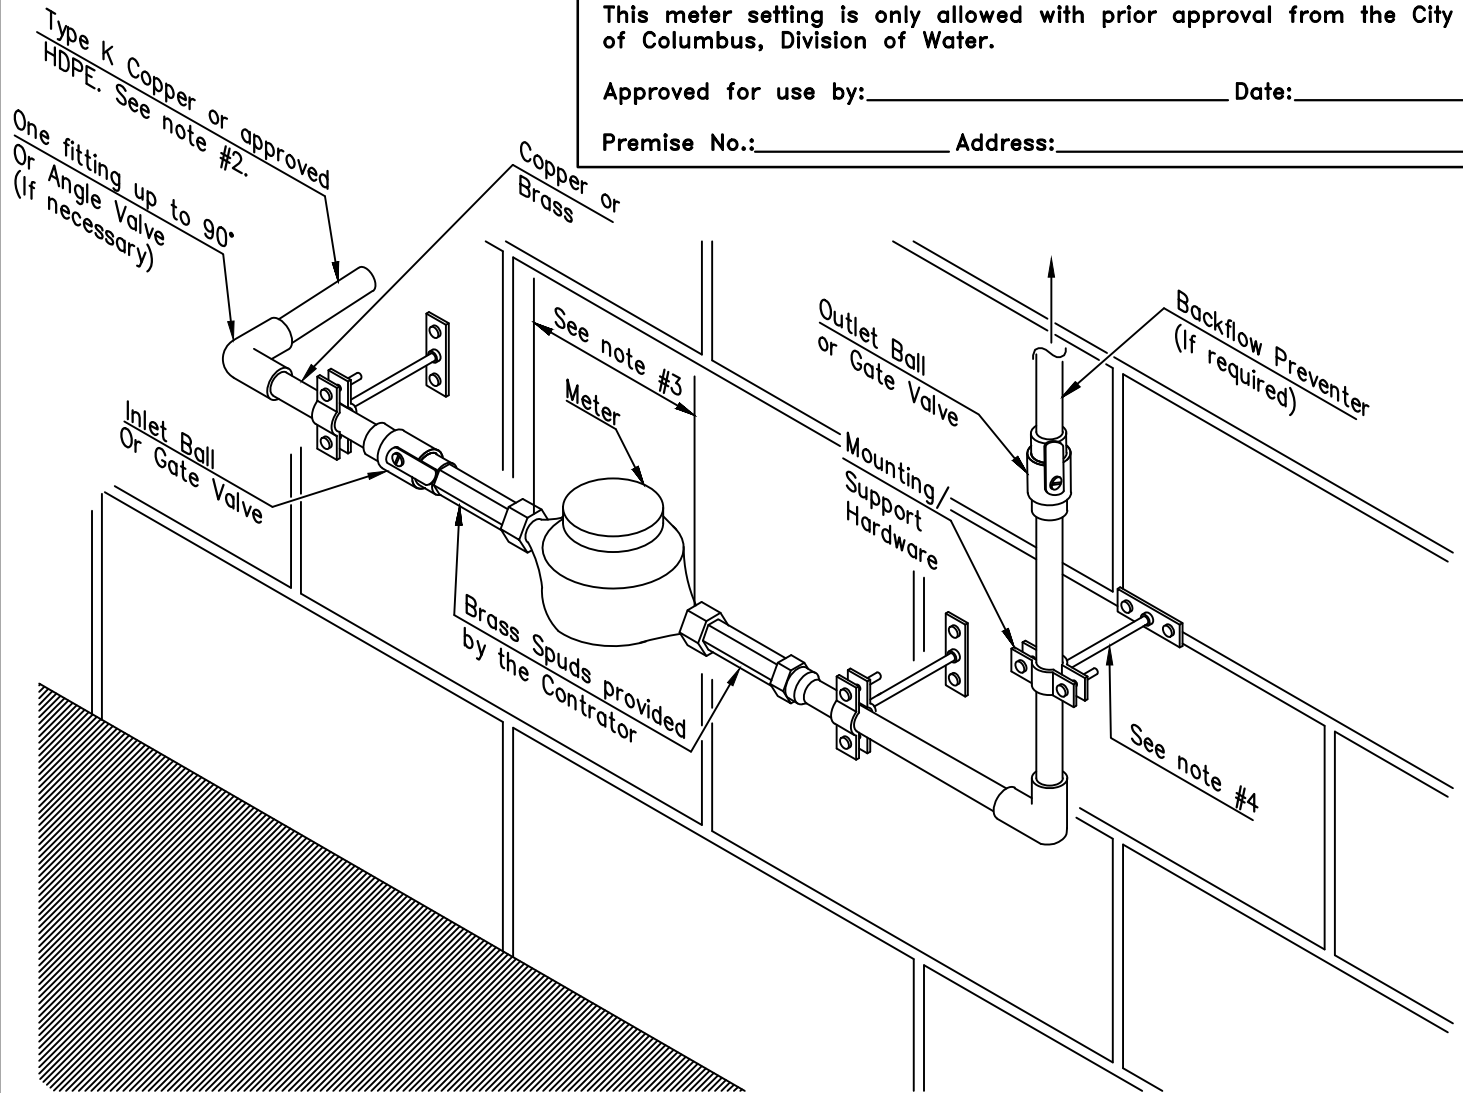

NOTES:

1. METER IS TO BE MOUNTED HORIZONTALLY 1 TO 4 FEET ABOVE FLOOR. PRE-EXISTING SERVICES CAN HAVE THE ELEVATION REMAIN AS-IS.
2. THE SERVICE LINE MAY BE OF GALVANIZED STEEL MATERIAL IF EXISTING AND IT IS NOT BEING REPLACED.
3. DIVISION OF WATER STANDARD METER LENGTHS ARE THE FOLLOWING:

METER SIZE	METER LAY LENGTH
5/8"	7.5"
5/8" x 3/4"	7.5"
3/4"	9"
1"	10.75"

4. SETTING MUST HAVE SUFFICIENT PERMANENT SUPPORTS FOR THE METER.

L-8504.Dwg Revision Date: 4/6/22

CITY OF COLUMBUS
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

STANDARD DETAIL
INTERIOR METER SETTING FOR WATER METERS
5/8-in TO 1-in SERVICE LINE SIZE

