



City of Columbus
Mayor Dana G. Rinehart

Public Utilities and Aviation Department

G. Raymond Lorello, Director

RULE AND REGULATION NO. 91-1
Division of Water
Department of Public Utilities and Aviation


DATE: March 22, 1991

SUBJECT: WATER SERVICE SIZING FOR RESIDENTIAL UNITS

Effective immediately, new water service connections for residential buildings will comply with the following minimum size requirements.

- Single family unit - 3/4" minimum service
- Two (2) family units - 1" minimum service
- Three (3) thru six (6) family units - 1-1/2" minimum service
- Seven (7) thru twelve (12) family units - 2" minimum service

This is necessary to ensure proper residual pressures under maximum usage conditions. In special situations where: system pressures are lower than the average system pressure; service lengths are longer than normally anticipated; or anticipated usage is higher than normal it may be necessary to use service sizes larger than the minimums set forth.

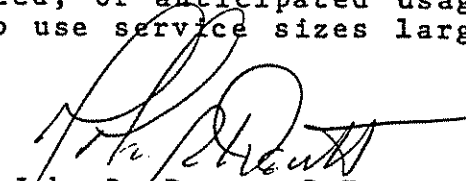

John R. Douth, P.E.
Administrator
Division of Water

APPROVED: 
G. Raymond Lorello, Director *3/25/91*
Public Utilities and Aviation

published in City Bulletin 4/6/91

Utilities Complex
910 Dublin Road, Columbus, Ohio 43215-1116

Director's Office 614/645-8141
Electricity Division 614/645-8371
Sewerage and Drainage Division 614/645-7175
Water Division 614/645-7020
FAX 614/645-3801

Municipal Electric Plant
2500 Jackson Pike
Columbus, Ohio 43223

614/645-3147
FAX 614/645-3654

Airports Division
Port Columbus International Airport 614/239-4000
FAX 614/239-4066

4600 International Gateway
Columbus, Ohio 43219

Bolton Field Airport 614/645-3634
2000 Norton Road, Columbus, Ohio 43228