

# Water Service Plan Inspection Responsibility


Revised 7/14/2025

M - Meter


B - Backflow

## DOMESTIC SERVICE


Meter inside building  
with backflow  
preventer

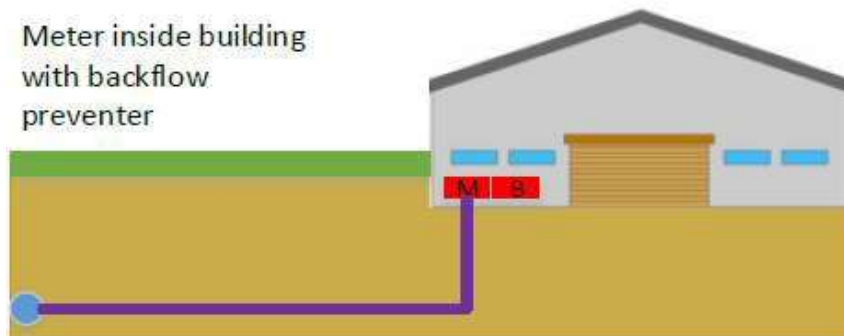

Meter in vault,  
backflow preventer in  
heated enclosure

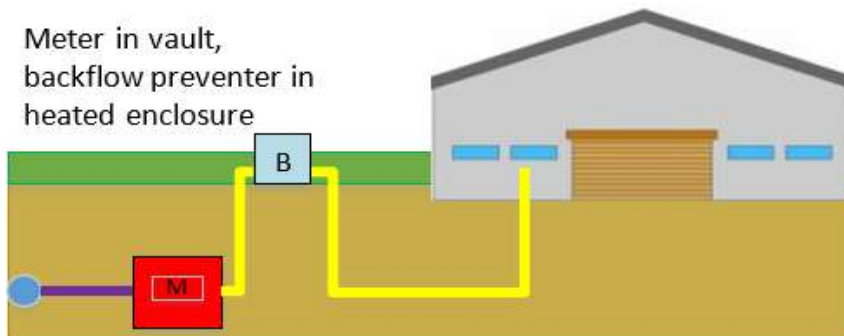

Meter in vault, backflow  
preventer inside building

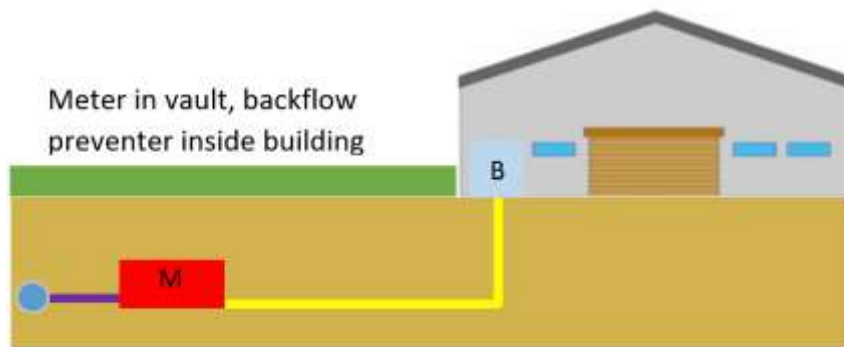


## Inspected by (Department):


- Permits Department – (614) 645-7330
- Commercial Metering Group – (614) 645-8119
- Building & Zoning Department – (614) 645-8355
- Backflow Compliance Office – (614) 645-6674

## FIRE SERVICE

RPDA or DCDA inside  
building

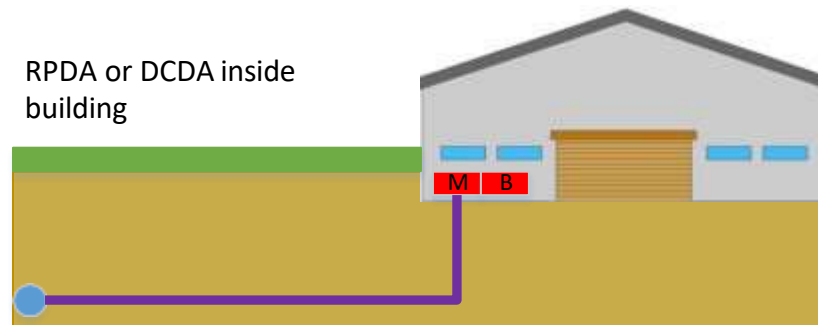

DCDA in vault

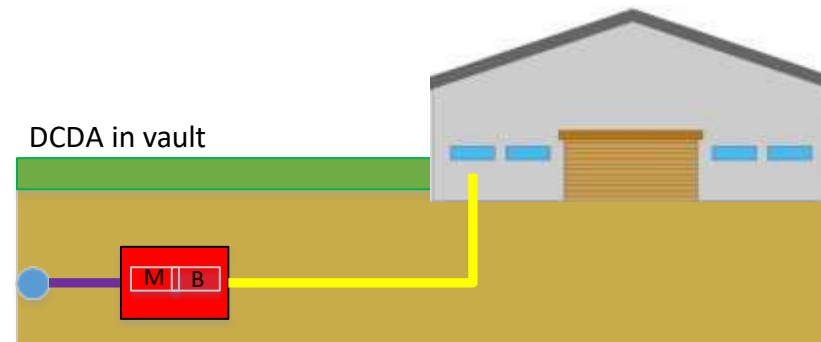

RPDA or DCDA in  
heated enclosure

