



FOR FIRE AND/OR DOMESTIC SERVICE  
CONTINUE WITH D.I.P OR SWITCH TO  
PIPE MATERIAL MEETING REQUIREMENTS  
OF LOCAL BUILDING AUTHORITY,  
CHANGE SIZE IF APPLICABLE

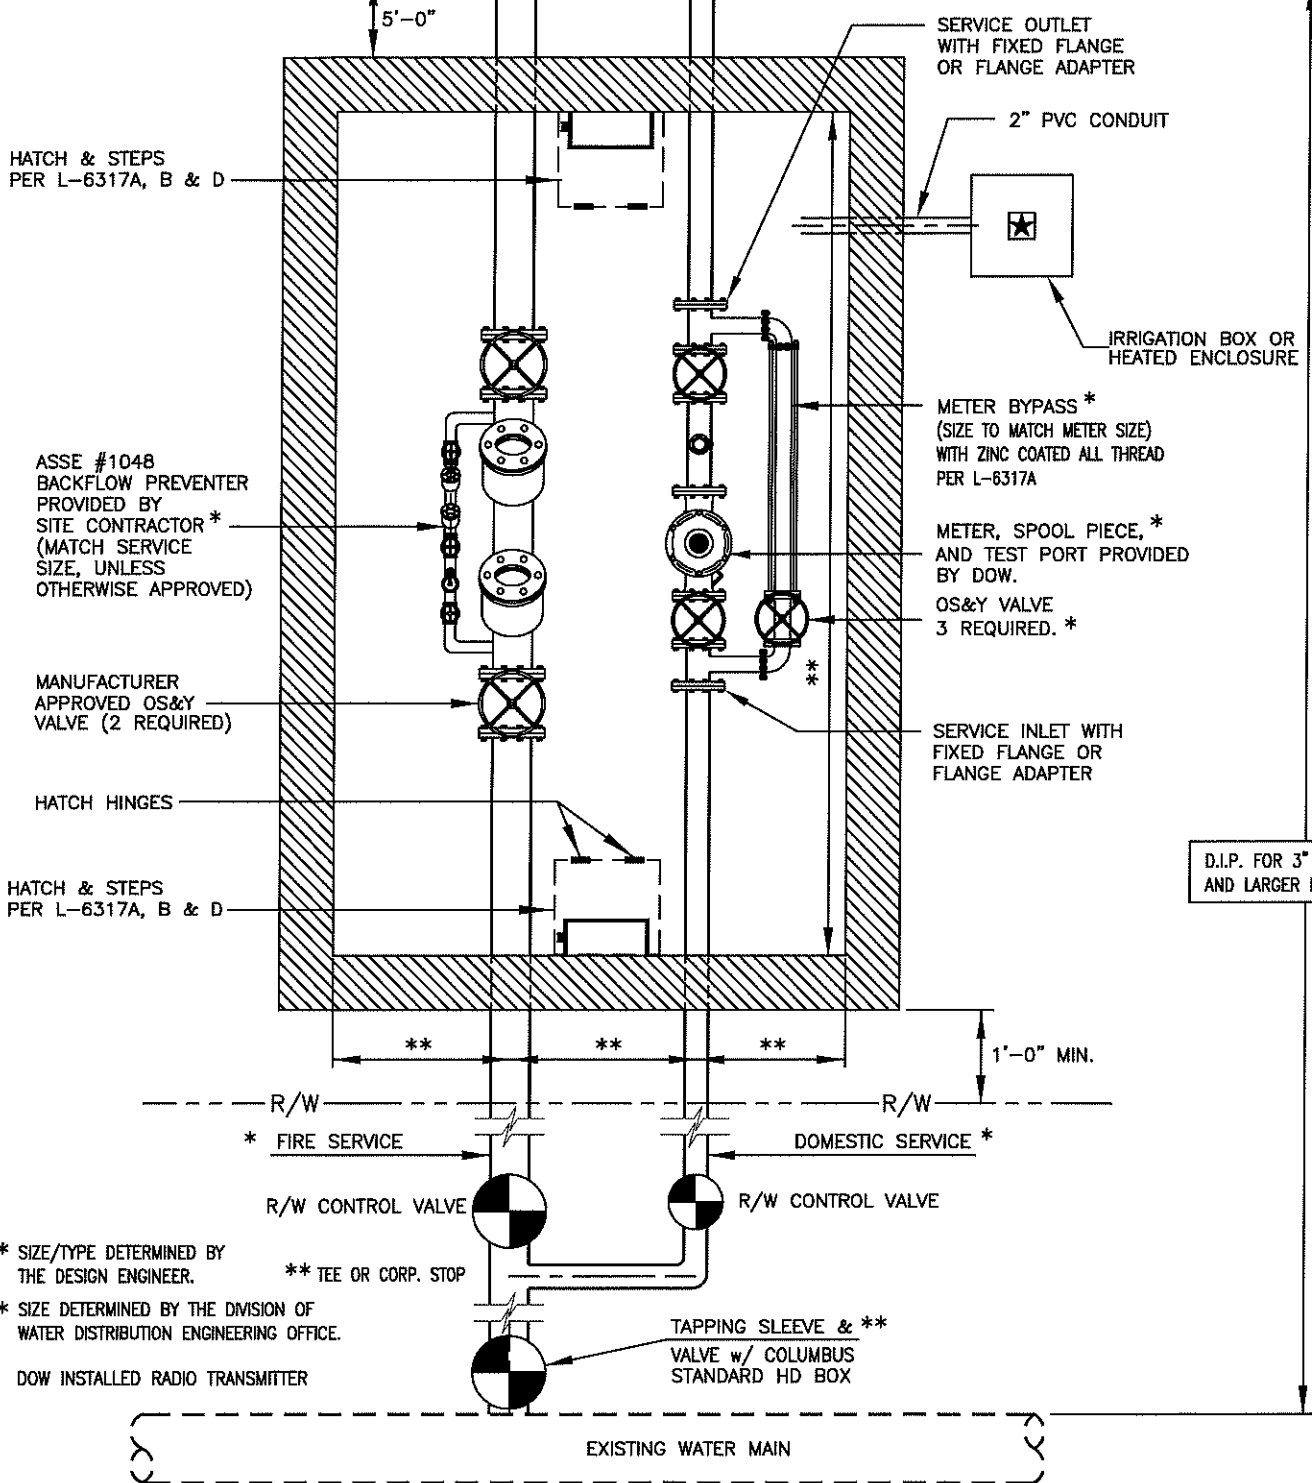

SEE DETAILS L-6317A, L-6317B AND L-6317D FOR VAULT DETAILS NOT SHOWN ON THIS DETAIL.

CITY OF COLUMBUS  
DEPARTMENT OF PUBLIC UTILITIES  
DIVISION OF WATER

STANDARD DETAIL



APPROVED:

*John A. W...*  
ADMINISTRATOR

11-17-23  
DATE

DUAL METER SETTING  
3" THRU 12" METERS