


SLAB METER SET

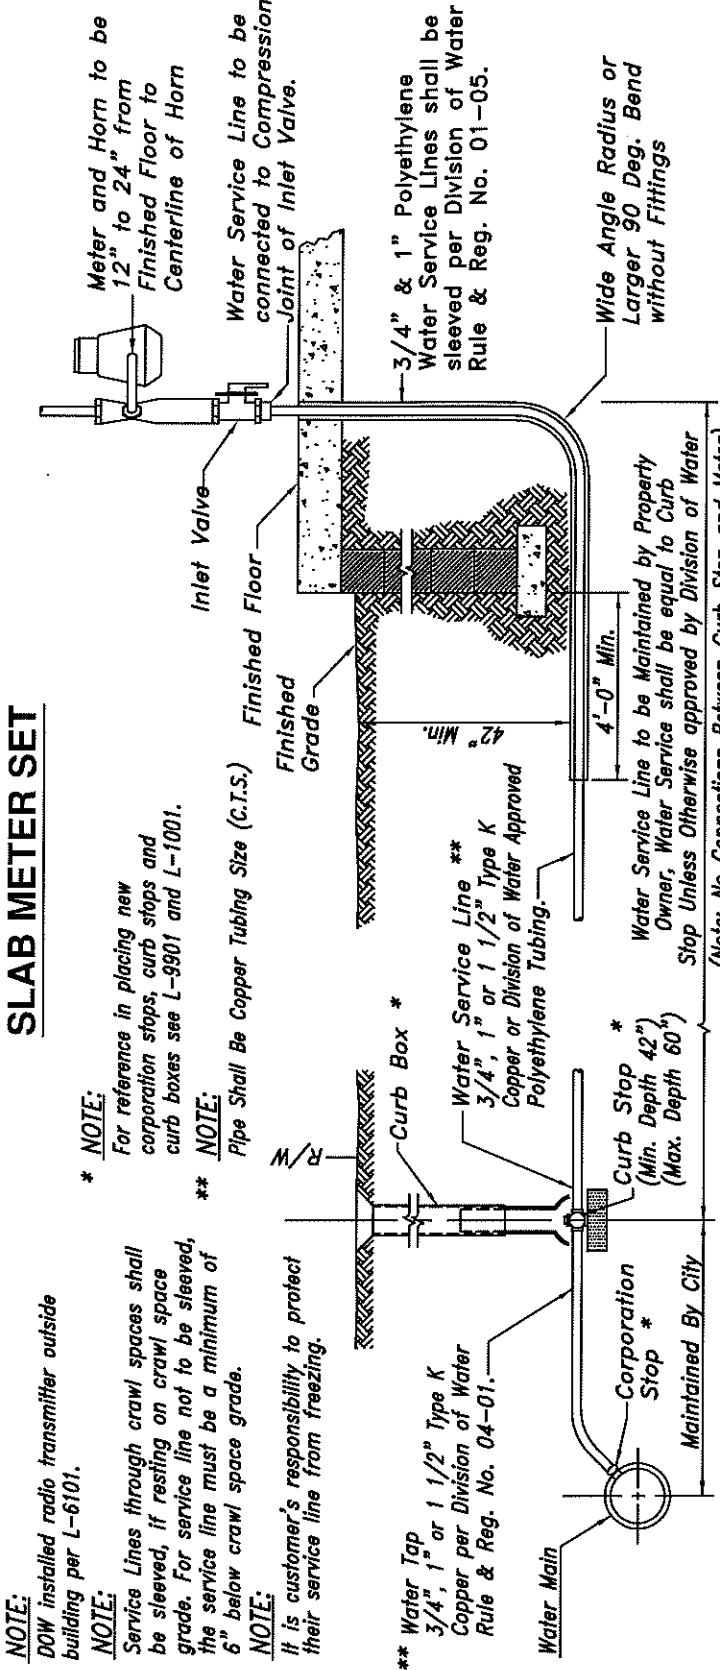

*** NOTE:**
For reference in placing new corporation stops, curb stops and curb boxes see L-9901 and L-1001.

**** NOTE:**
Pipe Shall Be Copper Tubing Size (C.T.S.)

*** NOTE:**
Service Lines through crawl spaces shall be sleeved, if resting on crawl space grade. For service line not to be sleeved, the service line must be a minimum of 6" below crawl space grade.

NOTE:
It is customer's responsibility to protect their service line from freezing.


* NOTE:

For reference in placing new corporation stops, curb stops and curb boxes see L-9901 and L-1001.

** NOTE:

Pipe Shall Be Copper Tubing Size (C.T.S.)

BASEMENT METER SET

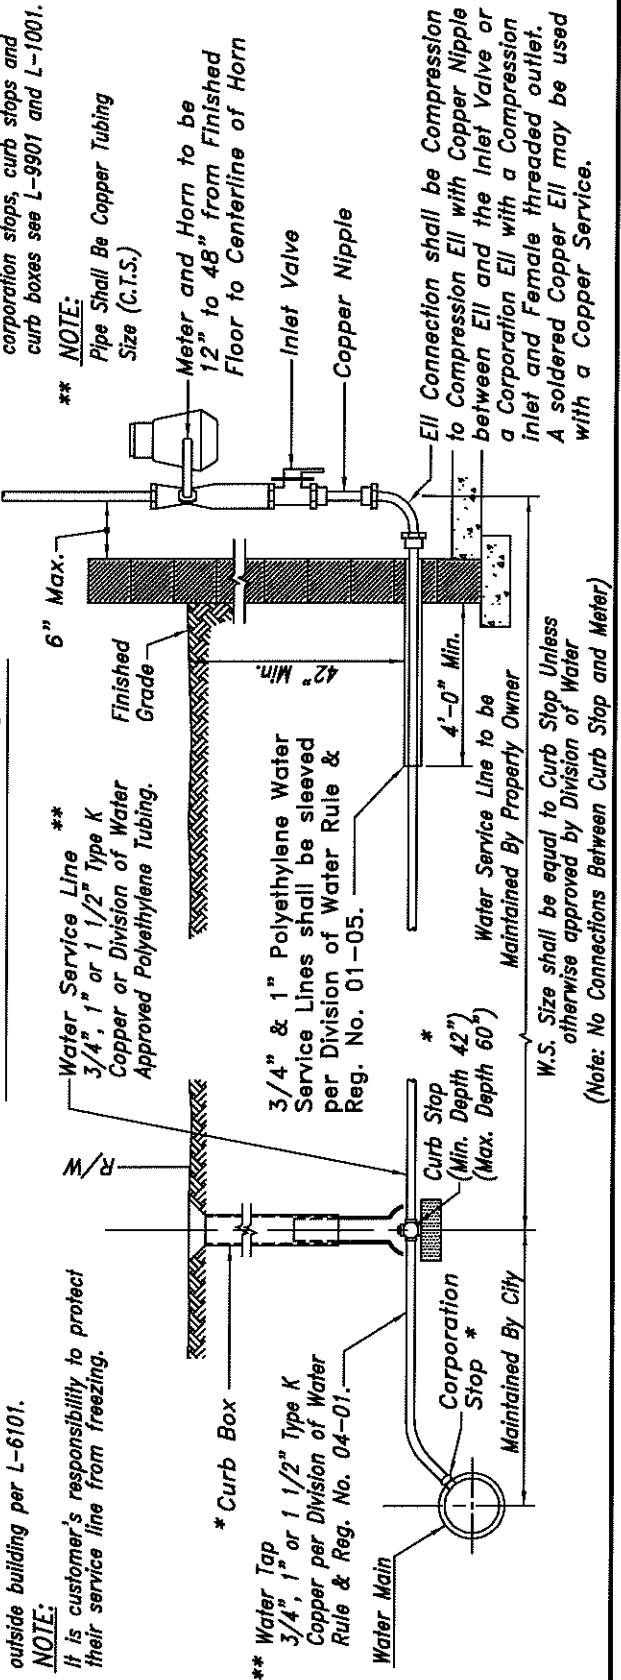

* NOTE:

DOW installed radio transmitter outside building per L-6101.

NOTE:

It is customer's responsibility to protect their service line from freezing.

** NOTE:

Water Tap 3/4", 1" or 1 1/2" Type K Copper per Division of Water Rule & Reg. No. 04-01.

W.S. Size shall be equal to Curb Stop Unless otherwise approved by Division of Water (Note: No Connections Between Curb Stop and Meter)

CITY OF COLUMBUS
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

APPROVED: *[Signature]*
ADMINISTRATOR

DATE: 11-17-23

STANDARD DETAIL
METER INSTALLATION IN BUILDING
5/8" THRU 1" METERS

