
NOV. 2019

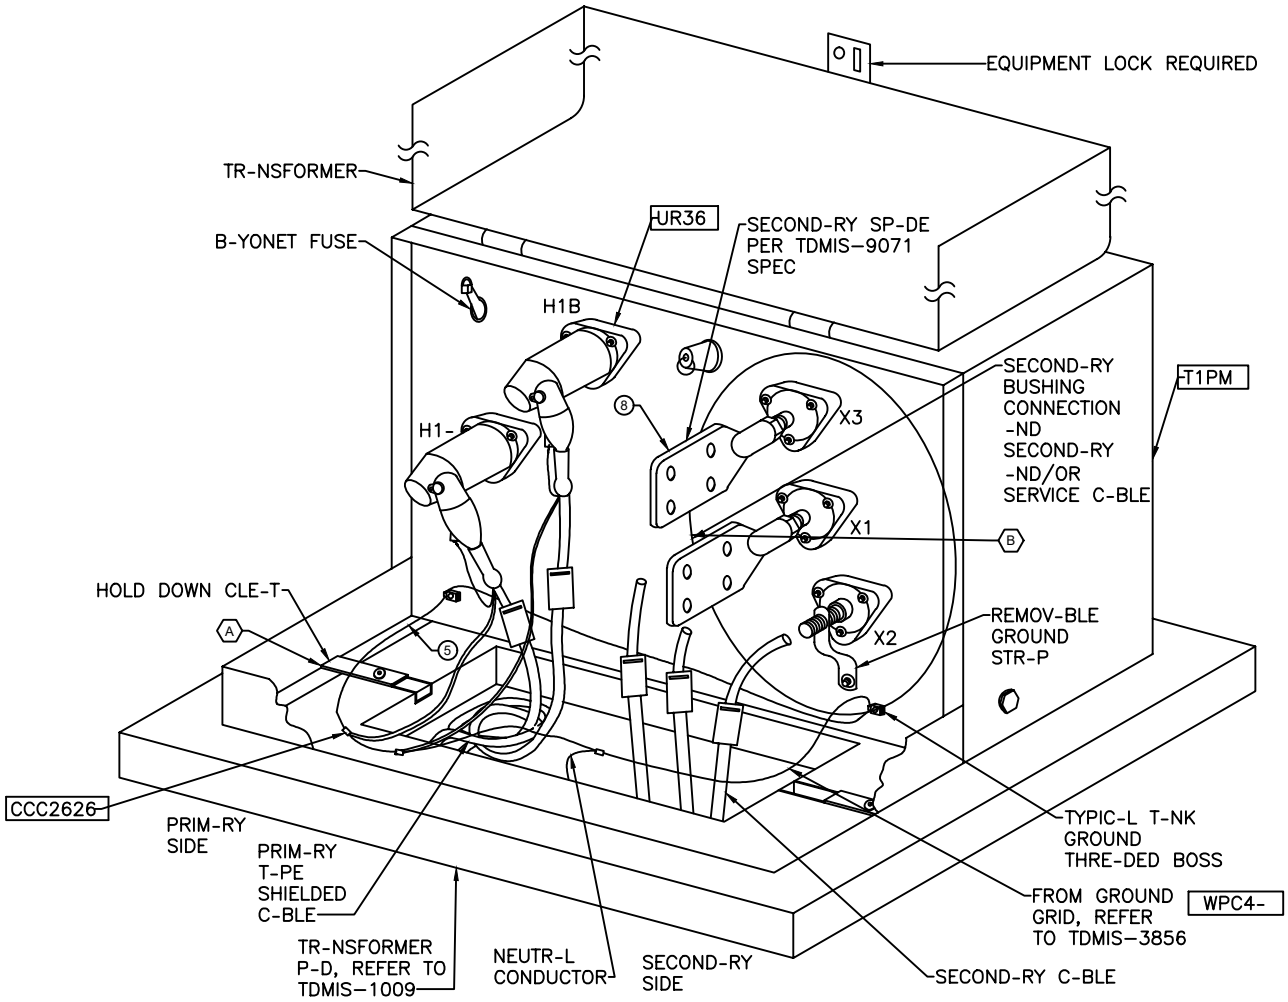

CODED NOTES:

(A) BOLT TR-NSFORMER ON E-CH SIDE OF P-D WITH M-NUF-CTURER SUPPLIED HOLD-DOWN CLE-T.

(B) SECOND-RY -ND/OR SERVICE C-BLES TO BE INST-LLED NEXT TO TR-NSFORMER SO THEY DO NOT INTERFERE WITH THE MOVEMENT OF THE PRIM-RY C-BLES.

SECONDARY SPADE SIZE TABLE	
# OF HOLES	TR-NSFORMER SIZE
4 MIN.	0-167 KV-
6 MIN.	167-250 KV-
8 MIN.	250-333 KV-

COMPATIBLE UNIT: TDMIS-3731.

TDMIS ID	MATERIAL	QTY	QTY	QTY	QTY
T1PM	SINGLE PH-SE TR-NSFORMER, SEE TDMIS-9071	1			
UR36	BUSHING WELL INSERT	2			
CCC2626	CONNECTOR, COMPRESSION TYPE, COPPER, 2/0 - G TO 2/0 - G T-P	3			
WPC4-	CONDUCTOR, COPPER, 2/0 - G, 19 STR-ND (FEET)	6			

THE CITY OF COLUMBUS
DEPT. OF PUBLIC UTILITIES
DIVISION OF POWER

SINGLE PHASE DEAD-FRONT PAD-MOUNTED TRANSFORMER

TDMIS-3731