NOV. 2019

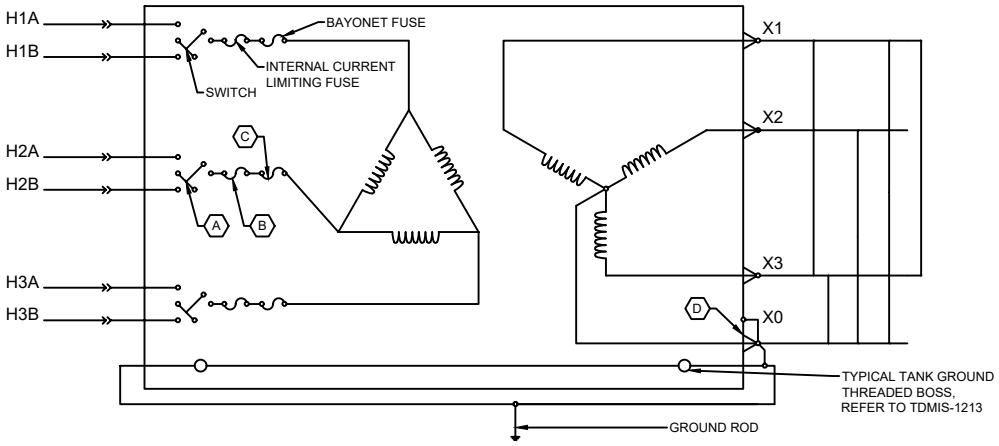
CODED NOTES:

(A) "T" BLADE SWITCH, TYP., SEE TABLE 1.


(B) NOT REPLACEABLE BY FIELD PERSONNEL.

(C) BAYONET TYPE, LOAD-BREAK FUSEHOLDER.





(D) GROUND STRAP IS NOT REQUIRED IF THE X0 TERMINAL IS A SPADE WELDED DIRECTLY TO THE TANK.



TDMIS 3742.A
120/208 VOLT 4 WIRE SERVICE

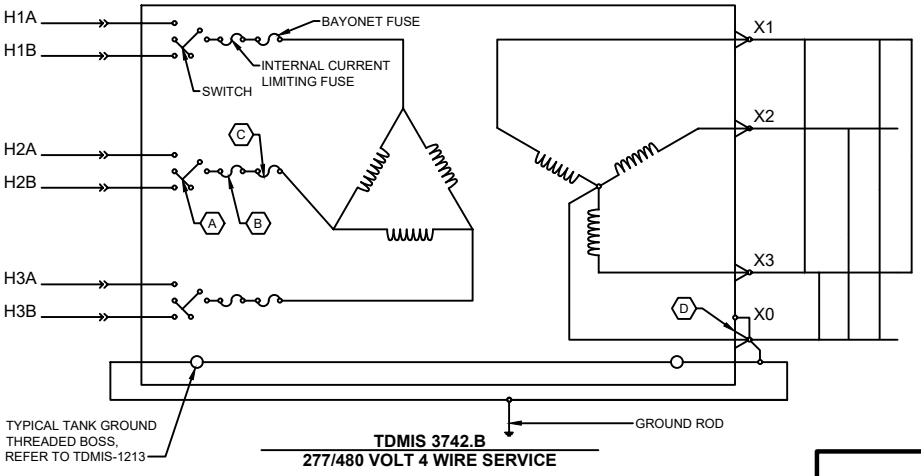

TDMIS 3742.B
277/480 VOLT 4 WIRE SERVICE

T-BL-DE SWITCH POSITION				
	POINTER DIRECTION			
	LEFT	RIGHT	UP	DOWN
SOURCE OF POWER FOR TR-NSFORMER	LINE -	LINE B	LINE - -ND LINE B	TR-NSFORMER OPEN LINE - -ND LINE B CONNECTED
CIRCUIT CONNNECTION				

LEGEND	
	BUSHING
	ELBOW
	INSUL-TING C-P
	P-RKING BUSHING
	FEED THRU C-N BE 2, 3, OR 4 OUTLETS
E-	ELBOW -RRESTER
S-	OVERHE-D -RRESTER

THE CITY OF COLUMBUS
DEPT. OF PUBLIC UTILITIES
DIVISION OF POWER

THREE PHASE PADMOUNT TRANSFORMER
STANDARD CONNECTION

TDMIS-3742