

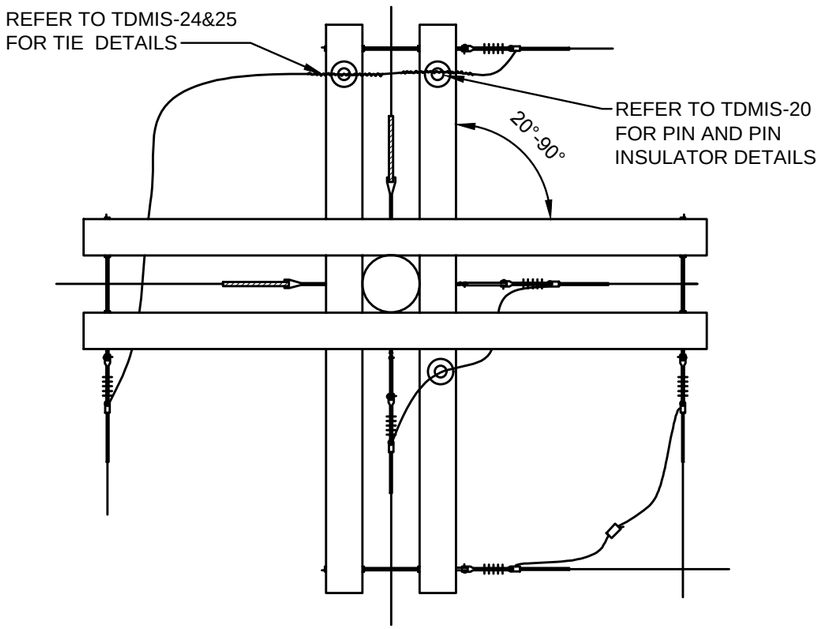



**DETAIL 1**
**PLAN VIEW**

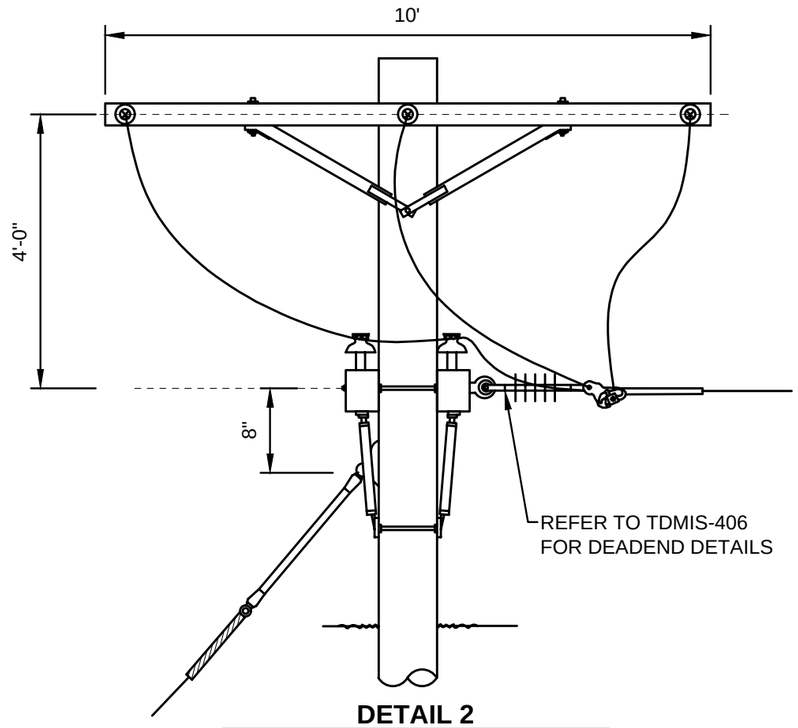


**DETAIL 2**
**FRONT VIEW**

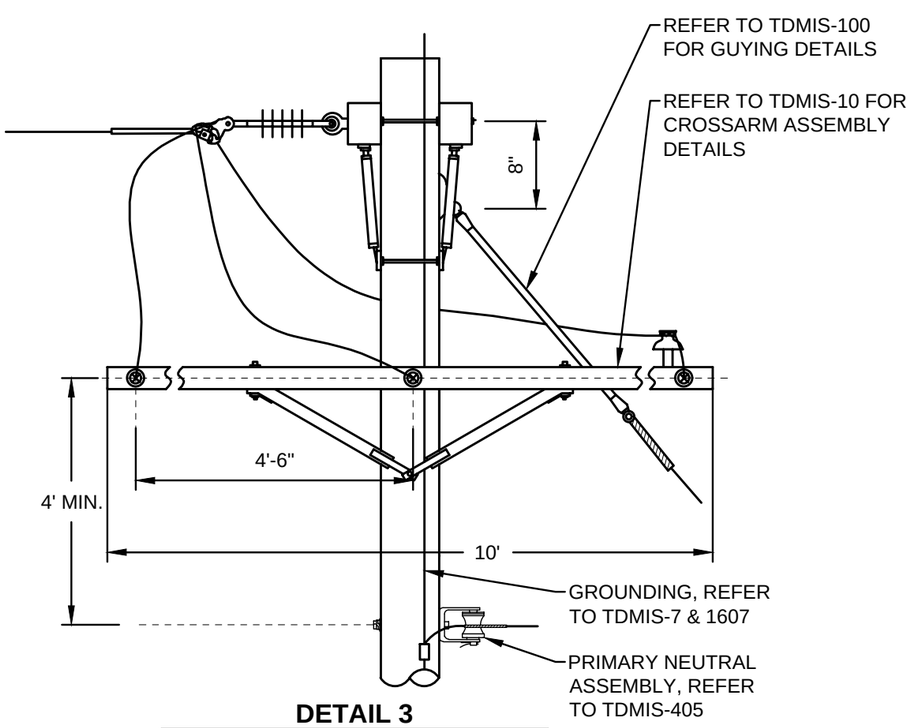


**DETAIL 3**
**SIDE VIEW**

GENERAL NOTES:

1. THE CITY WILL PAY FOR ALL WORK INSTALLED AS SPECIFIED IN THIS DRAWING ACCORDING TO THE APPROPRIATE CONTRACT ITEMS FOR EACH COMPONENT OF THE WORK.

## REFERENCE LIST

| TDMIS | DESCRIPTION |
|---|---|
| 1 | WOOD POLES |
| 7 | OVERHEAD DISTRIBUTION CIRCUIT GROUNDING |
| 10 | WOOD CROSSARM - WOOD BRACES |
| 11 | WOOD CROSSARM - STEEL BRACES |
| 20 | PIN AND PIN INSULATOR |
| 24 | COPPER CONDUCTOR HAND-MADE INSULATOR TIES |
| 25 | ALUMINUM CONDUCTOR HAND-MADE INSULATOR TIES |
| 100 | SINGLE DOWN GUY & ANCHOR WITH INSULATOR |
| 405 | PRIMARY NEUTRAL ASSEMBLY |
| 406 | DEADEND ASSEMBLIES |
| 1607 | GROUND ROD TEST |

THIS DRAWING IS FOR REFERENCE ONLY

CITY OF COLUMBUS, OHIO
DEPT. OF PUBLIC UTILITIES - DIVISION OF POWER

# TWO WAY BUCK
# THREE PHASE CONSTRUCTION, 20°-90°

| | | |
|---|---|---|
| DRAWN BY: AEC | DATE: 01/01/2018 | TDMIS-410 |
| APPROVED: R. SPRITE | | |
| SCALE: NTS | SHEET: 1 OF 1 | |