
CODED NOTES:

(A) -LUMINUM BUS B-R IS ONLY REQUIRED WHEN MORE TH-N FOUR TERMIN-L LUG -RE USED.

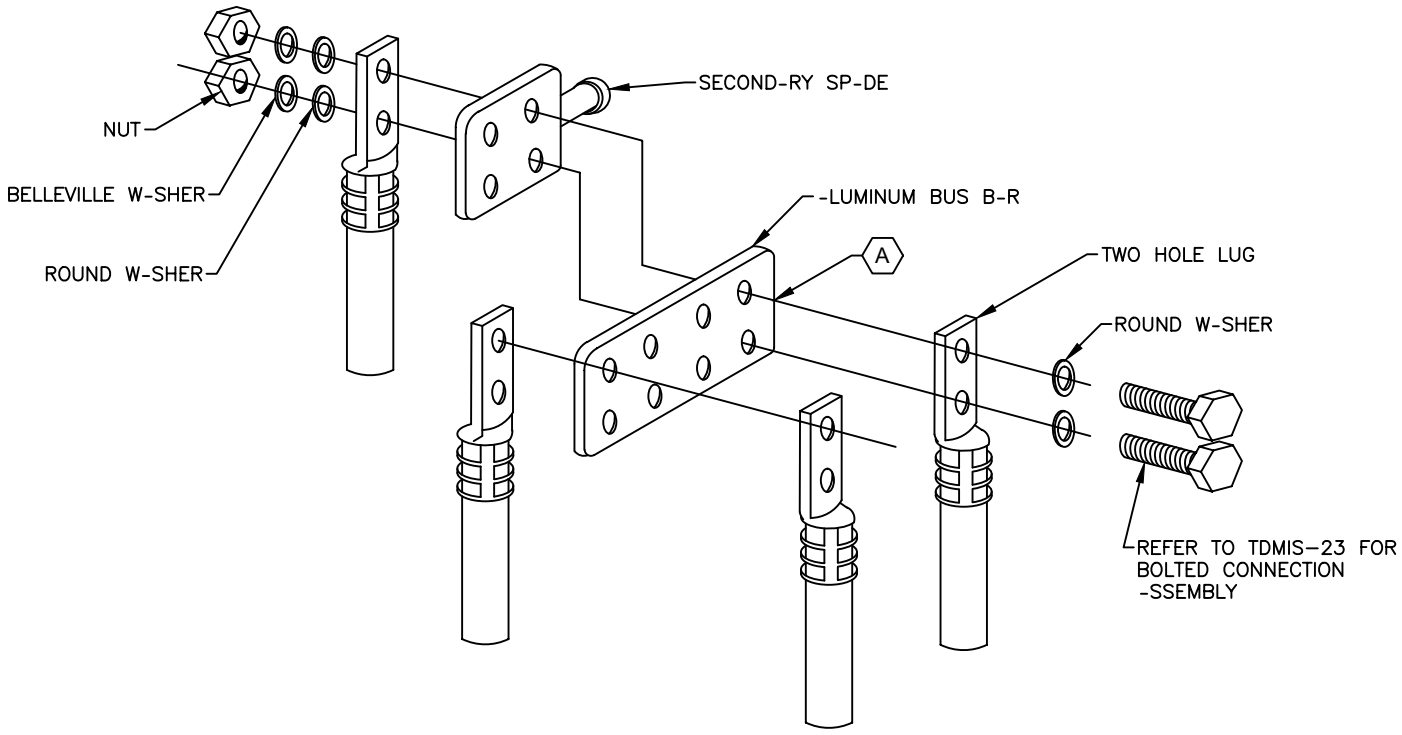

THE CITY OF COLUMBUS
DEPT. OF PUBLIC UTILITIES
DIVISION OF POWER

OVERHEAD TRANSFORMER
ALUMINUM SECONDARY CONNECTIONS

TDMIS–802